


MT-UPM-R7-1P-GNY-75KVA-SZ-BB-A6-BM-CZ-Z-M1

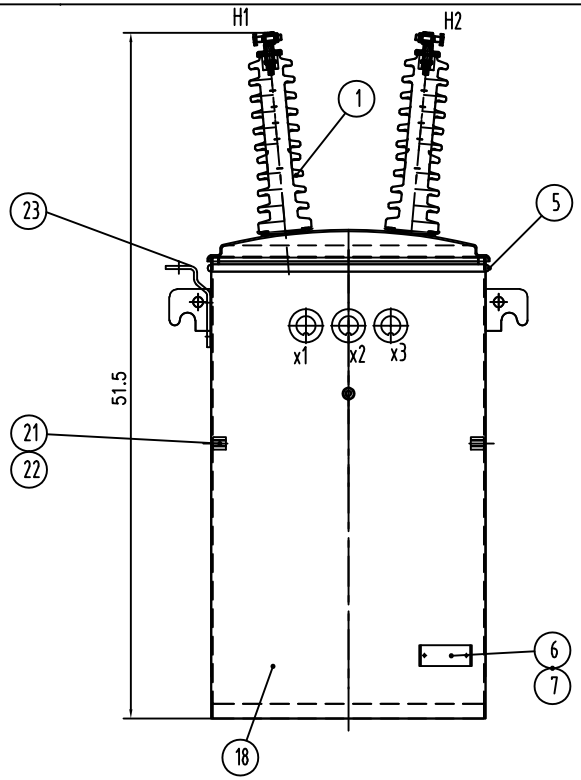

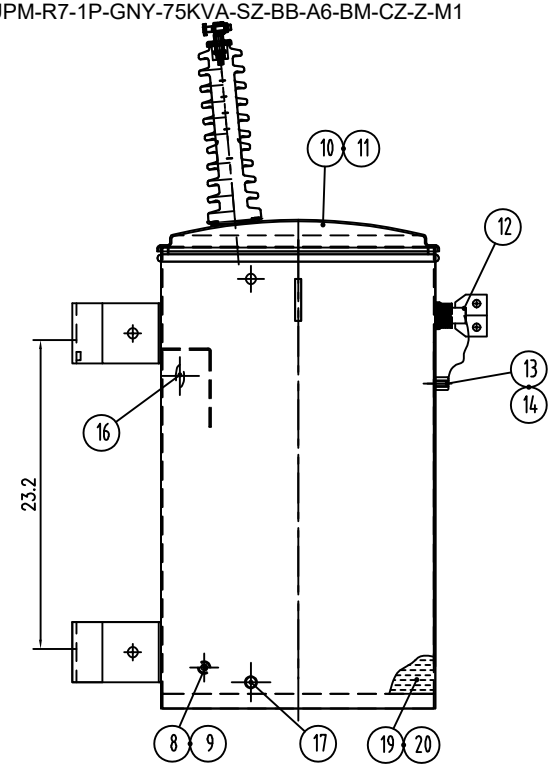


Approx. weight LBS


Untanked	Oil	Total
529	265	948

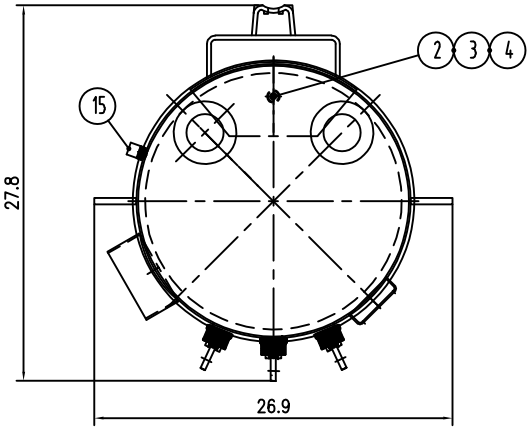


mounting position

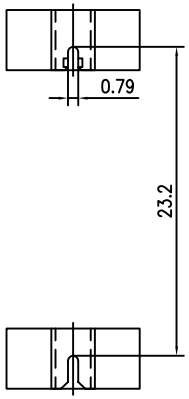


HV terminal



LV terminal



wiring diagram

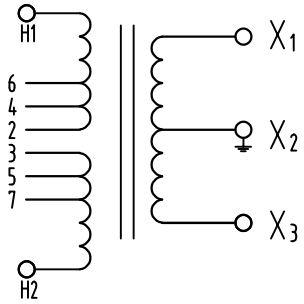

NO.	Code	Name	QTY	Material	Unit Weight	Total Weight	Remark
23		Arrester bracket	2				
22		Washer 12	2				black coated
21		Bolt M12×35	2				black coated
20		Tank assembly	1				
19		Insulation oil	(1)				
18		Tank	1				
17		Oil drain valve	1				
16		Tap changer	1				
15		Pressure relief valve	1				
14		Washer 12	1				galvenized
13		Bolt M12×25	1				galvenized
12		LV bushing	3				
11		Sealing gasket	1				
10		Cover	1				
9		Washer 12	2				galvenized
8		Bolt M12×30	1				galvenized
7		ScrewM4X6	2				
6		Nameplate	1				
5		Hold down gear	1				
4		Ground strap	2	0.3 copper belt			INNER TANK
3		Washer 12	2				black coated
2		Bolt M12×20	2				black coated
1		HV bushing	2				

Mark	Revise	Revision	Signature	Date
Designed		Standard		
Checked		Examined		
Audited		Approved		
Crafted		Date		

Pole Mount TR

23000GrdY/13280V
120/240V, 75KVA

pattern mark	mass	scale
		NOT
page	0	page

LARSON ELECTRONICS

Scan
Checked
0
Signature
Date