

100W Explosion Proof LED Flood Light Fixture - C1D2, C2D1/ C2D2 - Serviceable Junction Box Instruction Manual

This explosion proof light is designed for illumination of industrial locations. It uses the latest in solid state lighting technology for long life, low maintenance and high efficiency.

The unique design focuses the light where it is needed, giving improved efficiency over a conventional HID luminaire.

An internal, universal input, power-factor-corrected switch-mode supply allows it to be used from any nominal 100-277 Volts AC, 50/60Hz or 11-25 Volts AC/DC supply without any variation in light output.

WARNING

To avoid the risk of fire, explosion or electric shock, this product should be installed, inspected and maintained by a qualified electrician only, in accordance with all applicable electrical codes.

To avoid electric shock:

- Be certain electrical power is OFF before and during installation and maintenance.
- Luminaire must be connected to a wiring system with an equipment-grounding conductor.

To avoid explosion:

- Make sure the supply voltage is within the luminaires' voltage rating.
- Ensure the marked T rating is less than the ignition temperature of the Hazardous Atmosphere.
- Do not operate in ambient temperatures above those indicated on the luminaire nameplate.
- Do not operate if the lens is cracked or damaged. All fasteners should be properly seated.

For supply connections, use wire rated for at least 110°C

Recommended mounting height is 25-40 feet.

MOUNTING

This fixture offers an adjustable mounting system that allows this fixture to be mounted to any flat surface including walls and ceilings. A single ½-13 bolt is used to mount the fixture to the surface.

Check to ensure that all mounting hardware is included.

- 2 Small Brackets
- 1 Large Trunnion Bracket
- 8 Bolts
- 8 Lock-Washers
- 4 Nuts

1. Place tower in desired location that is flat and able to support the quadpod without falling over.
2. Loosen hand screw and lower legs until firmly stabilizing quadpod.
3. Tighten hand screw to secure legs.
4. With help, place the light head over top pole and tighten hand screw.

Light weight lamps can be attached by tilting quadpod toward the ground with the legs up. Attach light head to pole, tighten hand screw and tilt back to its vertical position. DO NOT tilt quadpod while extended to max height. It is recommended to have another person hold the quadpod while tilting vertically.

For heavy weight lamps, use a ladder and extra help for attaching light head to pole.

Double check that all hand screws are tight before continuing use of the light tower.

EXTENDING

1. Loosen hand screw for extending the light head. Once loose, extend light head until desired height is achieved with at least 1ft - 2ft remaining inside pole for support.

WARNING: *DO NOT over extend light head completely allowing extension pole to free from base! If the light head becomes free, serious injury or death can occur. Larson Electronics shall not be held liable for injuries caused by misuse.*

2. When desired height is achieved, tighten hand screw to secure light head.

LOWERING

1. To lower mast, grasp light head and slowly loosen hand screw. Lower the light head and tighten hand screw.

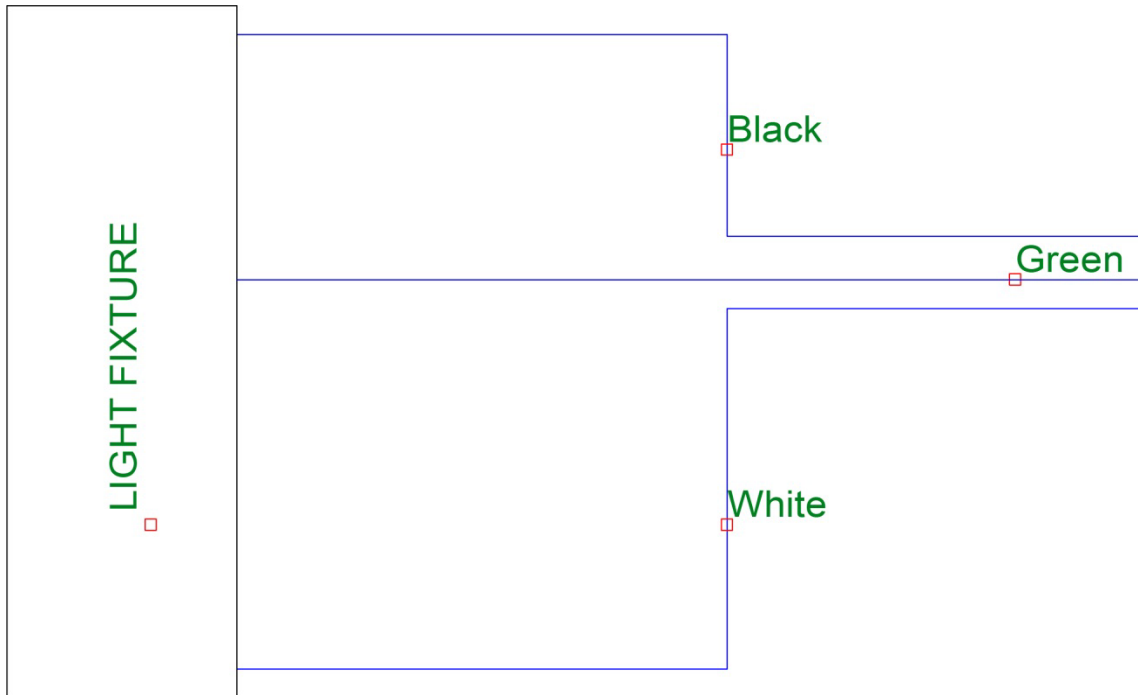
WARNING: *DO NOT loosen hand screw allowing light head to fall freely. This can damage the unit and cause serious injury or death. Always grasp light head before lowering. Larson Electronics shall not be held liable for injuries caused by misuse.*

The quadpod mount light tower can be disassembled for storage or transporting. Unplug light from power source and remove light head following previous steps for attaching.

Once the light head has been removed, loosen hand screw for legs and fold them up. Wheel to desired location or remove from wheel base for complete disassembly.

THE LENS AND CORD MUST BE ROUTINELY CHECKED FOR CUTS, BREAKS, SCRATCHES OR ANY SEVERE ABRASIONS, AND IF ANY ARE FOUND, THE PARTS MUST BE REPLACED BEFORE RESUMING USE OF THE LIGHT TOWER.

The EPL-TP-1x150LED-100 is designed to provide years of reliable lighting performance. Should the need for replacement parts arise, please contact Larson Electronics at the contact information below.

WIRING (see attached wiring diagram)**MAINTENANCE**

Caution: To avoid personal injury, disconnect power to the light and allow the unit to cool down before performing maintenance.

Warning: No user serviceable parts inside of fixture. Risk of electric shock. Removal of the lens will void the warranty.

1. Perform visual, mechanical and electrical inspections on a regular basis. We recommend routine checks to be made on a yearly basis. Frequency of use and environment should determine this. It is recommended to follow an Electrical Preventive Maintenance Program as described in NFPA 70B: Recommended practice for Electrical Equipment.
2. The lens should be cleaned periodically as needed to ensure continued photometric performance. Clean the lens with a damp, non-abrasive, lint-free cloth. If not sufficient, use mild soap or a liquid cleaner.
3. Inspect the cooling fins on the luminaire to ensure that they are free of any obstructions or contamination (i.e. excessive dust build-up). Clean with a non-abrasive cloth if needed.
4. Do not operate if the lens is cracked or damaged. All fasteners should be properly seated.