


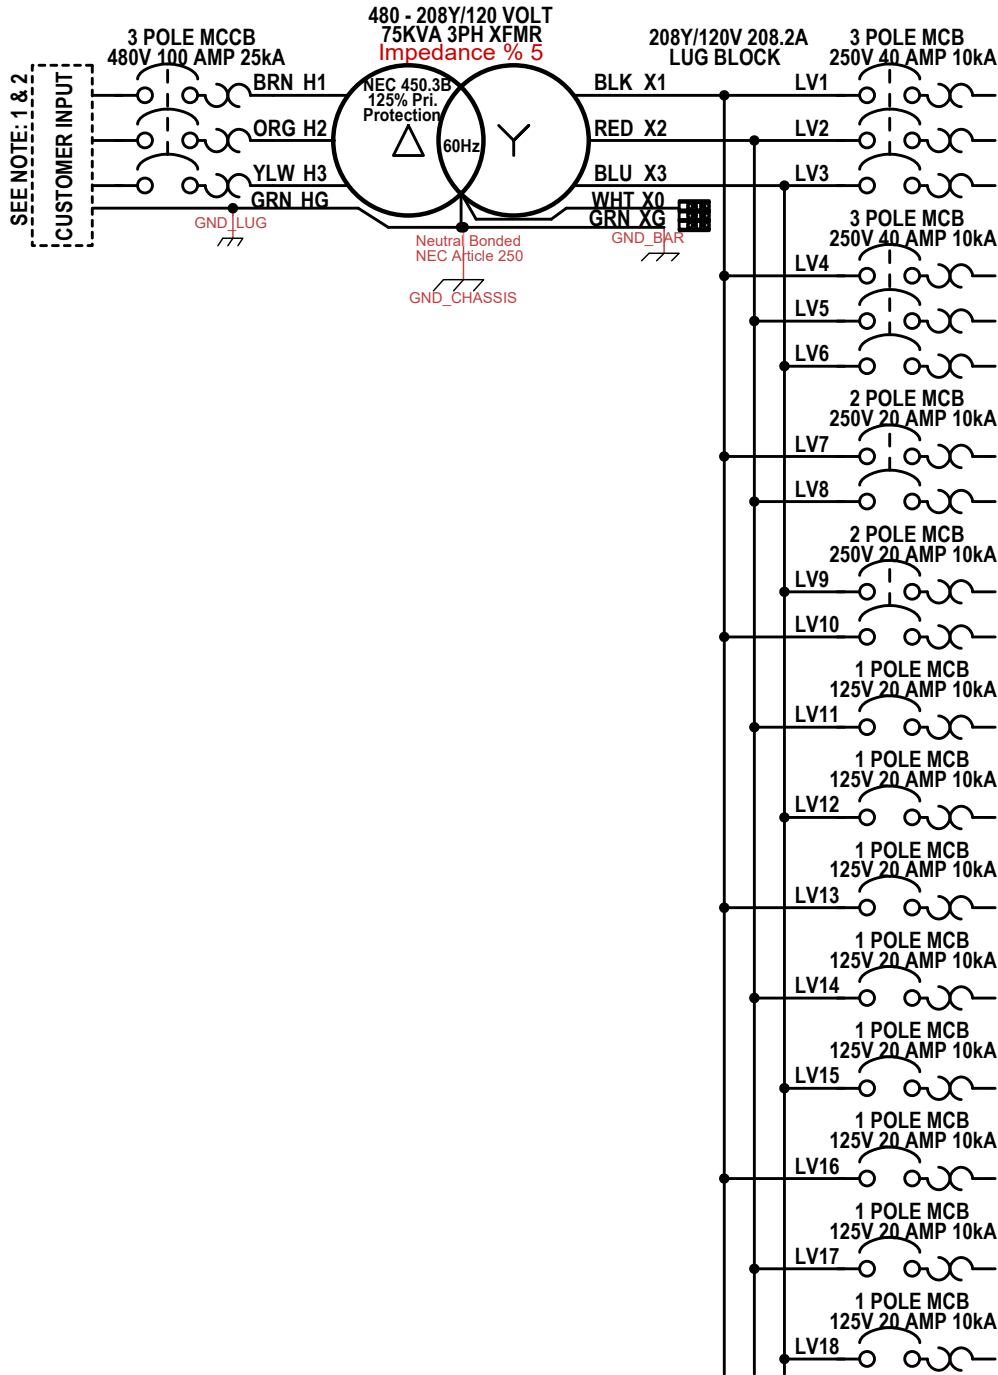

WIRE LEGEND

ID	TYPE	DESCRIPTION	WIRE SIZE
H1	CABLE	600V THHN BROWN	#2 AWG cu
H2	CABLE	600V THHN ORANGE	#2 AWG cu
H3	CABLE	600V THHN YELLOW	#2 AWG cu
HG	CABLE	600V THHN GREEN	#6 AWG cu
X1	CABLE	600V THHN BLACK	#3/0 AWG cu
X2	CABLE	600V THHN RED	#3/0 AWG cu
X3	CABLE	600V THHN BLUE	#3/0 AWG cu
X0	CABLE	600V THHN WHITE	#3/0 AWG cu
XG	CABLE	600V THHN GREEN	#6 AWG cu
LV1	CABLE	600V THHN BLACK	#8 AWG cu
LV2	CABLE	600V THHN RED	#8 AWG cu
LV3	CABLE	600V THHN BLUE	#8 AWG cu
LV4	CABLE	600V THHN BLACK	#8 AWG cu
LV5	CABLE	600V THHN RED	#8 AWG cu
LV6	CABLE	600V THHN BLUE	#8 AWG cu
LV7	CABLE	600V THHN BLACK	#12 AWG cu
LV8	CABLE	600V THHN RED	#12 AWG cu
LV9	CABLE	600V THHN BLUE	#12 AWG cu
LV10	CABLE	600V THHN BLACK	#12 AWG cu
LV11	CABLE	600V THHN RED	#12 AWG cu
LV12	CABLE	600V THHN BLUE	#12 AWG cu
LV13	CABLE	600V THHN BLACK	#12 AWG cu
LV14	CABLE	600V THHN RED	#12 AWG cu
LV15	CABLE	600V THHN BLUE	#12 AWG cu
LV16	CABLE	600V THHN BLACK	#12 AWG cu
LV17	CABLE	600V THHN RED	#12 AWG cu
LV18	CABLE	600V THHN BLUE	#12 AWG cu

USER NOTES:

- 1) USE MINIMUM 600V 100A WIRING
- 2) USE MINIMUM 480V 3PH 100A INPUT SERVICE DEVICE

IEC 60076 permits +/- 10% tolerance in percentage impedance at the manufacturer's end.

Title MPD-CW11-TB.100AB-DE75YT-LZ-2.R62-2.R43-8.R11-M1		
Author David Downs		
File .3PH 75KVA 208Y-120V 208.2A 3PH MLO 2x3P4	Document RV24	
Revision 1.0	Date 08/23/2019	Sheets 1 of 1