

| REV | DESCRIPTION | DATE |
| --- | --- | --- |
| A | QUOTE | 01/30/2025 |

# MPD-CW10-CLP5.100AB-DT30YT-LZ-3.L35-M1


LARSON ELECTRONICS®

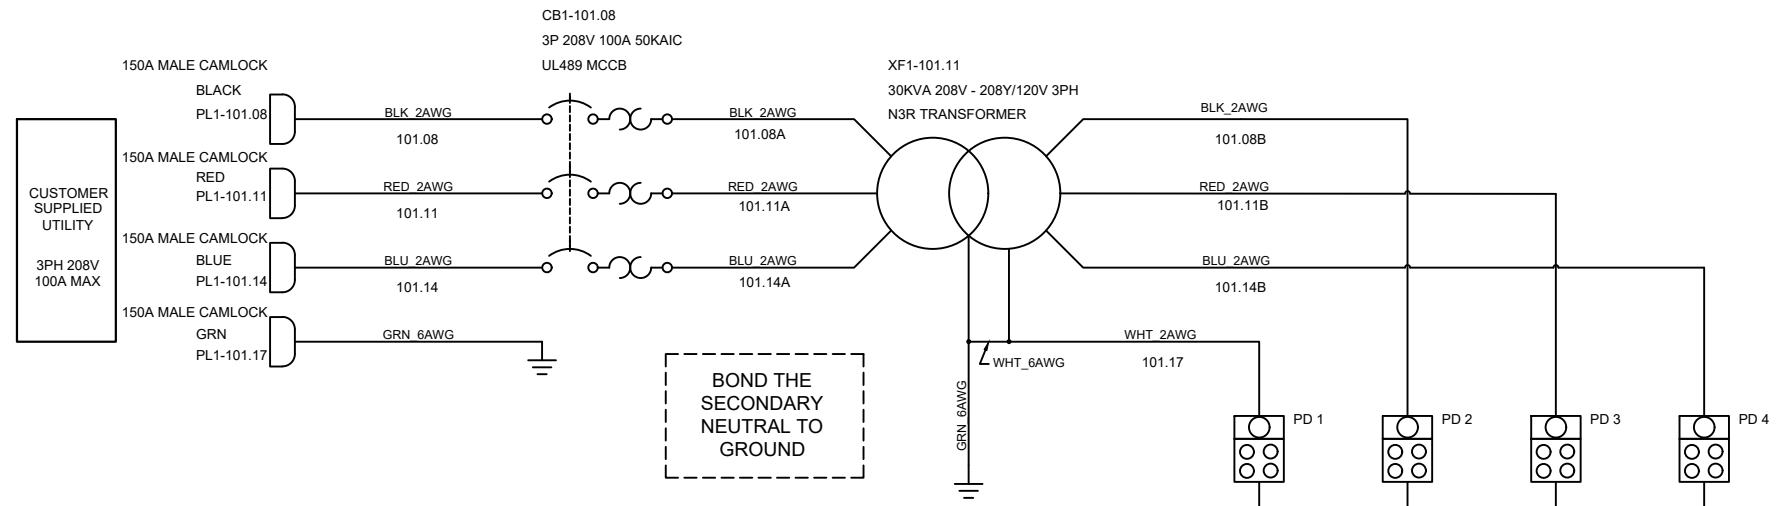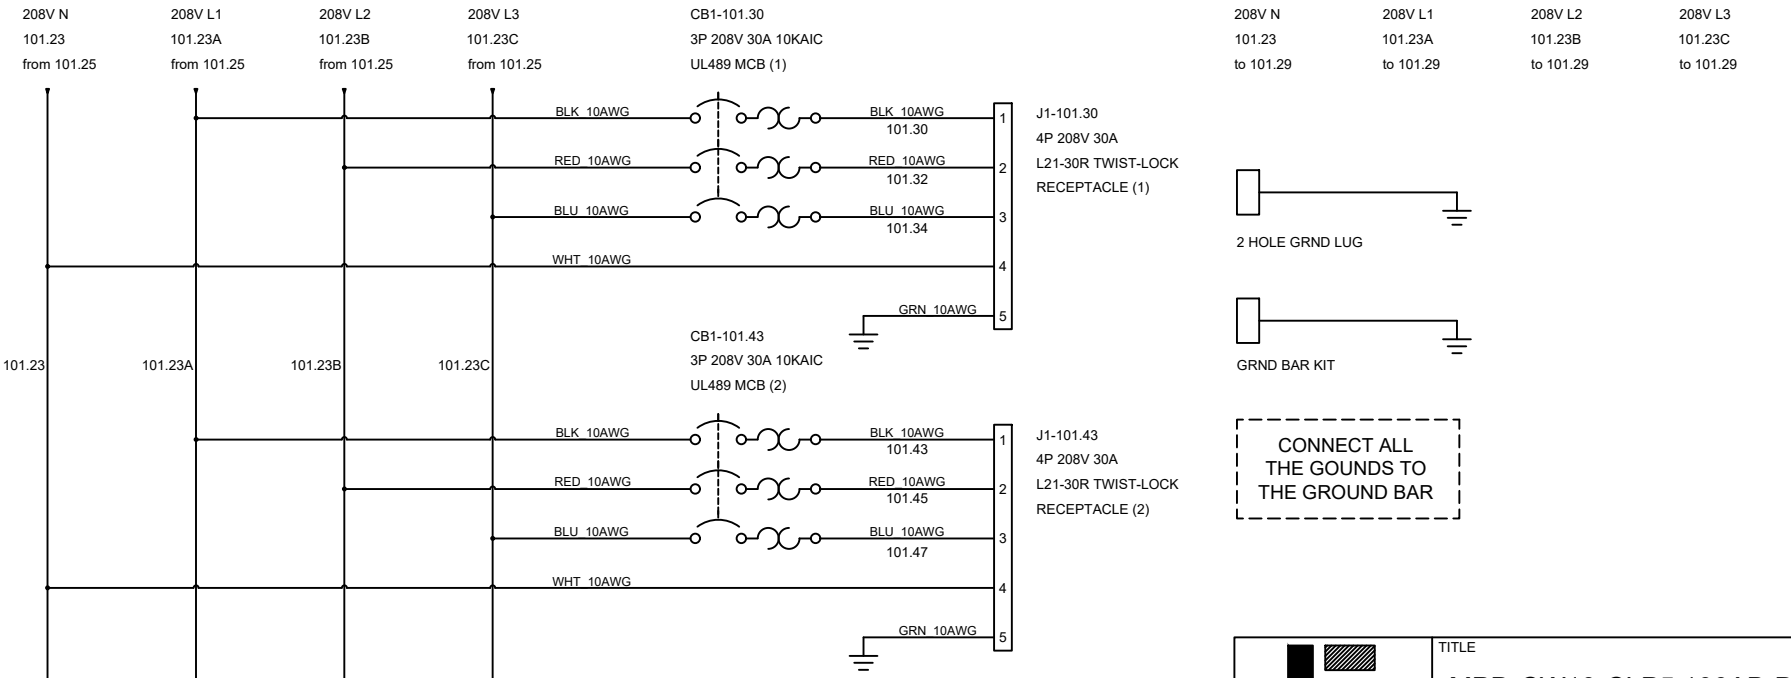


LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

| TITLE | | | |
|---|---|---|---|
| MPD-CW10-CLP5.100AB-DT30YT-LZ -3.L35-M1 | | | |
| DRAWN BY | DATE | REV | |
| L.Calib | 01-30-2025 | A | |
| CHECKED BY | SHEET # | DRAWING # | |
| | 1 OF 2 | 101 | |

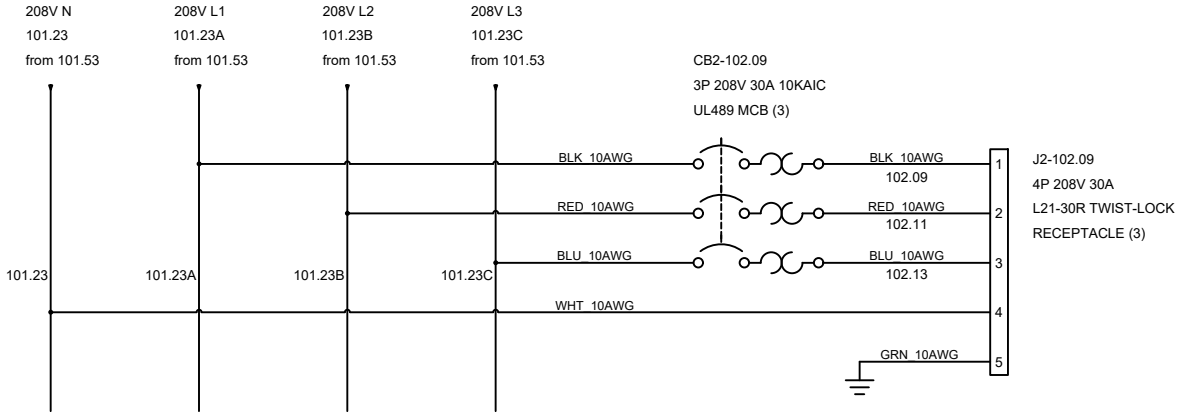


| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| J1-101.30<br>J1-101.43<br>J2-102.09 | 3 | UNV00007119 | 3P 5W 120/208V 30A L21-30R LOCKING RECEPTACLE |
| 2 HOLE GRND LUG | 1 | UNV00007136 | 2 HOLE GROUND LUG |
| PL1-101.17 | 1 | UNV00002277 | 600V 150A 8-2AWG MALE PANEL RECEPTACLE CAM LOCK-GREEN |
| PL1-101.08 | 1 | UNV00013726 | 600V 150A 8-2AWG MALE PANEL RECEPTACLE CAM LOCK-BLACK |
| PL1-101.11 | 1 | UNV00013727 | 600V 150A 8-2AWG MALE PANEL RECEPTACLE CAM LOCK-RED |
| PL1-101.14 | 1 | UNV00013728 | 600V 150A 8-2AWG MALE PANEL RECEPTACLE CAM LOCK-BLUE |
| CB1-101.30<br>CB1-101.43<br>CB2-102.09 | 3 | UNV00015171 | 3P 30A 240V UL489 DIN RAIL MOUNT CIRCUIT BREAKER |
| CB1-101.08 | 1 | UNV00014727 | 3P 100A 240/480VAC MCCB |
| PD 1<br>PD 2<br>PD 3<br>PD 4 | 4 | UNV00015084 | POWER DISTRIBUTION BLOCK 175 A 600V 1-4 OPENING |
| GRND BAR KIT | 1 | UNV00013942C | GROUND BAR KIT |
| XF1-101.11 | 1 | UNV00017959 | 3PH 30KVA 208V-208Y/120V N3R TRANSFORMER |

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW10-CLP5.100AB-DT30YT-LZ-3.L35-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 01-30-2025 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 2 OF 2 | 102 |