

| REV | DESCRIPTION | DATE |
| --- | --- | --- |
| A | QUOTE | 01/05/2026 |

# MPD-CW11-TB.100AB-DE75YT-LQ-6.C10-2.N10-M1


LARSON ELECTRONICS®

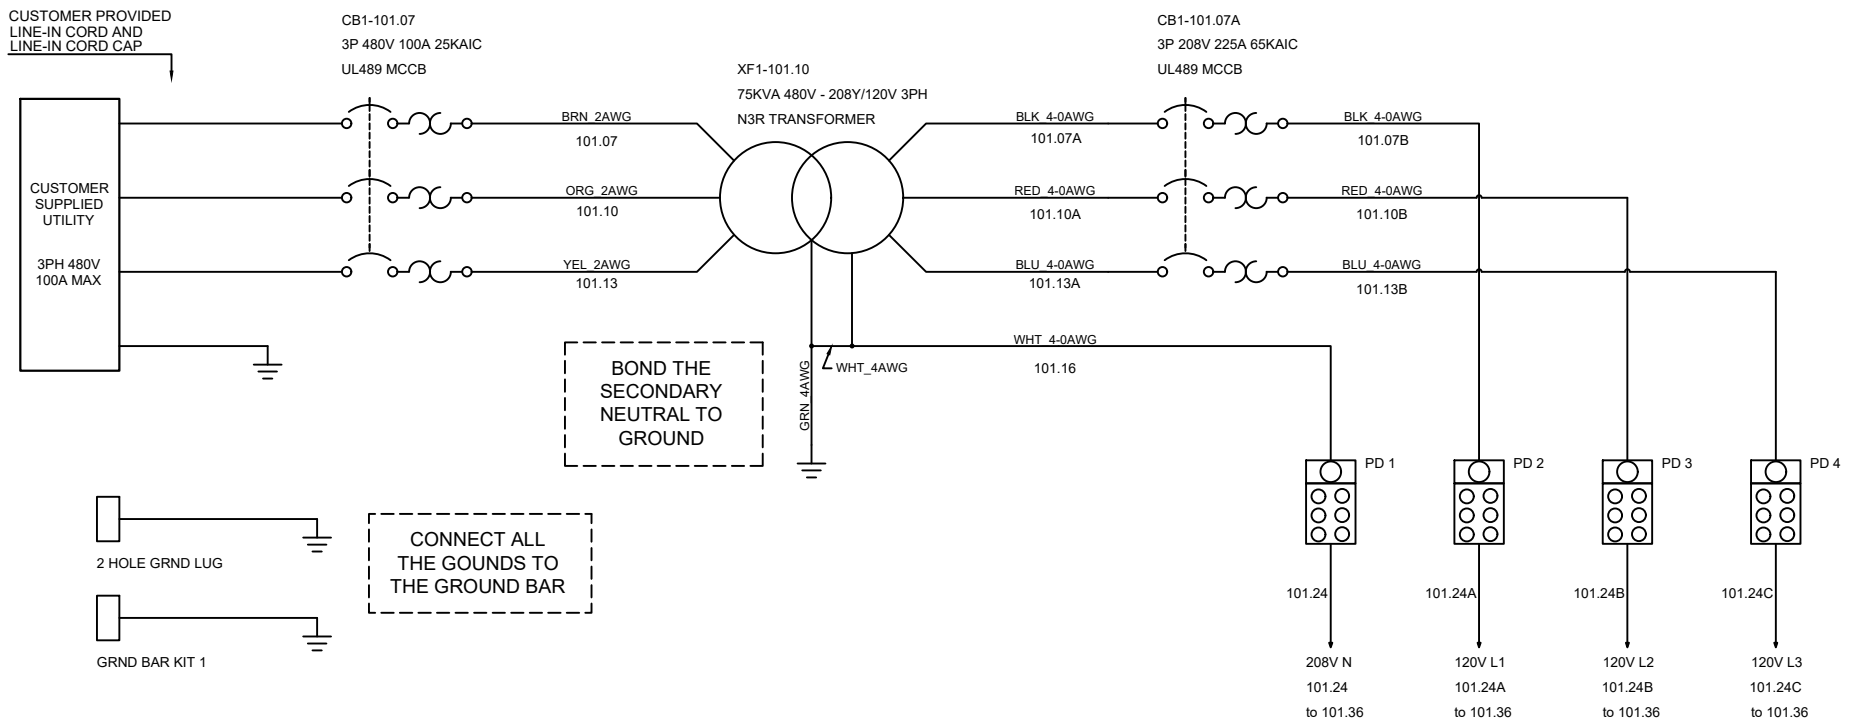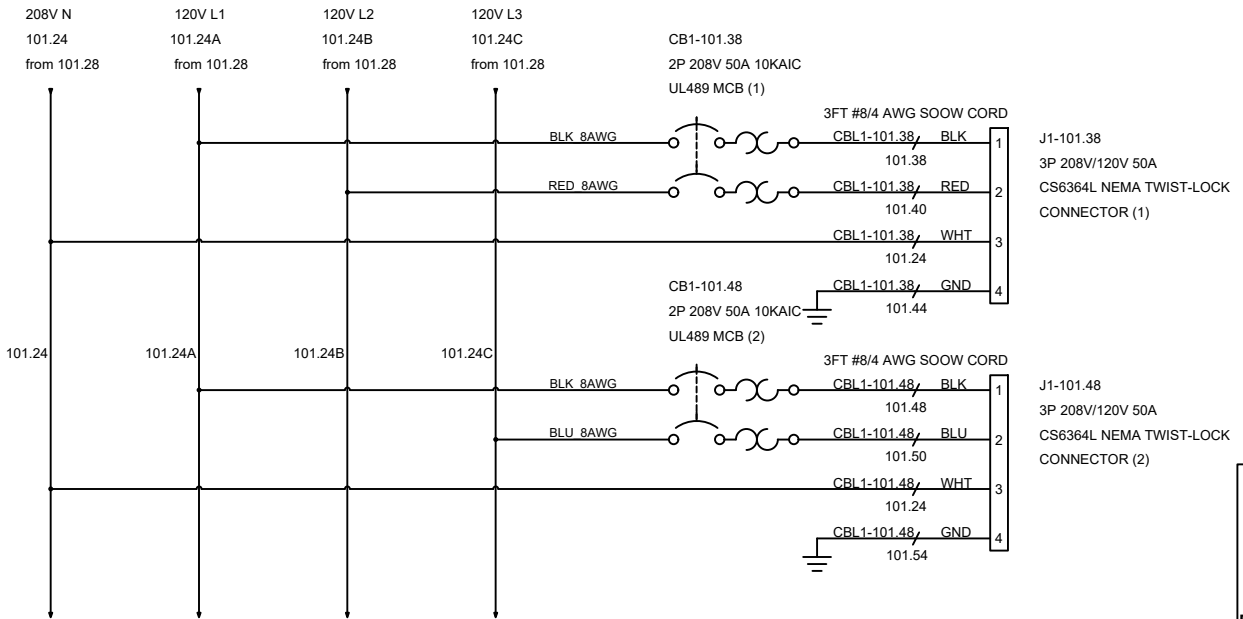


LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

| TITLE | | | |
|---|---|---|---|
| MPD-CW11-TB.100AB-DE75YT-LQ-6.C10-2.N10-M1 | | | |
| DRAWN BY | DATE | REV | |
| L.Calib | 01-05-2026 | A | |
| CHECKED BY | SHEET # | DRAWING # | |
| | 1 OF 3 | 101 | |

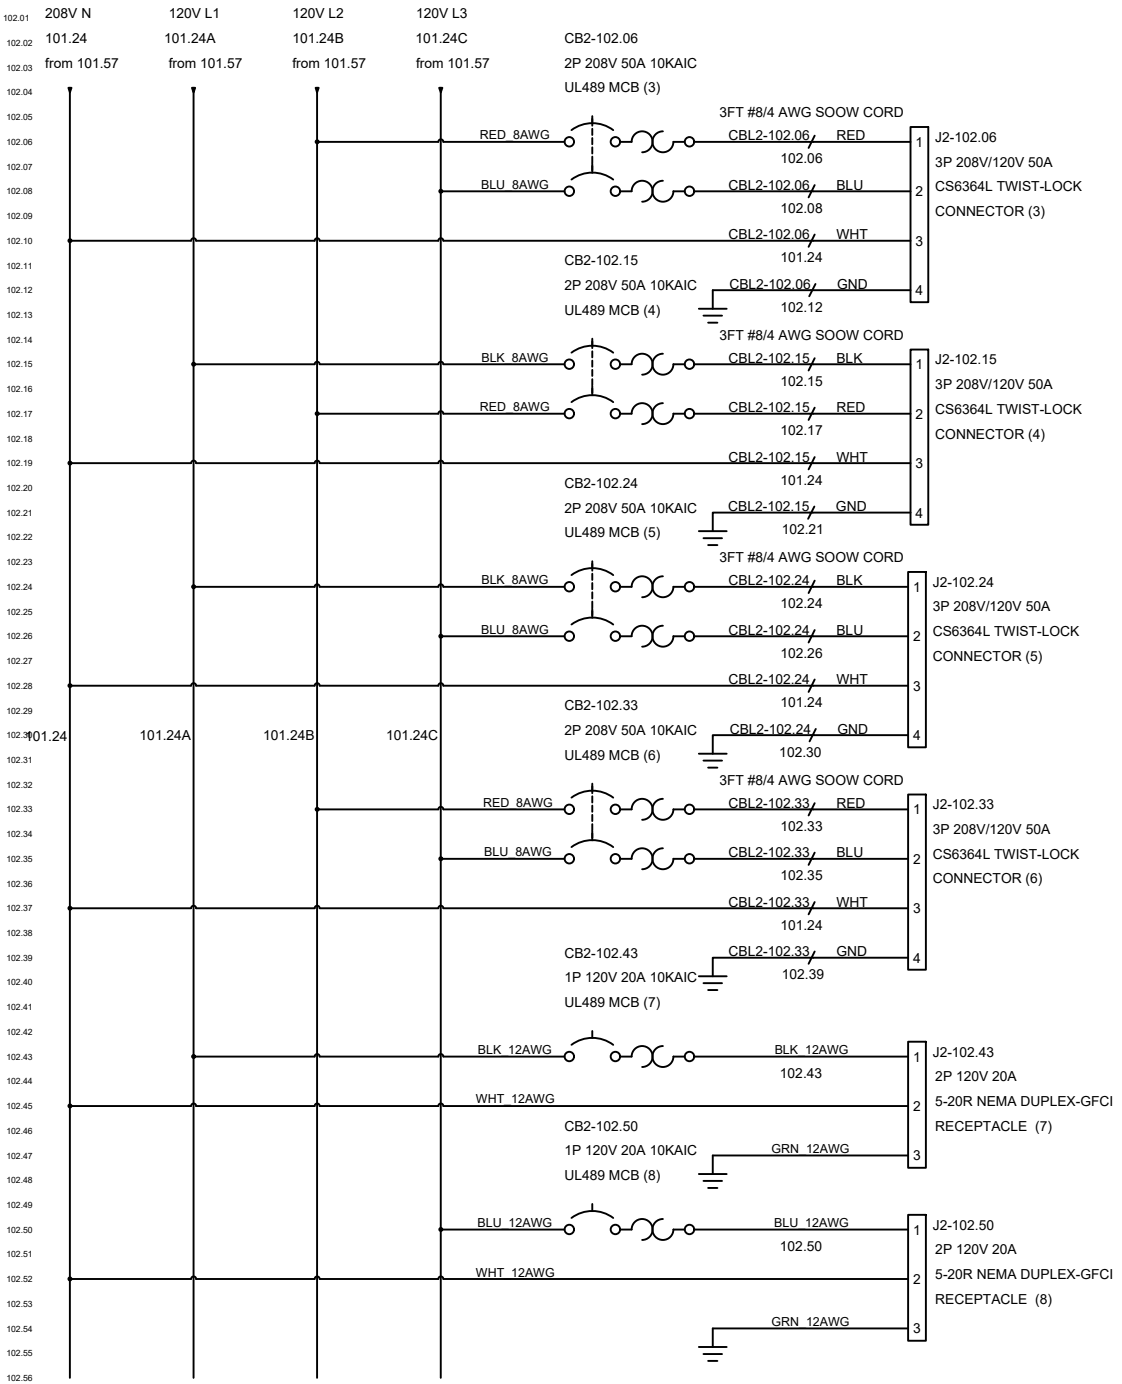


LARSON ELECTRONICS

9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW11-TB.100AB-DE75YT-LQ-6.C10-2.N10-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 01-05-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 2 OF 3 | 102 |

| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| 2 HOLE GRND LUG | 1 | UNV00007136 | 2 HOLE GROUND LUG |
| J2-102.43<br>J2-102.50 | 2 | UNV00014533 | 5-20R 1P 20A 125V GFCI RECEPTACLE |
| J1-101.38<br>J1-101.48<br>J2-102.06<br>J2-102.15<br>J2-102.24<br>J2-102.33 | 6 | UNV00005505 | 3P 240V 50A CS6364L LOCKING CONNECTOR |
| CB1-101.38<br>CB1-101.48<br>CB2-102.06<br>CB2-102.15<br>CB2-102.24<br>CB2-102.33 | 6 | UNV00014731 | 2P 250V 50A DIN RAIL MOUNT MCCB UL489 |
| CB1-101.07A | 1 | UNV00015187 | 3P 480V 225A UL489 MCCB |
| CB2-102.43<br>CB2-102.50 | 2 | UNV00017491 | 1P 125V 20A 10KA UL489 DIN RAIL MOUNT BREAKER |
| CB1-101.07 | 1 | UNV00014727 | 3P 100A 240/480VAC MCCB |
| PD 1<br>PD 2<br>PD 3<br>PD 4 | 4 | UNV00016633 | POWER DISTRIBUTION BLOCK 380A 1-6 OPENING |
| GRND BAR KIT 1 | 1 | UNV00013942C | GROUND BAR KIT |
| CBL1-101.38<br>CBL1-101.48<br>CBL2-102.06<br>CBL2-102.15<br>CBL2-102.24<br>CBL2-102.33 | 6 | UNV00007449 | #8/4 AWG SOOW CORD |
| XF1-101.10 | 1 | UNV00001275 | 480DTO 208Y 75KVA TRANSFORMER |

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW11-TB.100AB-DE75YT-LQ-6.C10-2.N10-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 01-05-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 3 OF 3 | 103 |