Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664

MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

350-Amp & 225-Amp Portable I-Line Panel, 5 Panels, 480Y/277V Wye PH, (40) 15-Amp MCCB & (1) 70-Amp MCCB Total, NEMA 1

Product ID: 322509



Image: MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

Larson Electronics LLC manufactures a wide variety of products, including custom built to spec designs. The pictures displayed for this unit are a general representation of form factor for the product line and may not accurately represent this exact configuration in every detail due to custom builds and changes between similar products in our standard catalog. The specifics for this configuration are listed in the specification table and supporting documentation (CAD files, Dimensional Drawing, Name Plate Diagram, Wiring Diagram, etc.). This means that specific details (receptacles, plugs, wires, connections, mounting brackets, external finishes, etc.) may not be accurately represented in images vs specifications. Please review specifications and do not order based solely on images.

MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1 - Temporary Power Distribution System

Line-in Cord: Not Included - Requires Minimum Use Wiring 350A Rated Cu @ [600V] (**Customer Provided**)
Line-in Cord Cap: Not Included – Requires Minimum Use Device 350A @ [480Y/277V] (**Customer Provided**)
Primary Voltage (V): 480Y/277V AC Wye
Primary Phase (PH): 3-Phase (3PH)
Primary Frequency (HZ): 60 Hz (60-cycles)
Primary Panel(s): 480Y/277V 3PH 350A MCCB NEMA 1; (4) 480Y/277V 3PH 225A MCCB NEMA 1 42CKT Panel
Primary Breaker(s):

PANEL A: (14) 15A 3P MCCB [480V];

PANEL B: (13) 15A 3P MCCB [480V];

PANEL C: (13) 15A 3P MCCB [480V];

PANEL D: (1) 70A 3P MCCB [480V]
Primary Outlet(s): N/A – (**Customer Provided**)
Primary Protection: MCCB Circuit Breakers
Transformer (KVA): N/A
Secondary Voltage (V): N/A
Secondary Phase (PH): N/A
Secondary Frequency (HZ): N/A

Ratings

Max Primary OCP: 350A @ 480V

Max Secondary Output: N/A

NEMA 3R Indoor/Outdoor Use
Made in the USA
NRTL Certified to UL 1640

NRTL Certified to CSA C22.2 No. 14

Powder Coat Finish Standards:
Complies with ASTM D-523
Complies with ASTM D-3359
Complies with ASTM D-522
Complies with ASTM D-3363

Secondary Panel: N/A
Secondary Breaker(s): N/A
Secondary Outlet(s): N/A
Secondary Protection: N/A
Form Factor: Powder Coated I-Line Panel w/ Pad Mount and Skids
Doors: (2)
Frame Material: Steel
Frame Finish: High-Strength TGIC Polyester Powder Coated Blue
Cart Handle Orientation: Horizontal
Lifting Eyelet: (4) Top Located
Skid Pockets: (2) Bottom Located
Casters: N/A
Dimensions: (*Please note that dimensions are approximate and subject to change*) 58.5"-L x 33.5"-W x 73.7"-H
Weight: (*Please note that weight is approximate and subject to change*) 1650 lb
Larson Electronics manufactures a wide variety of custom power distribution systems. The pictures displayed for this unit are a general representation of form factor and may not accurately represent this exact configuration in every detail due to being custom builds. The specifics for this configuration are listed in the specification table and one-line diagram.

Complies with ASTM D-2794

Special Orders - Special Requirements
Contact us for special requirements
Intl: 1-214-616-6180
Toll Free: 1-800-369-6671

Fax: 1-903-765-7664

E-mail: sales@larsonelectronics.com

All grounding shall comply with state and local codes and meet the minimum requirements of the National Electronic Code section 250

Made in Texas

The MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1 from Larson Electronics is a Temporary Power Distribution System that utilizes three-phase 480Y/277V AC Wye electrical current. This unit provides operators the ability to safely tap into and distribute 480Y/277V AC Wye power from a variety of sources including generators and direct grid power. This unit is rated NEMA 1.

PLEASE NOTE: ANY FREE SHIPPING OFFERS DO NOT APPLY TO POWER DISTRIBUTION PANELS, TRANSFORMERS, OR SUBSTATIONS*

The MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1 temporary power distribution system gives operators the ability to power their 480 volt and 277 volt equipment from a single system.

Operation:

• Primary Voltage: 480Y/277V AC Wye 3PH

• Primary Panel(s): 480Y/277V 3PH 350A MCCB NEMA 1; (4) 480Y/277V 3PH 225A MCCB NEMA 1 42CKT Panel

• Primary Breaker(s):

PANEL A: (14) 15A 3P MCCB [480V];

PANEL B: (13) 15A 3P MCCB [480V];

PANEL C: (13) 15A 3P MCCB [480V];

PANEL D: (1) 70A 3P MCCB [480V]

• Primary Outlet(s): N/A – (**Customer Provided**)

• Primary Protection: MCCB Circuit Breakers

• Transformer: N/A

• Secondary Voltage: N/A

• Secondary Panel: N/A

• Secondary Breaker(s): N/A

• Secondary Outlet(s): N/A

*See specification table at the top of the page for more information about the power distribution system.

Protective Construction: This temporary power distribution panel is fully enclosed and is ruggedly constructed to withstand demanding conditions and industrial applications. The system is accessible via front locking doors for access to breakers on the panels. The receptacles are side mounted to the enclosure and provide weatherproof flip covers. This model is equipped with bottom-located forklift skid pockets and top-located lifting eyelets, which allows easy lifting with cable or chain hooks. An external protects the panel from external damage while in the field.

The power distribution system is constructed of steel with a polyester powder coated finish for durability against dirt, moisture, and mild corrosion. This special coating creates a high-strength barrier for protection from accidental bumps and scratches. The TGIC polyester powder coat finish offers reliable resistance against chemicals, UV light (sun light), and degrading elements in outdoor locations. Our powder coating solution ensures robust color retention for many years without fading. Custom colors, such as black, grey, white, desert tan, or forest green, and galvanized finishes are available upon request. Non-standard powder coat colors or galvanized finishes may increase price and lead times.

The load center/distribution assembly is mounted to a 2" x 2" x 1/8" thick steel frame resulting in an extremely stable, durable, and mobile power distribution platform. A top located lift eye allows easy lifting with cable or chain hooks. This temporary power distribution solution can be modified to meet the needs of job-site receptacle requirements. Larger units are available upon request and can be equipped with skids or trailer mounted.

Certification: All units are built in accordance to NFPA 70 (National Electric Code) and NRTL certified to UL 1640. This equipment is NEMA 1 rated for indoor use. NEMA 3R, 4 and NEMA 4X equipment can be equipped upon request.

Grounding: Transformer is grounded to the frame and we provide a grounding lug on the frame for the earth ground.
~Please check all motor loads for dual rated motors that will work 208 or 240.~

Applications: This power distribution system is ideal for indoor use and applications including but not limited to, construction sites, plant maintenance, plant turnarounds, shows, exhibits, and shipyard operations. These power distribution systems are popularly used in applications


where external power sources are often necessary. We also offer class rated transformers for use within explosion proof and hazardous location environments.

Custom Built Systems Available: Larson Electronics is a manufacturer and we can build portable power distribution systems to your specifications. Although we carry several models of portable power distribution systems in stock, we can deliver custom ordered units almost as quickly as our prebuilt units. If this model does not meet your needs, please contact us at 1-800-369-6671 or sales@larsonelectronics.com to discuss your specific requirements.


REV	DESCRIPTION	DATE
A	QUOTE	08/11/2025


MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

LARSON ELECTRONICS®

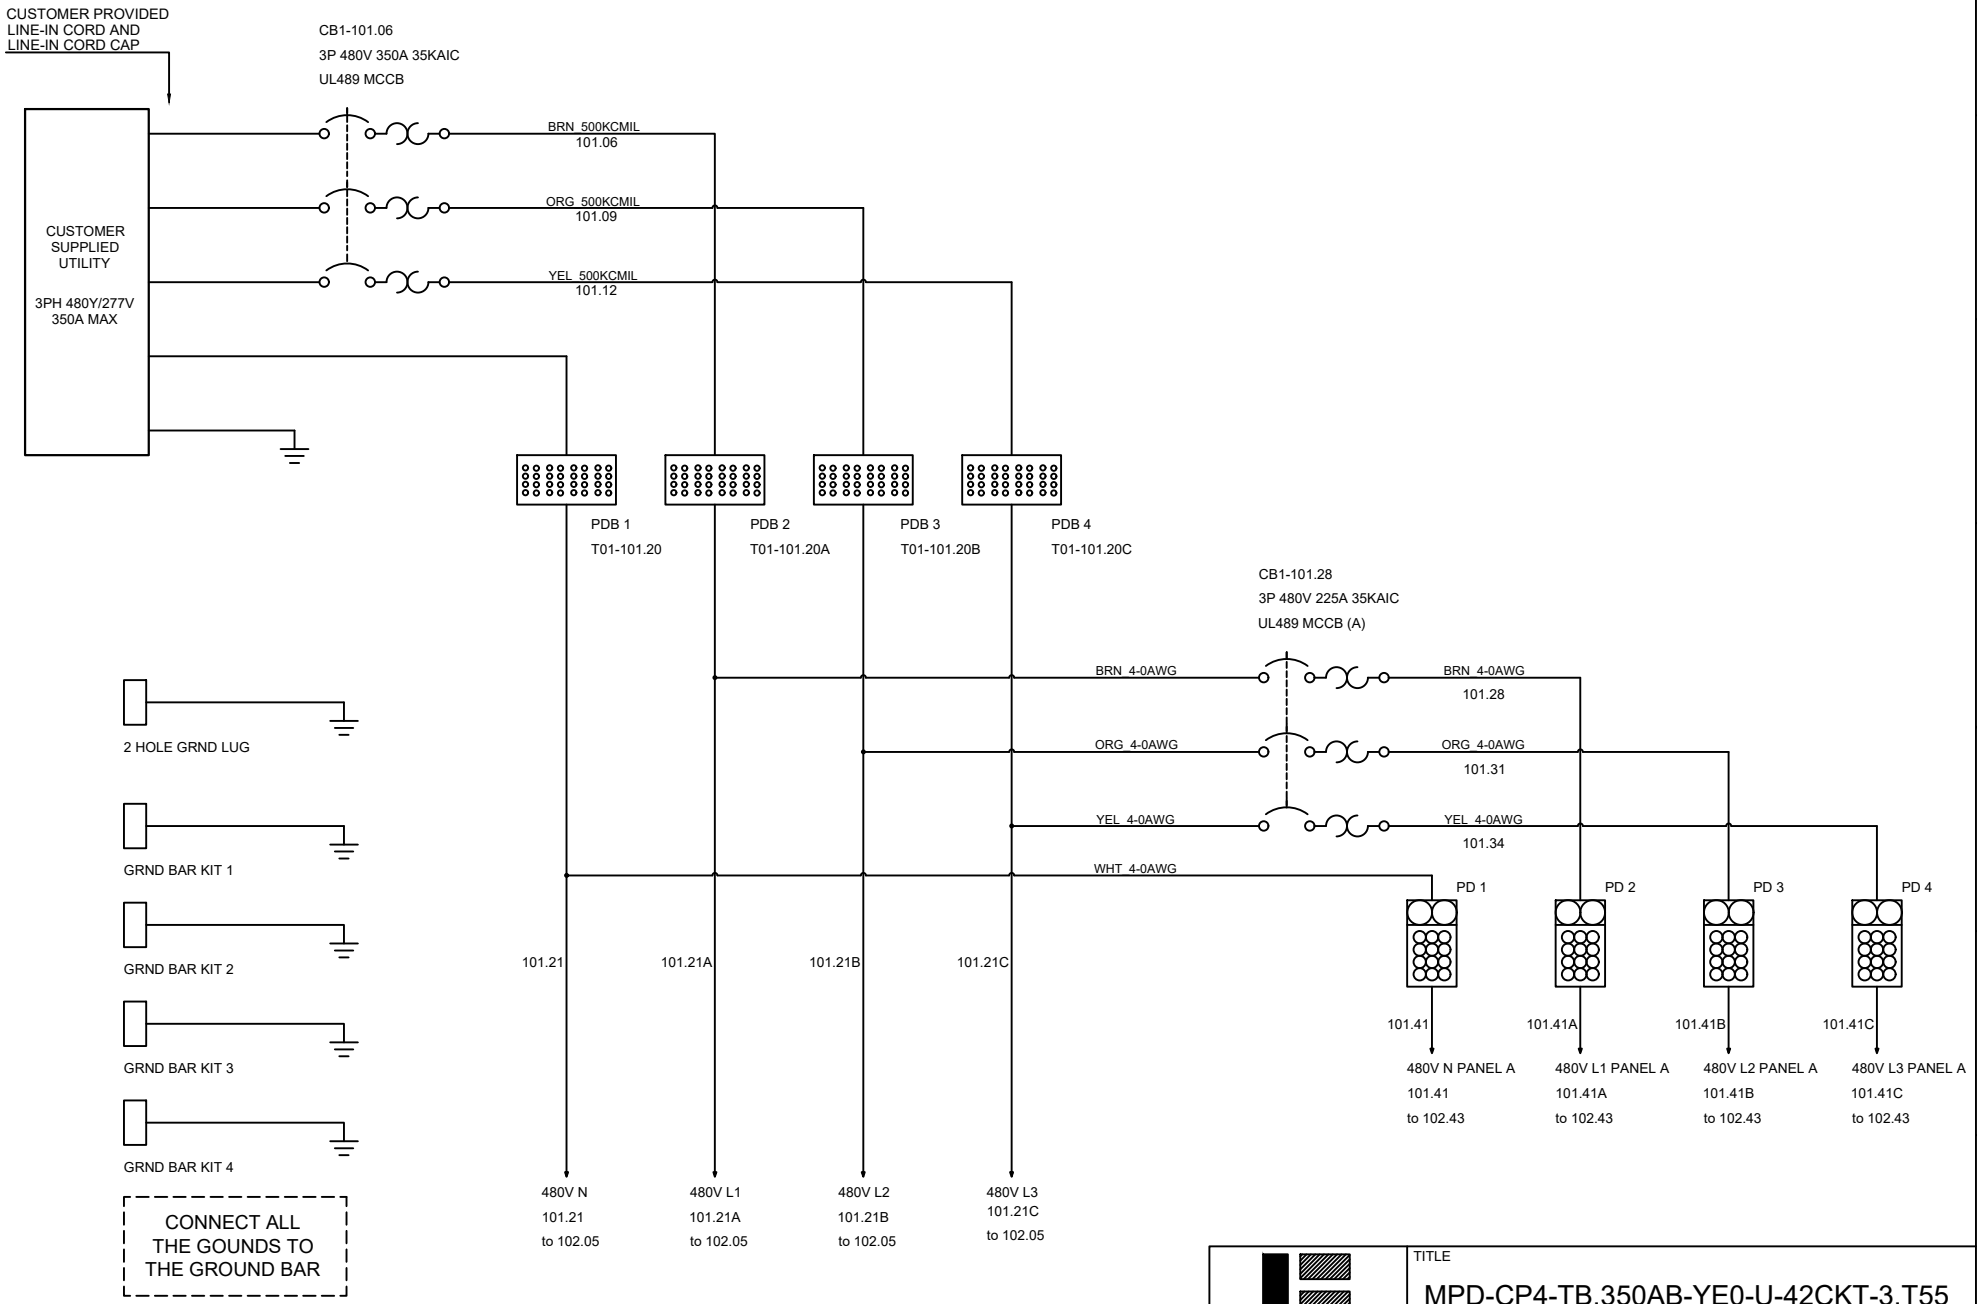

LARSON ELECTRONICS 9419 E US HWY 175, KEMP, TX 75143	TITLE: MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1		
	DRAWN BY: L.Calib	DATE: 08-11-2025	REV: A
	CHECKED BY:	SHEET #: 1 OF 8	DRAWING #: 101

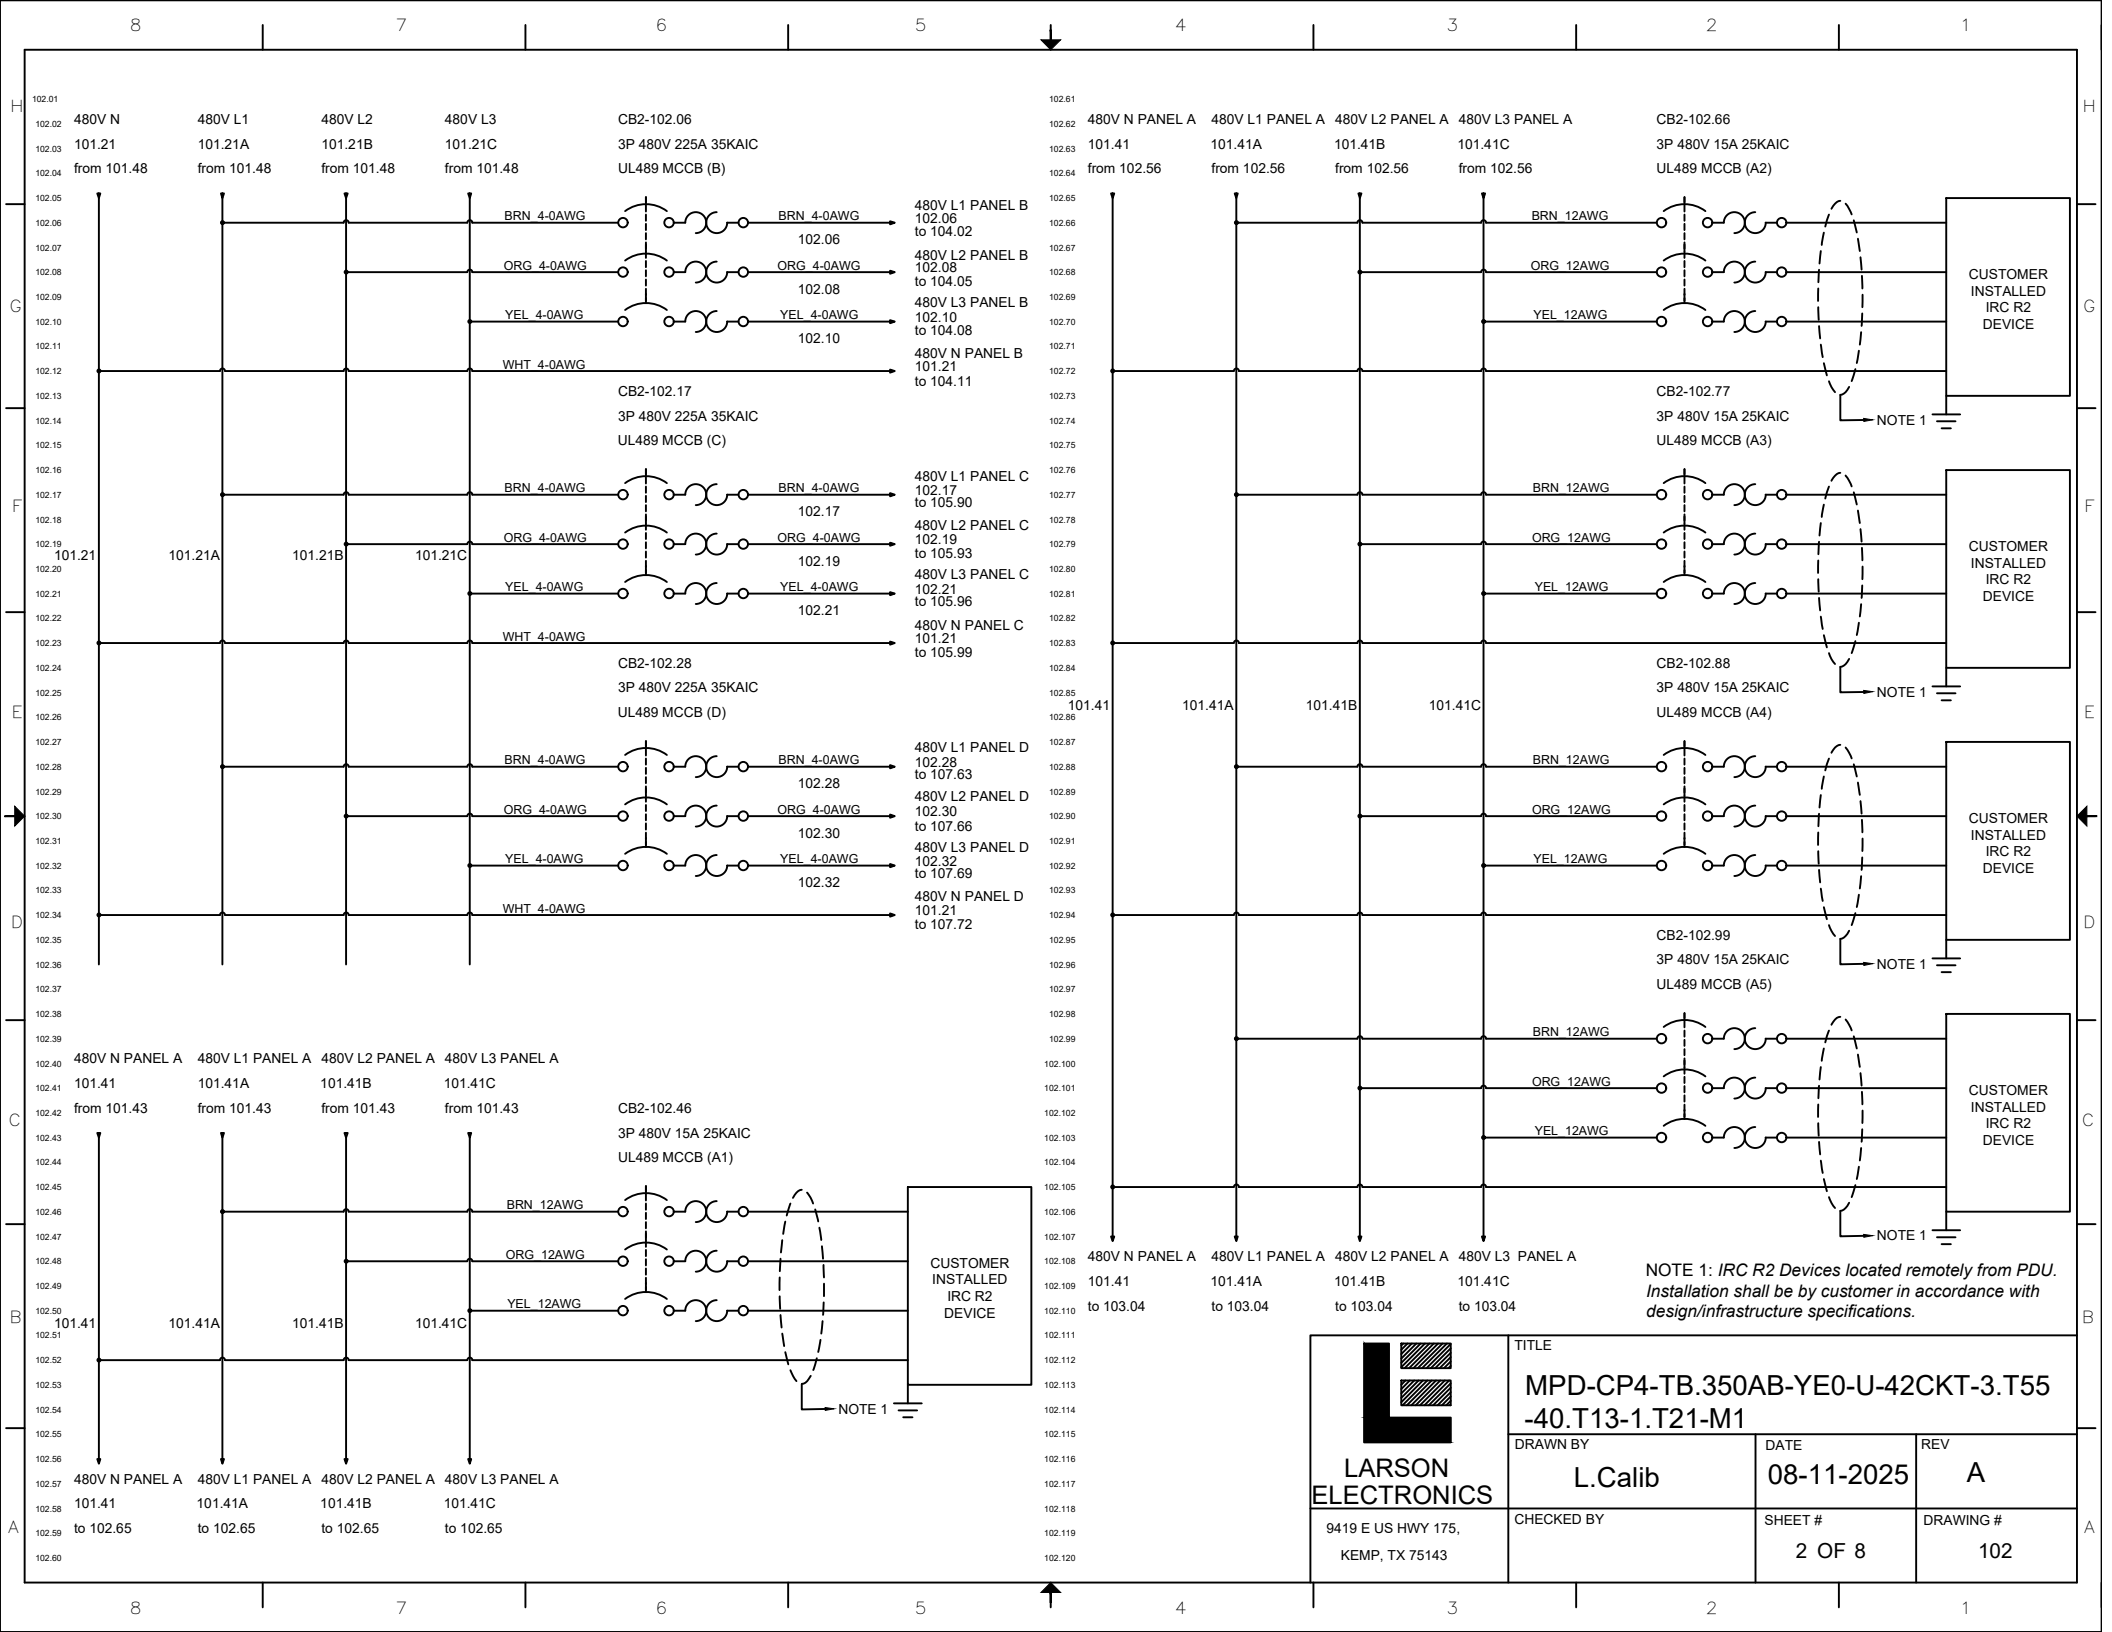

480V N
101.21
from 101.48
480V L1
101.21A
from 101.48
480V L2
101.21B
from 101.48
480V L3
101.21C
from 101.48
CB2-102.06
3P 480V 225A 35KAIC
UL489 MCCB (B)
BRN 4-0AWG
ORG 4-0AWG
YEL 4-0AWG
WHT 4-0AWG
BRN 4-0AWG 102.06
ORG 4-0AWG 102.08
YEL 4-0AWG 102.10
480V L1 PANEL B 102.06 to 104.02
480V L2 PANEL B 102.08 to 104.05
480V L3 PANEL B 102.10 to 104.08
480V N PANEL B 101.21 to 104.11
CB2-102.17
3P 480V 225A 35KAIC
UL489 MCCB (C)
BRN 4-0AWG 102.17
ORG 4-0AWG 102.19
YEL 4-0AWG 102.21
480V L1 PANEL C 102.17 to 105.90
480V L2 PANEL C 102.19 to 105.93
480V L3 PANEL C 102.21 to 105.96
480V N PANEL C 101.21 to 105.99
CB2-102.28
3P 480V 225A 35KAIC
UL489 MCCB (D)
BRN 4-0AWG 102.28
ORG 4-0AWG 102.30
YEL 4-0AWG 102.32
480V L1 PANEL D 102.28 to 107.63
480V L2 PANEL D 102.30 to 107.66
480V L3 PANEL D 102.32 to 107.69
480V N PANEL D 101.21 to 107.72
101.21
101.21A
101.21B
101.21C
480V N PANEL A
101.41
from 101.43
480V L1 PANEL A
101.41A
from 101.43
480V L2 PANEL A
101.41B
from 101.43
480V L3 PANEL A
101.41C
from 101.43
CB2-102.46
3P 480V 15A 25KAIC
UL489 MCCB (A1)
BRN 12AWG
ORG 12AWG
YEL 12AWG
CUSTOMER INSTALLED IRC R2 DEVICE
NOTE 1
101.41
101.41A
101.41B
101.41C
480V N PANEL A
101.41
to 102.65
480V L1 PANEL A
101.41A
to 102.65
480V L2 PANEL A
101.41B
to 102.65
480V L3 PANEL A
101.41C
to 102.65
480V N PANEL A
101.41
from 102.56
480V L1 PANEL A
101.41A
from 102.56
480V L2 PANEL A
101.41B
from 102.56
480V L3 PANEL A
101.41C
from 102.56
CB2-102.66
3P 480V 15A 25KAIC
UL489 MCCB (A2)
CB2-102.77
3P 480V 15A 25KAIC
UL489 MCCB (A3)
CB2-102.88
3P 480V 15A 25KAIC
UL489 MCCB (A4)
CB2-102.99
3P 480V 15A 25KAIC
UL489 MCCB (A5)
480V N PANEL A
101.41
to 103.04
480V L1 PANEL A
101.41A
to 103.04
480V L2 PANEL A
101.41B
to 103.04
480V L3 PANEL A
101.41C
to 103.04
NOTE 1: IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1
DRAWN BY
L.Calib
DATE
08-11-2025
REV
A
CHECKED BY
SHEET #
2 OF 8
DRAWING #
102

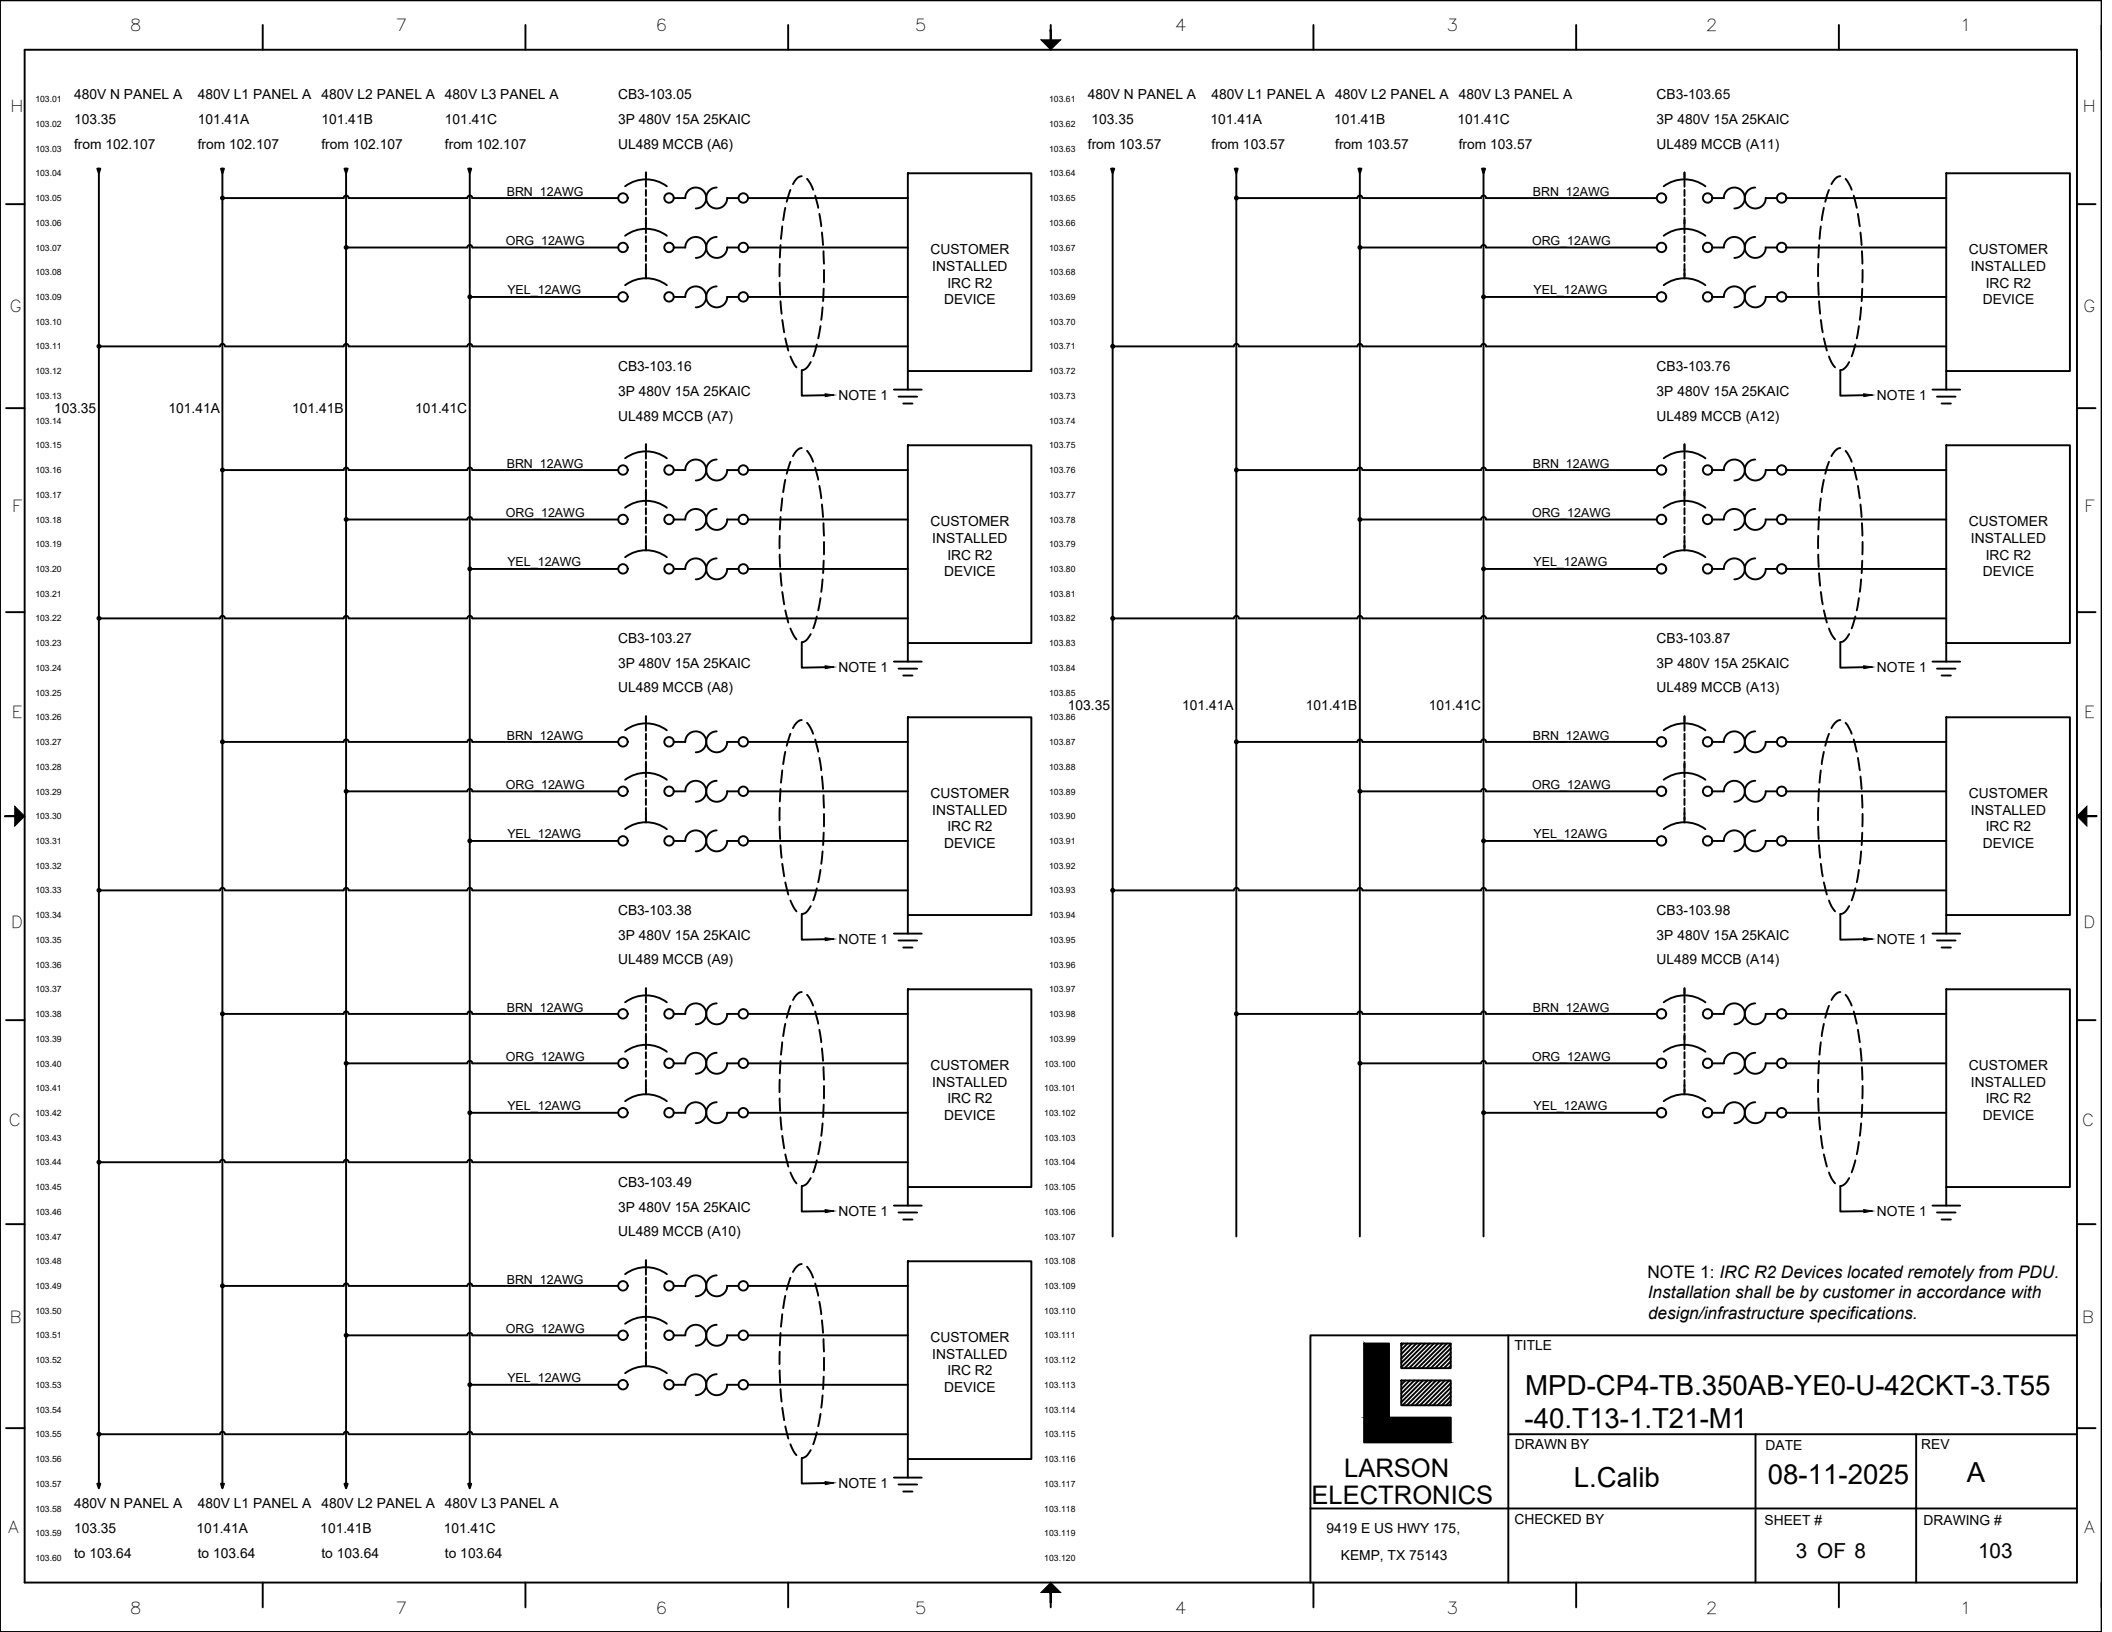


NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY: L.Calib	DATE: 08-11-2025	REV: A	
CHECKED BY:	SHEET #: 3 OF 8	DRAWING #: 103	

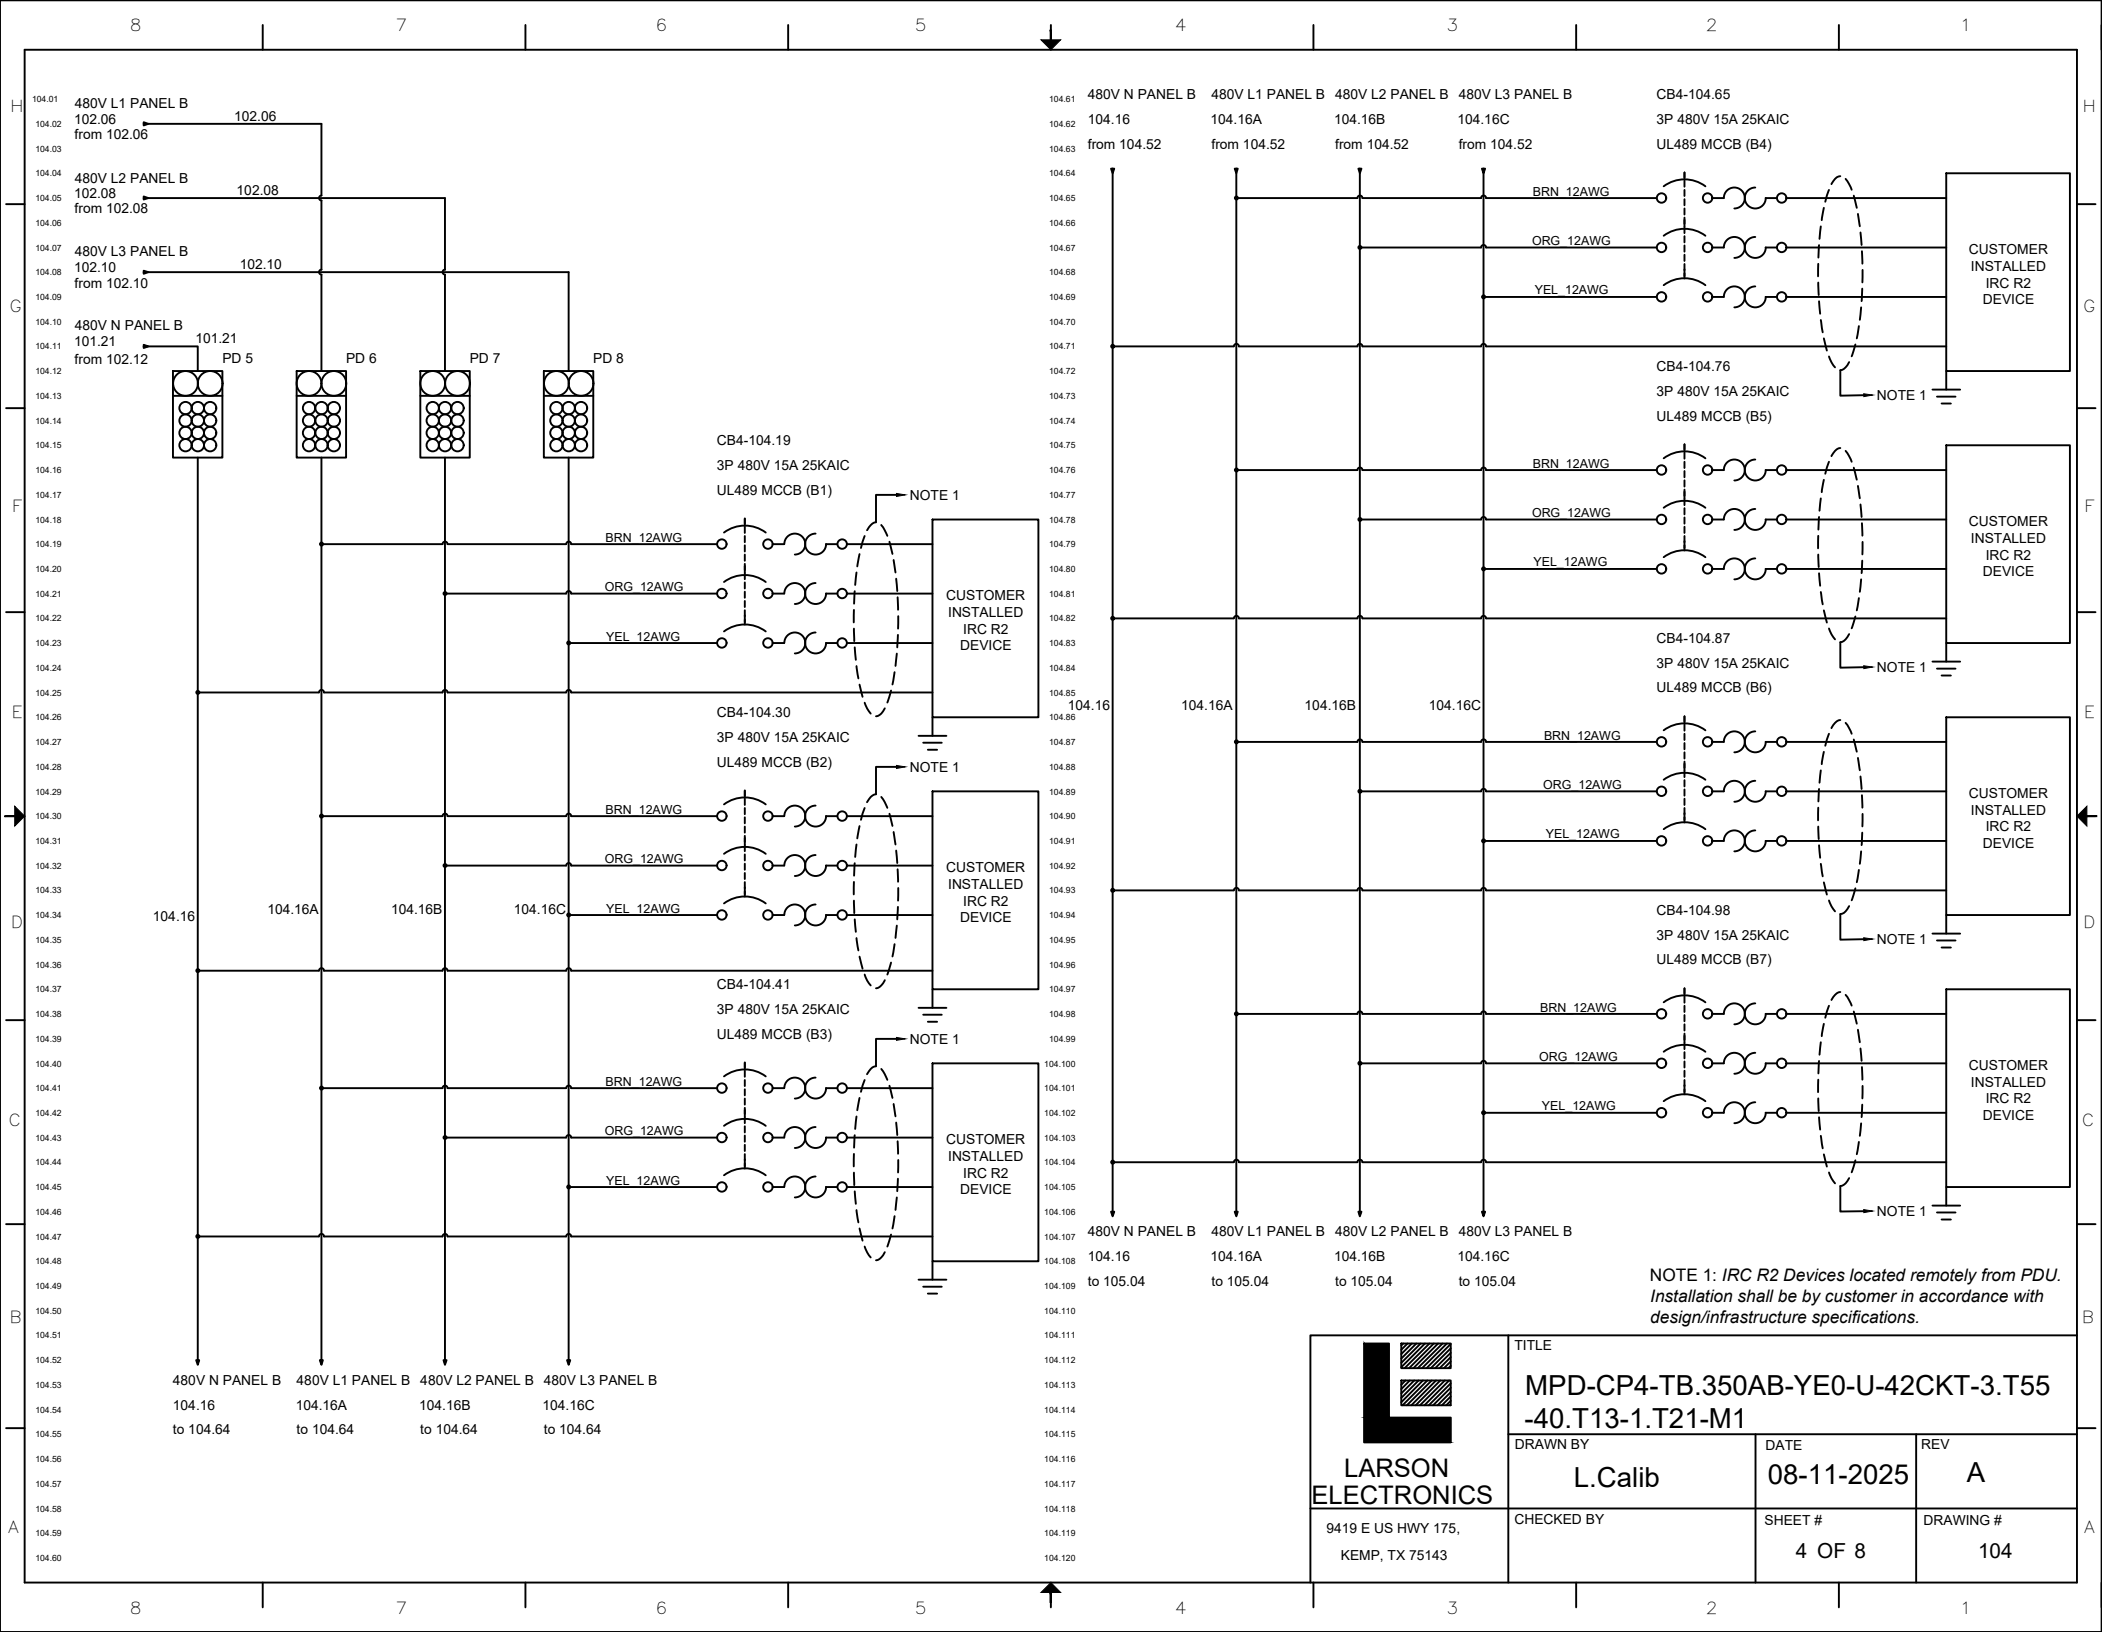
480V L1 PANEL B
102.06
from 102.06
102.06
480V L2 PANEL B
102.08
from 102.08
102.08
480V L3 PANEL B
102.10
from 102.10
102.10
480V N PANEL B
101.21
from 102.12
101.21
PD 5
PD 6
PD 7
PD 8
CB4-104.19
3P 480V 15A 25KAIC
UL489 MCCB (B1)
NOTE 1
BRN 12AWG
ORG 12AWG
YEL 12AWG
CUSTOMER INSTALLED IRC R2 DEVICE
CB4-104.30
3P 480V 15A 25KAIC
UL489 MCCB (B2)
CB4-104.41
3P 480V 15A 25KAIC
UL489 MCCB (B3)
104.16
104.16A
104.16B
104.16C
480V N PANEL B
104.16
to 104.64
480V L1 PANEL B
104.16A
to 104.64
480V L2 PANEL B
104.16B
to 104.64
480V L3 PANEL B
104.16C
to 104.64
480V N PANEL B
104.16
from 104.52
480V L1 PANEL B
104.16A
from 104.52
480V L2 PANEL B
104.16B
from 104.52
480V L3 PANEL B
104.16C
from 104.52
CB4-104.65
3P 480V 15A 25KAIC
UL489 MCCB (B4)
CB4-104.76
3P 480V 15A 25KAIC
UL489 MCCB (B5)
CB4-104.87
3P 480V 15A 25KAIC
UL489 MCCB (B6)
CB4-104.98
3P 480V 15A 25KAIC
UL489 MCCB (B7)
480V N PANEL B
104.16
to 105.04
480V L1 PANEL B
104.16A
to 105.04
480V L2 PANEL B
104.16B
to 105.04
480V L3 PANEL B
104.16C
to 105.04
NOTE 1: IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1
DRAWN BY
L.Calib
DATE
08-11-2025
REV
A
CHECKED BY
SHEET #
4 OF 8
DRAWING #
104

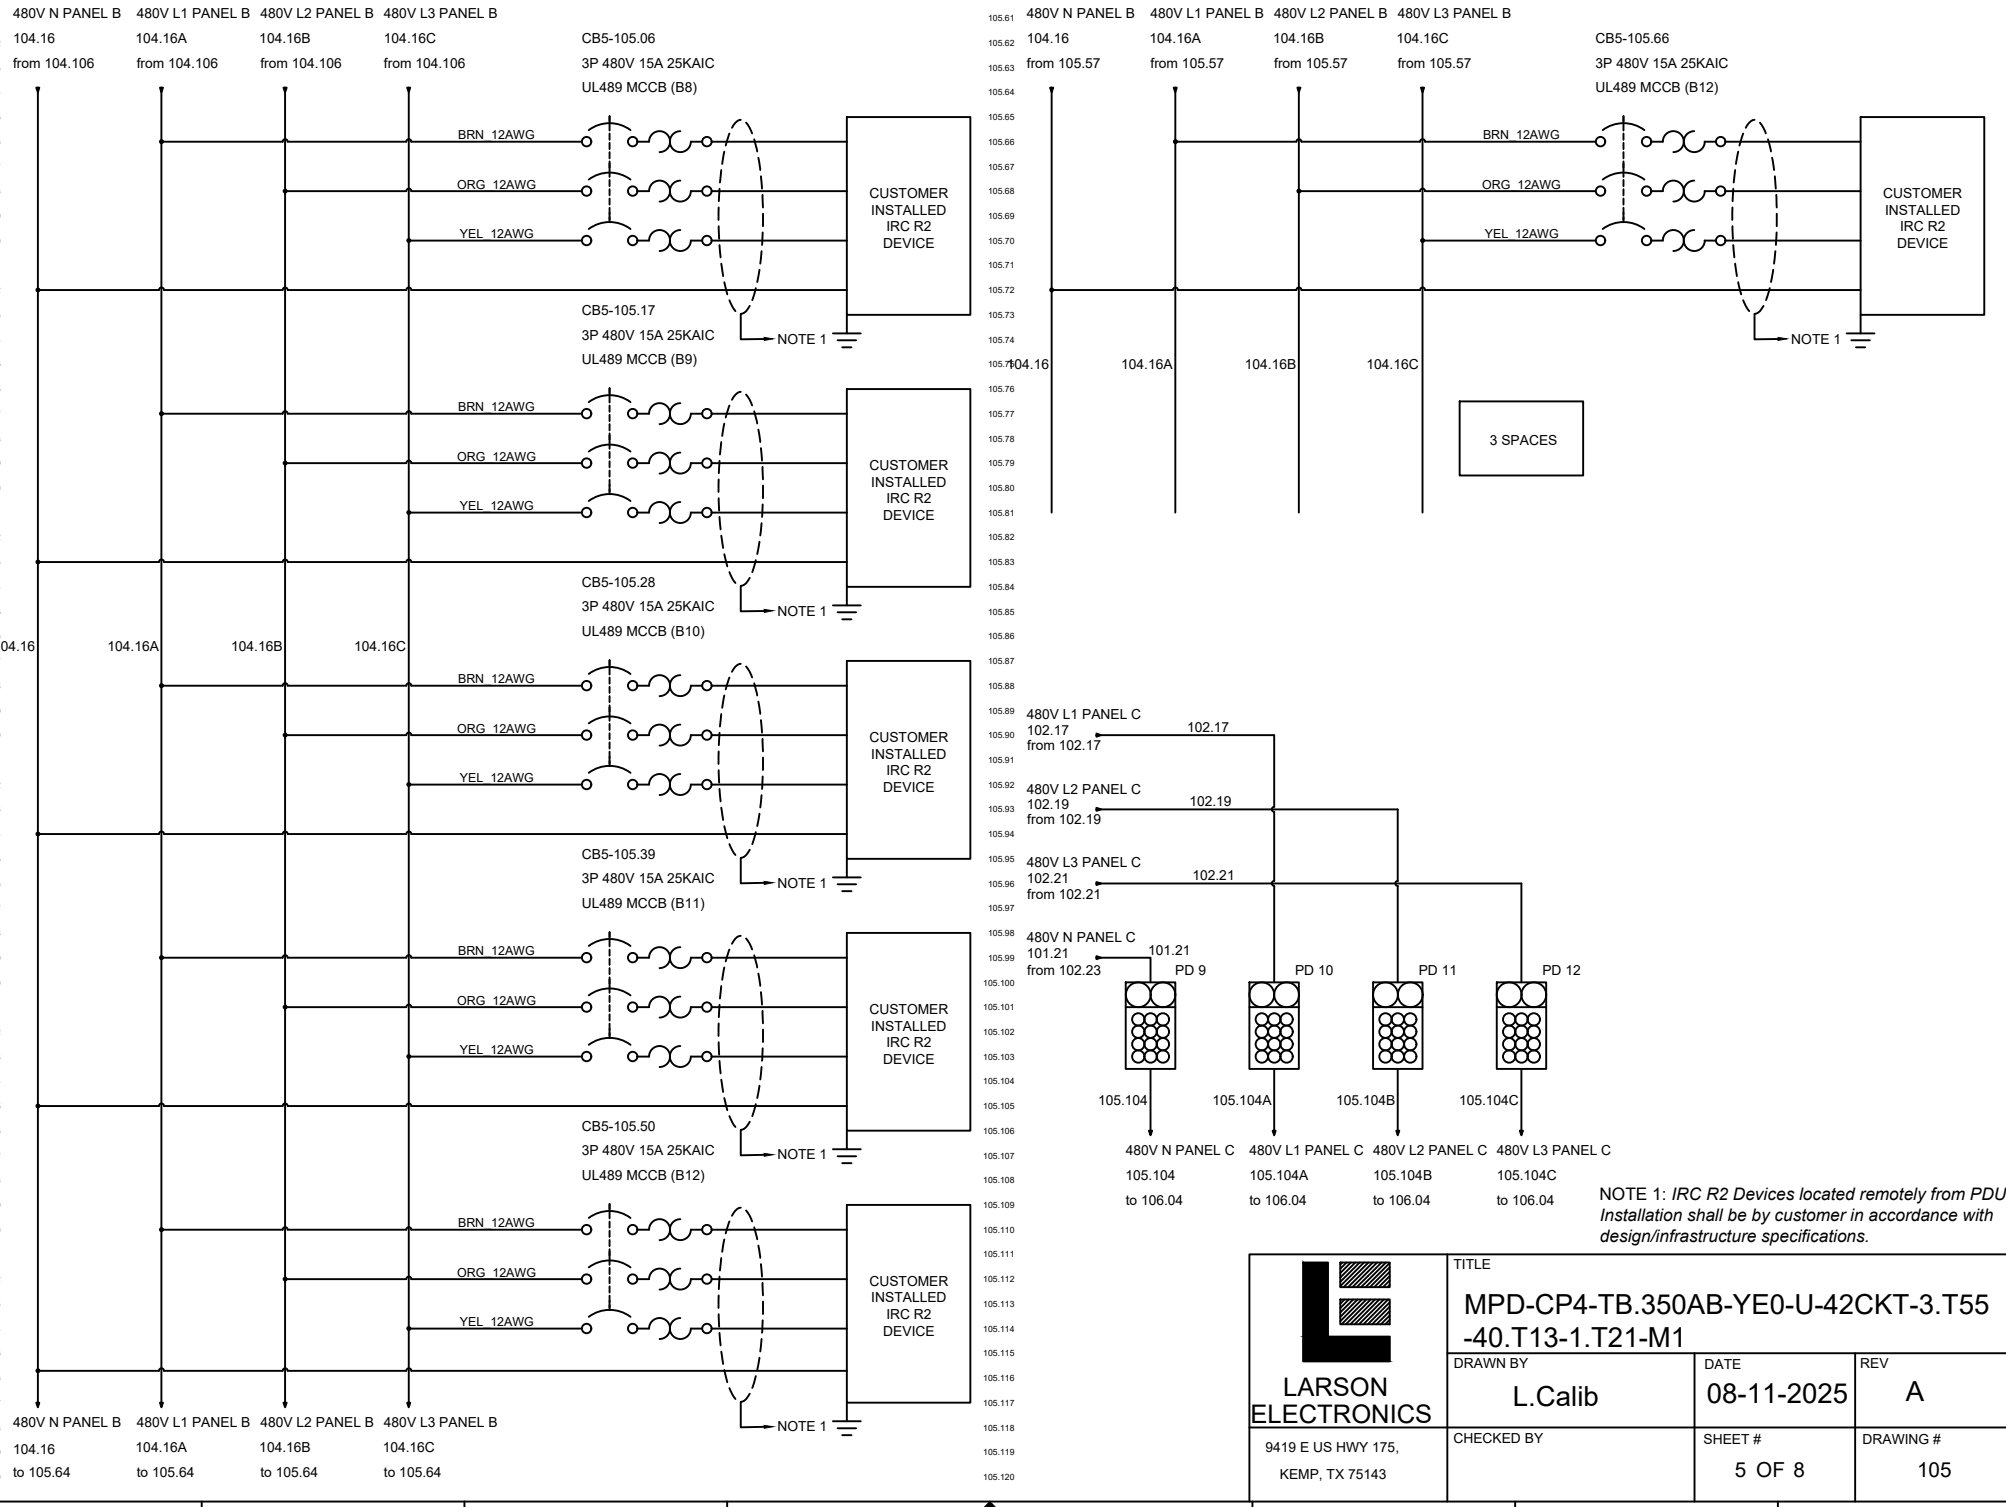


NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS

9419 E US HWY 175,
KEMP, TX 75143


TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	5 OF 8	105	

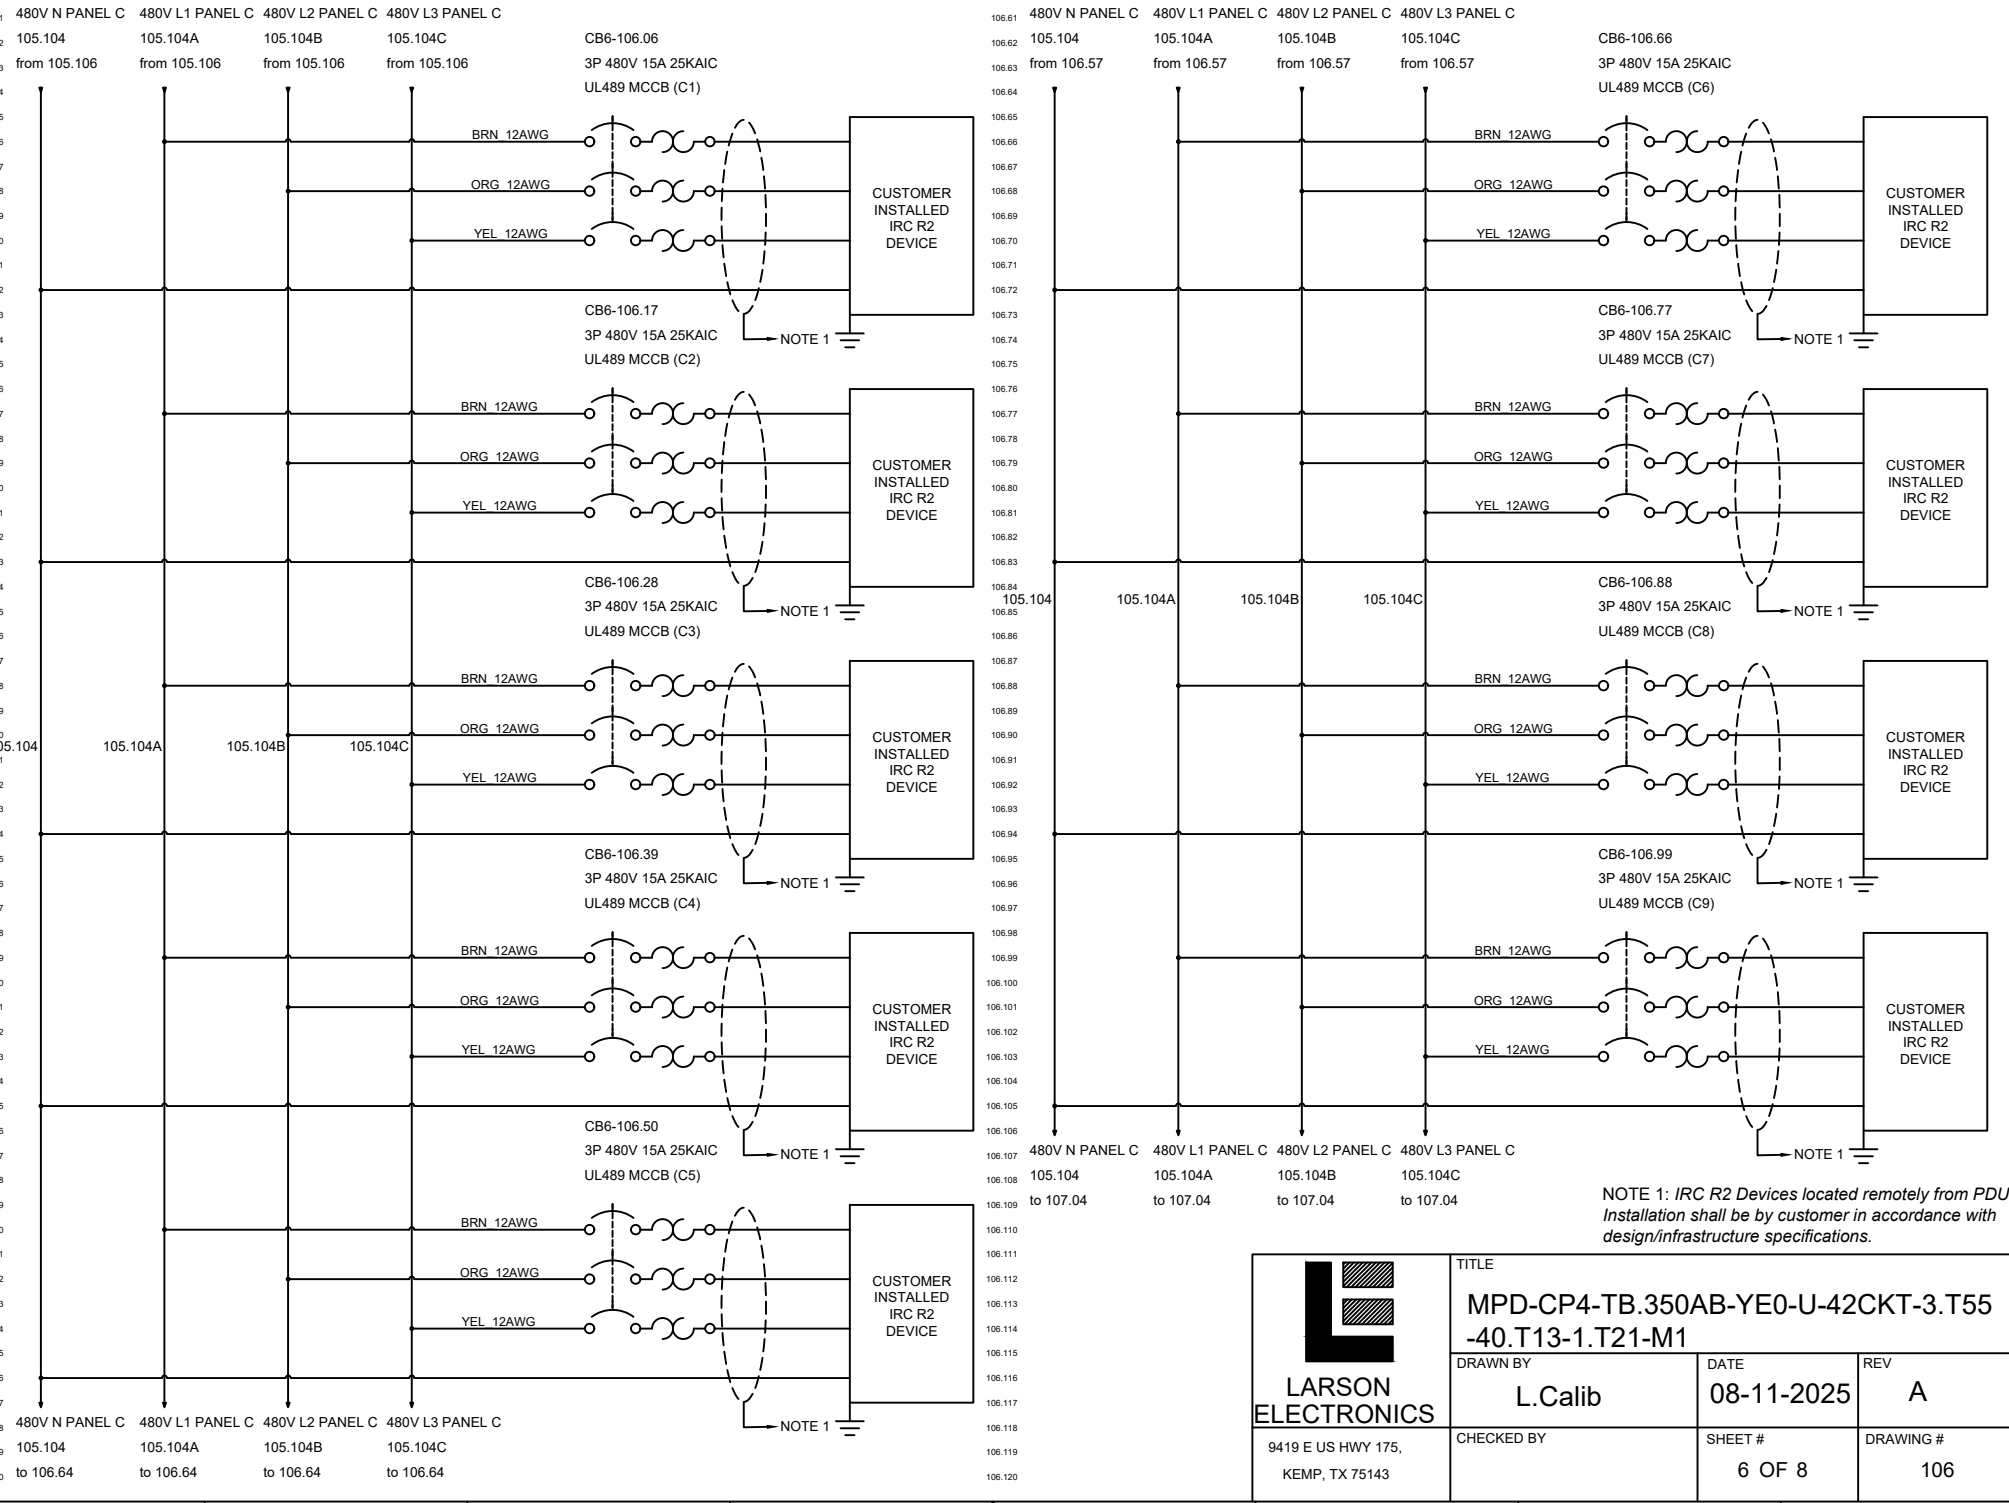

NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	6 OF 8	106	

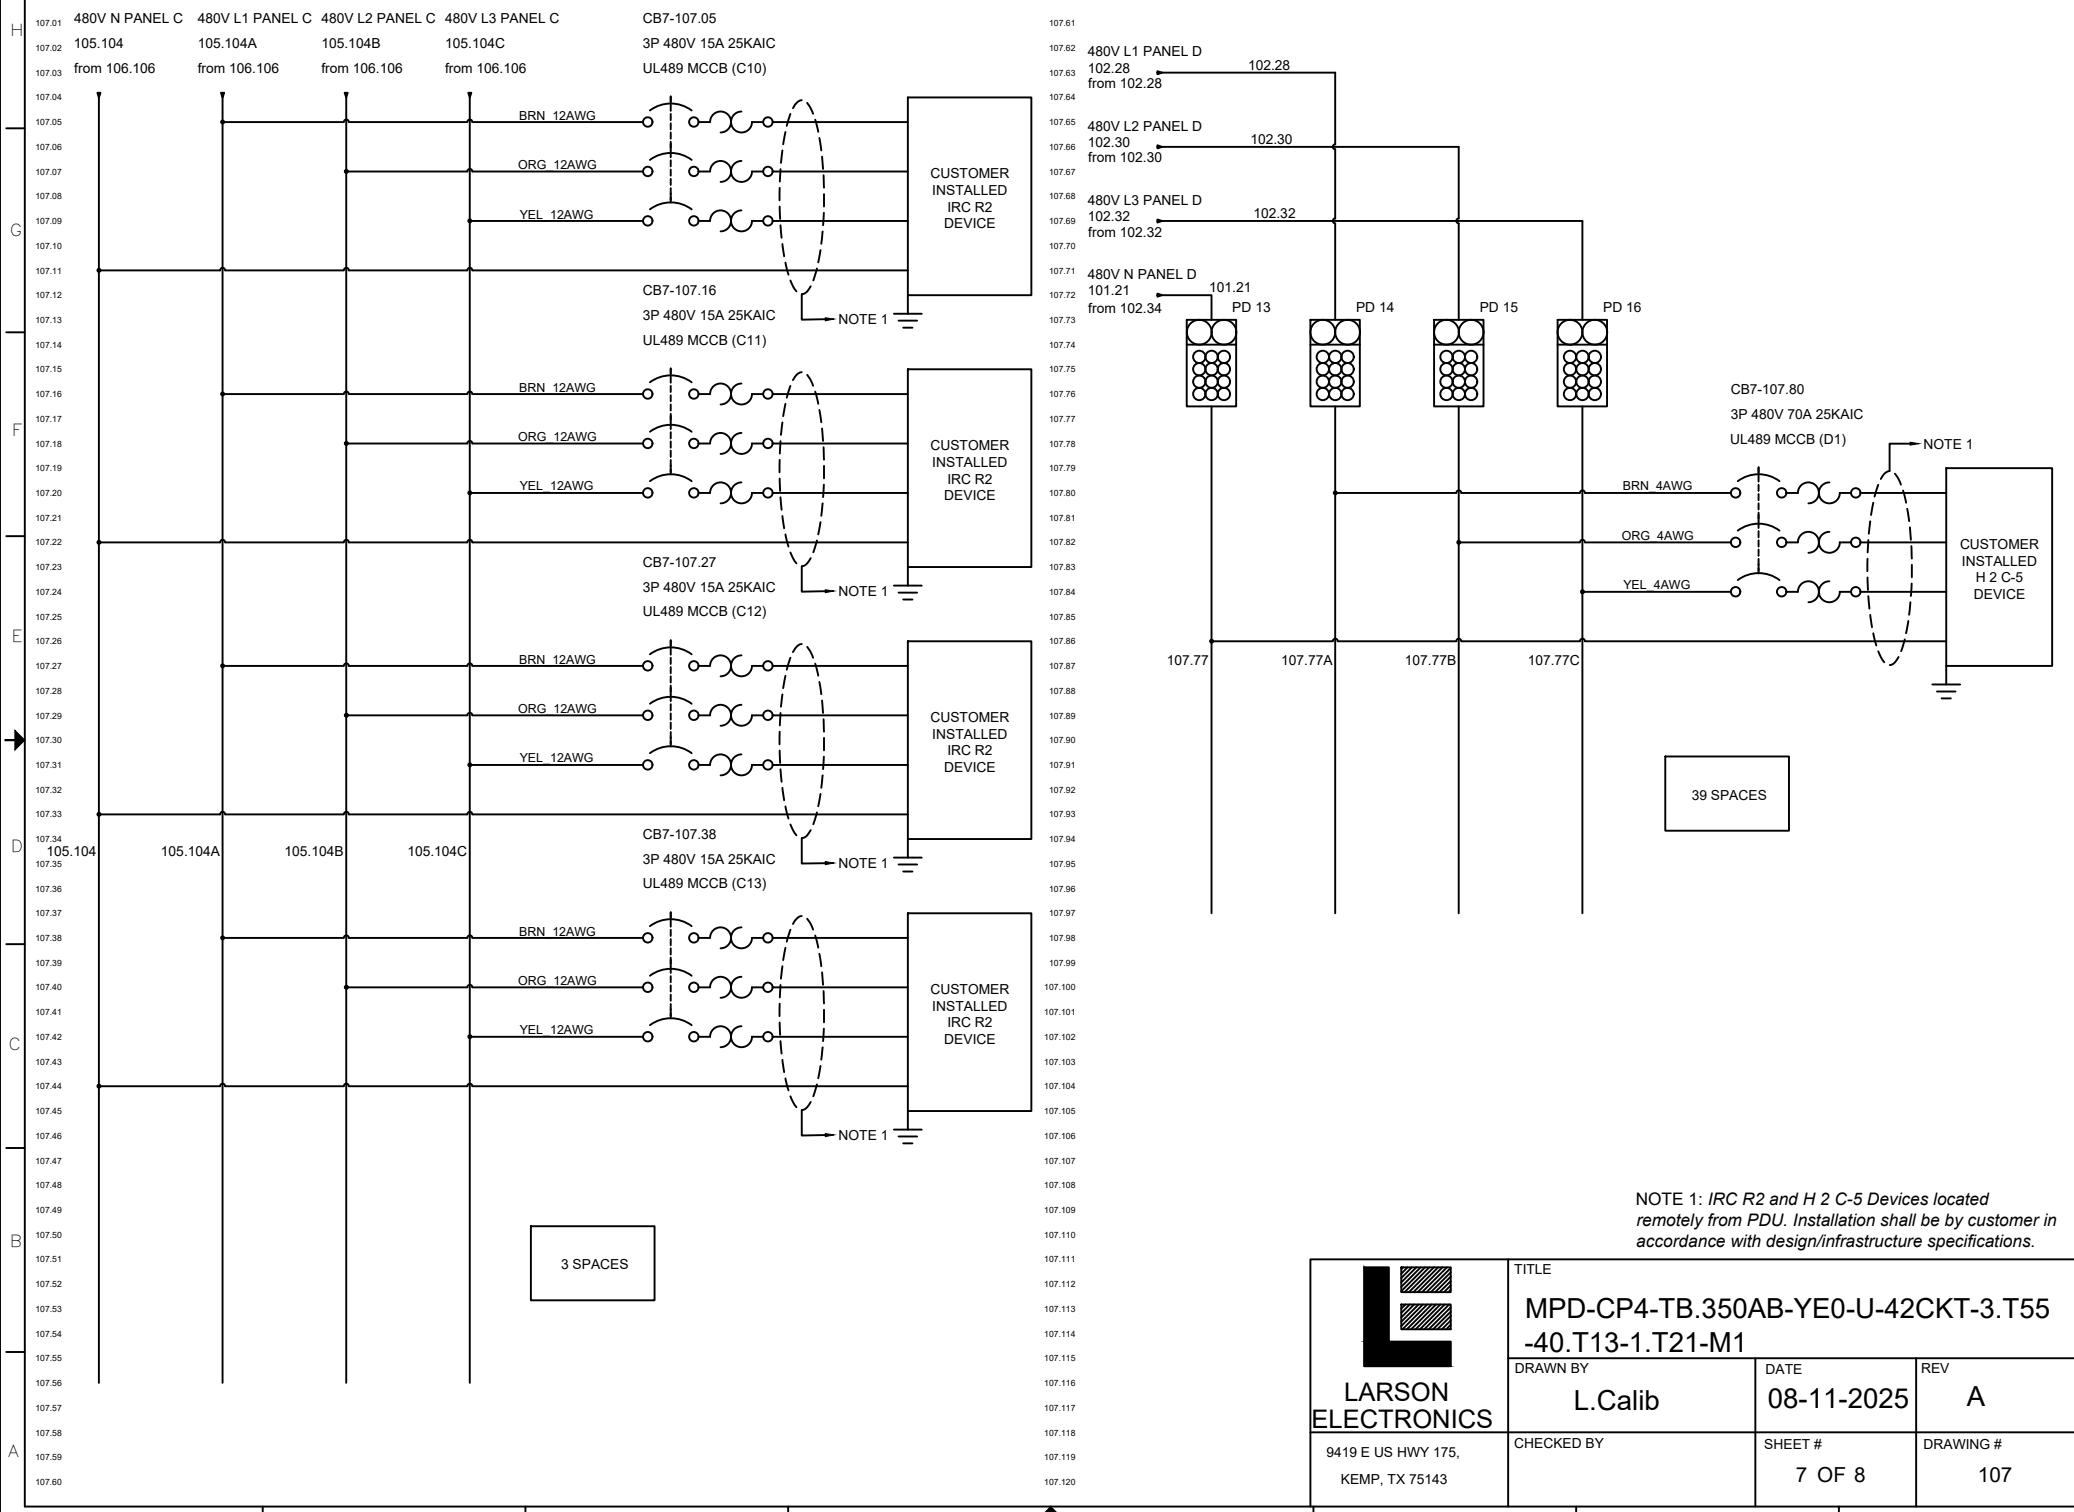

NOTE 1: *IRC R2 and H 2 C-5 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	7 OF 8	107	

TAGS	QTY	CATALOG	DESCRIPTION
2 HOLE GRND LUG	1	UNV00007136	2 HOLE GROUND LUG
CB7-107.80	1	UNV00015179	3P 70A 250/480V DIN RAIL MCCB
CB1-101.28 CB2-102.06 CB2-102.17 CB2-102.28	4	UNV00015187	3P 480V 225A UL489 MCCB
CB1-101.06	1	UNV00020377	3P 350A 480V UL489 MOLDED CASE CIRCUIT BREAKER
CB2-102.46 CB2-102.66 CB2-102.77 CB2-102.88 CB2-102.99 CB3-103.05 CB3-103.16 CB3-103.27 CB3-103.38 CB3-103.49 CB3-103.65 CB3-103.76 CB3-103.87 CB3-103.98 CB4-104.19 CB4-104.30 CB4-104.41 CB4-104.65 CB4-104.76 CB4-104.87 CB4-104.98 CB5-105.06 CB5-105.17 CB5-105.28 CB5-105.39 CB5-105.50 CB5-105.66 CB6-106.06 CB6-106.17 CB6-106.28 CB6-106.39 CB6-106.50 CB6-106.66 CB6-106.77 CB6-106.88 CB6-106.99 CB7-107.05 CB7-107.16 CB7-107.27 CB7-107.38	40		3P 15A 480V UL489 MOLDED CASE CIRCUIT BREAKER
T01-101.20 T01-101.20A T01-101.20B T01-101.20C	4	UNV00014768	22 HOLE 10IN BUS BAR

TAGS	QTY	CATALOG	DESCRIPTION
PD 1 PD 10 PD 11 PD 12 PD 13 PD 14 PD 15 PD 16 PD 2 PD 3 PD 4 PD 5 PD 6 PD 7 PD 8 PD 9	16	UNV00015085	POWER DISRIBUTION BLOCK 2-12 OPENING 570A
GRND BAR KIT 1 GRND BAR KIT 2 GRND BAR KIT 3 GRND BAR KIT 4	4	UNV00013942C	GROUND BAR KIT

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143


TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

DRAWN BY	DATE	REV
L.Calib	08-11-2025	A
CHECKED BY	SHEET #	DRAWING #
	8 OF 8	107


REV	DESCRIPTION	DATE
A	QUOTE	08/11/2025


MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

LARSON ELECTRONICS®

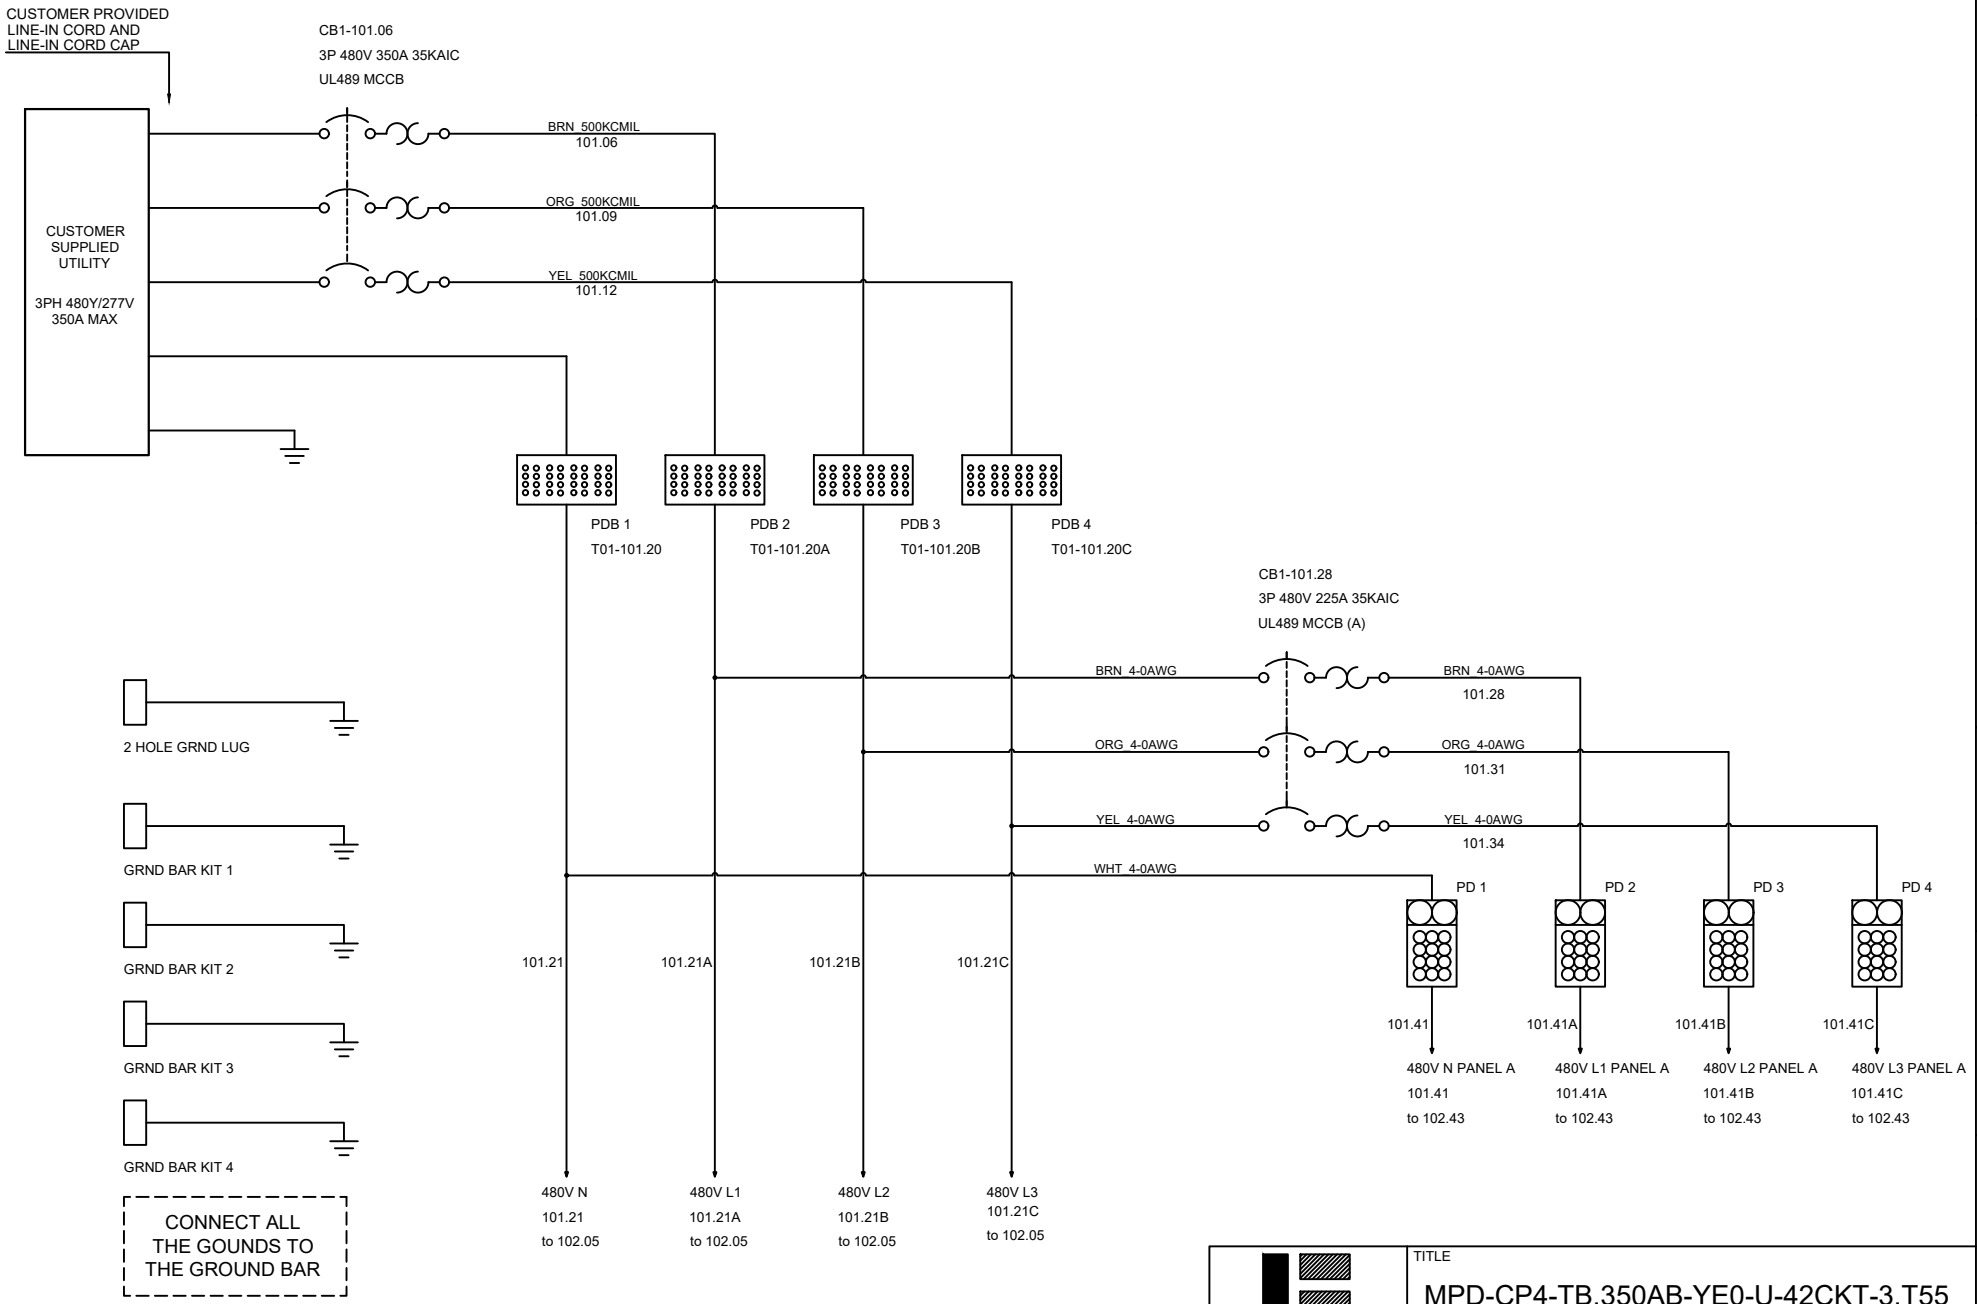

LARSON ELECTRONICS 9419 E US HWY 175, KEMP, TX 75143	TITLE: MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1		
	DRAWN BY: L.Calib	DATE: 08-11-2025	REV: A
	CHECKED BY:	SHEET #: 1 OF 8	DRAWING #: 101

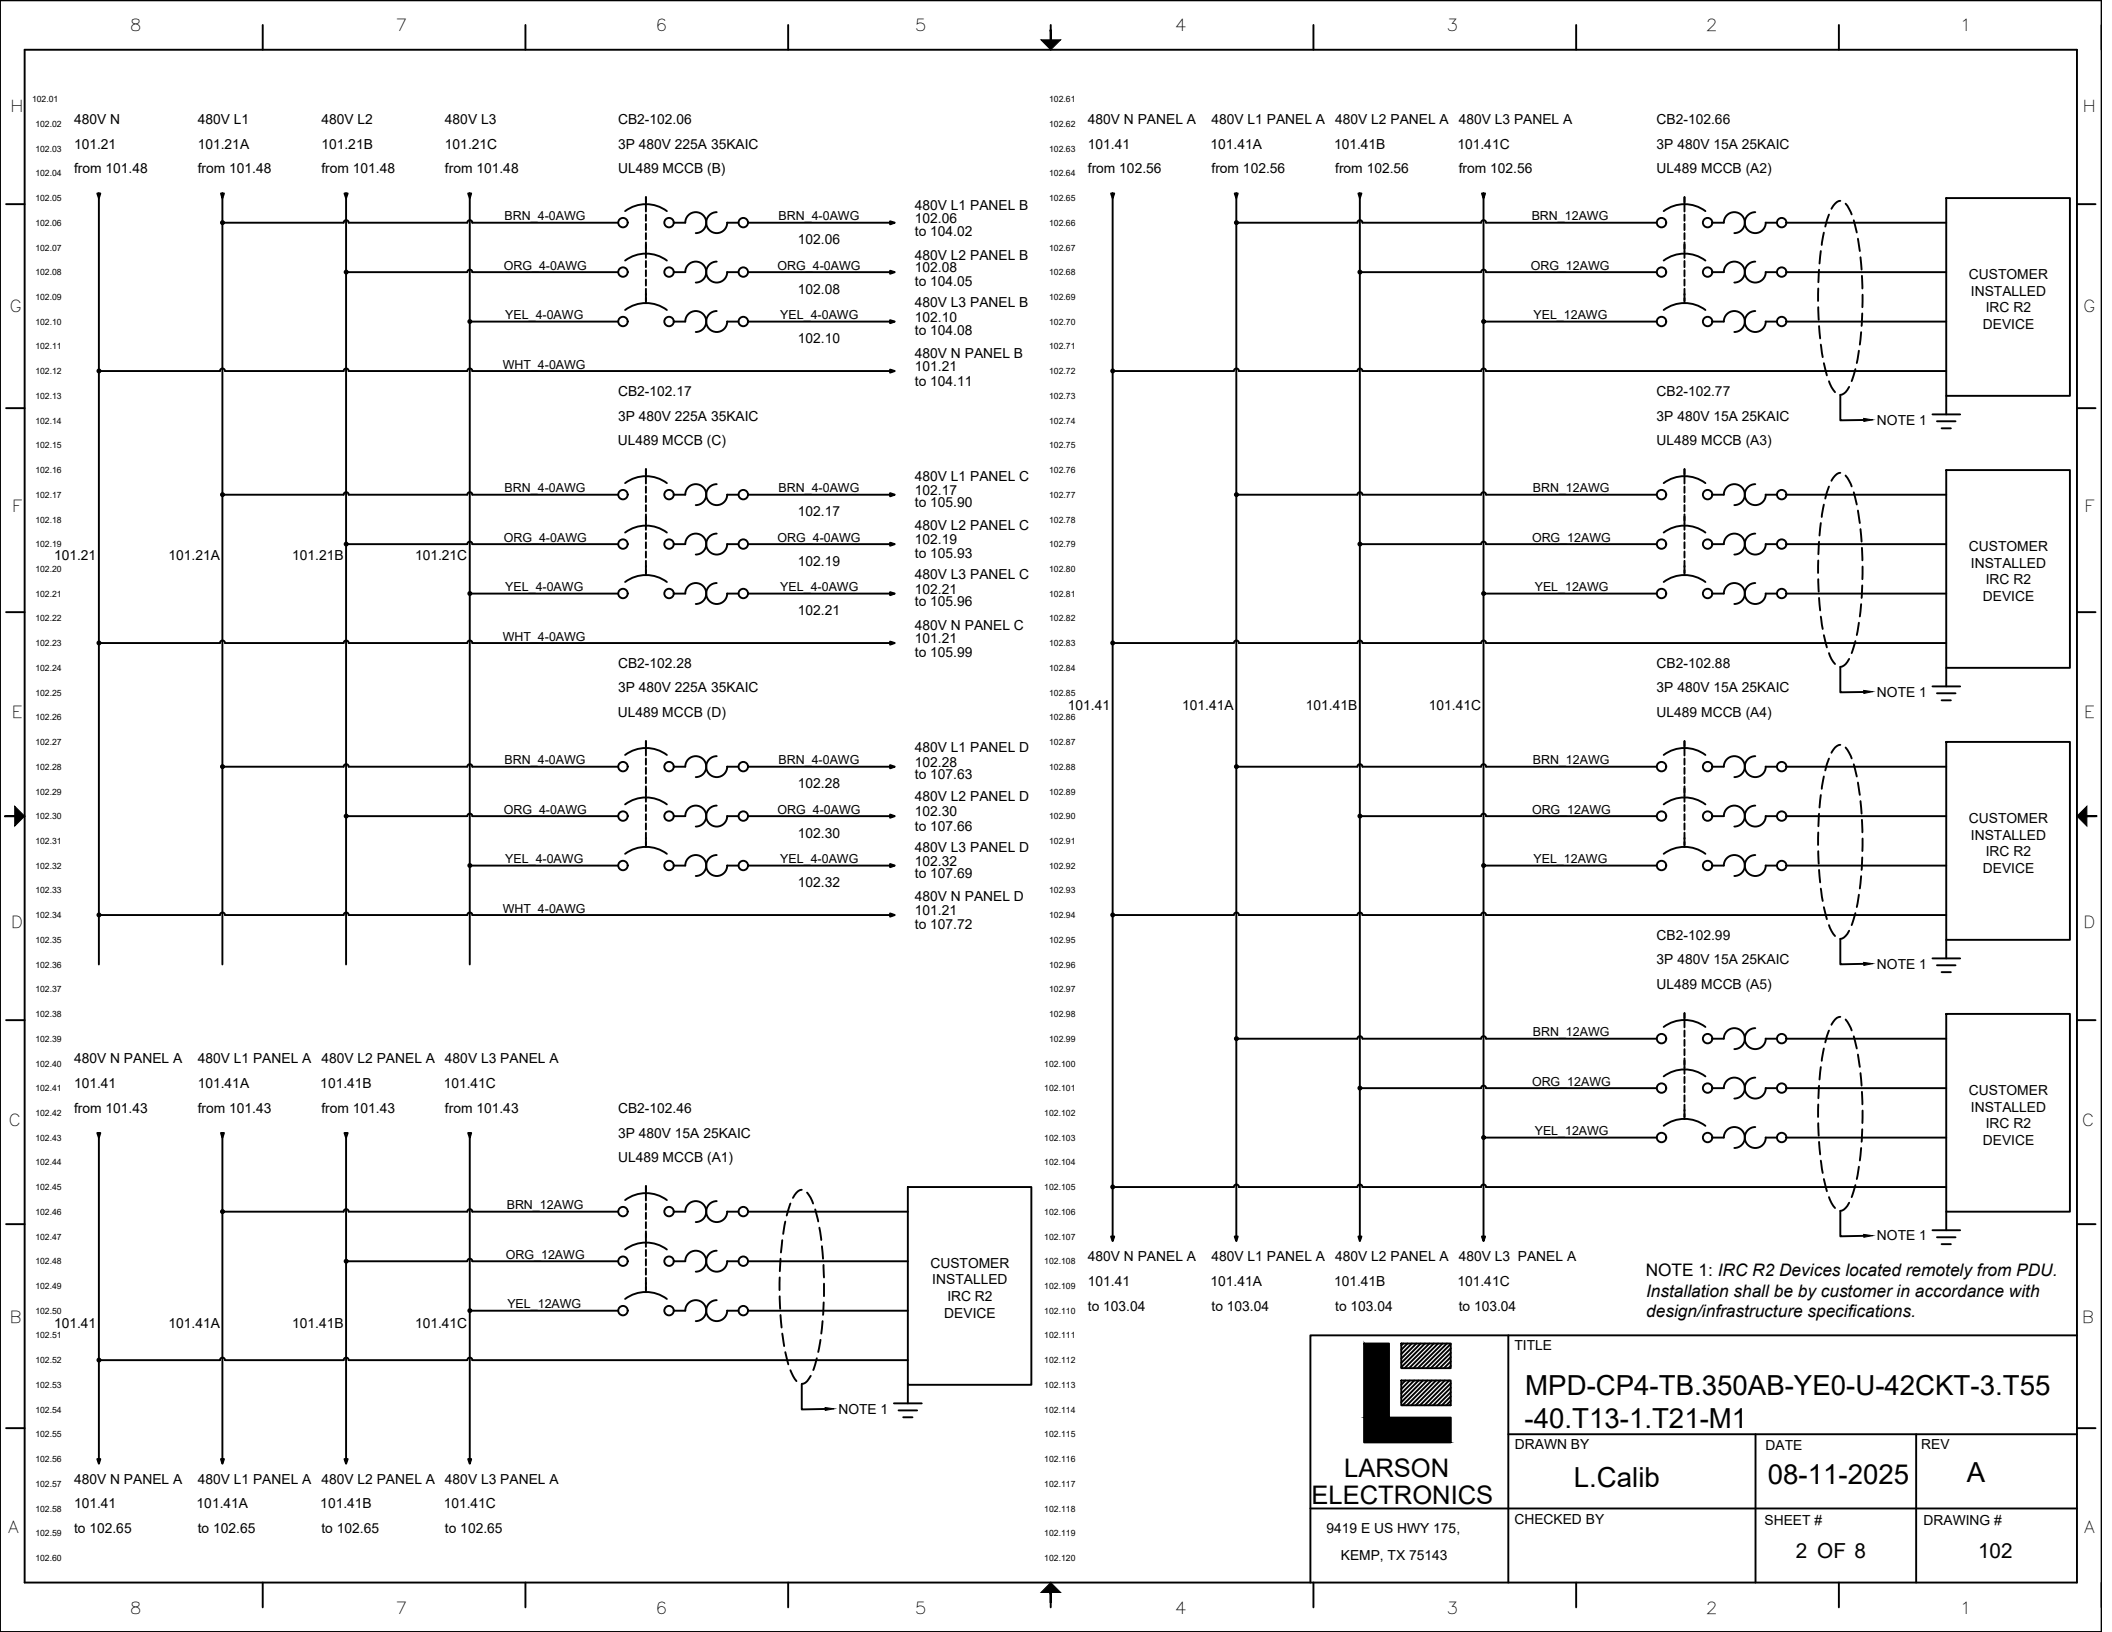

480V N
101.21
from 101.48
480V L1
101.21A
from 101.48
480V L2
101.21B
from 101.48
480V L3
101.21C
from 101.48
CB2-102.06
3P 480V 225A 35KAIC
UL489 MCCB (B)
BRN 4-0AWG
ORG 4-0AWG
YEL 4-0AWG
WHT 4-0AWG
BRN 4-0AWG 102.06
ORG 4-0AWG 102.08
YEL 4-0AWG 102.10
480V L1 PANEL B 102.06 to 104.02
480V L2 PANEL B 102.08 to 104.05
480V L3 PANEL B 102.10 to 104.08
480V N PANEL B 101.21 to 104.11
CB2-102.17
3P 480V 225A 35KAIC
UL489 MCCB (C)
BRN 4-0AWG 102.17
ORG 4-0AWG 102.19
YEL 4-0AWG 102.21
480V L1 PANEL C 102.17 to 105.90
480V L2 PANEL C 102.19 to 105.93
480V L3 PANEL C 102.21 to 105.96
480V N PANEL C 101.21 to 105.99
CB2-102.28
3P 480V 225A 35KAIC
UL489 MCCB (D)
BRN 4-0AWG 102.28
ORG 4-0AWG 102.30
YEL 4-0AWG 102.32
480V L1 PANEL D 102.28 to 107.63
480V L2 PANEL D 102.30 to 107.66
480V L3 PANEL D 102.32 to 107.69
480V N PANEL D 101.21 to 107.72
101.21
101.21A
101.21B
101.21C
480V N PANEL A
101.41
from 101.43
480V L1 PANEL A
101.41A
from 101.43
480V L2 PANEL A
101.41B
from 101.43
480V L3 PANEL A
101.41C
from 101.43
CB2-102.46
3P 480V 15A 25KAIC
UL489 MCCB (A1)
BRN 12AWG
ORG 12AWG
YEL 12AWG
CUSTOMER INSTALLED IRC R2 DEVICE
NOTE 1
101.41
101.41A
101.41B
101.41C
480V N PANEL A
101.41
to 102.65
480V L1 PANEL A
101.41A
to 102.65
480V L2 PANEL A
101.41B
to 102.65
480V L3 PANEL A
101.41C
to 102.65
480V N PANEL A
101.41
from 102.56
480V L1 PANEL A
101.41A
from 102.56
480V L2 PANEL A
101.41B
from 102.56
480V L3 PANEL A
101.41C
from 102.56
CB2-102.66
3P 480V 15A 25KAIC
UL489 MCCB (A2)
CB2-102.77
3P 480V 15A 25KAIC
UL489 MCCB (A3)
CB2-102.88
3P 480V 15A 25KAIC
UL489 MCCB (A4)
CB2-102.99
3P 480V 15A 25KAIC
UL489 MCCB (A5)
480V N PANEL A
101.41
to 103.04
480V L1 PANEL A
101.41A
to 103.04
480V L2 PANEL A
101.41B
to 103.04
480V L3 PANEL A
101.41C
to 103.04
NOTE 1: IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1
DRAWN BY
L.Calib
DATE
08-11-2025
REV
A
CHECKED BY
SHEET #
2 OF 8
DRAWING #
102

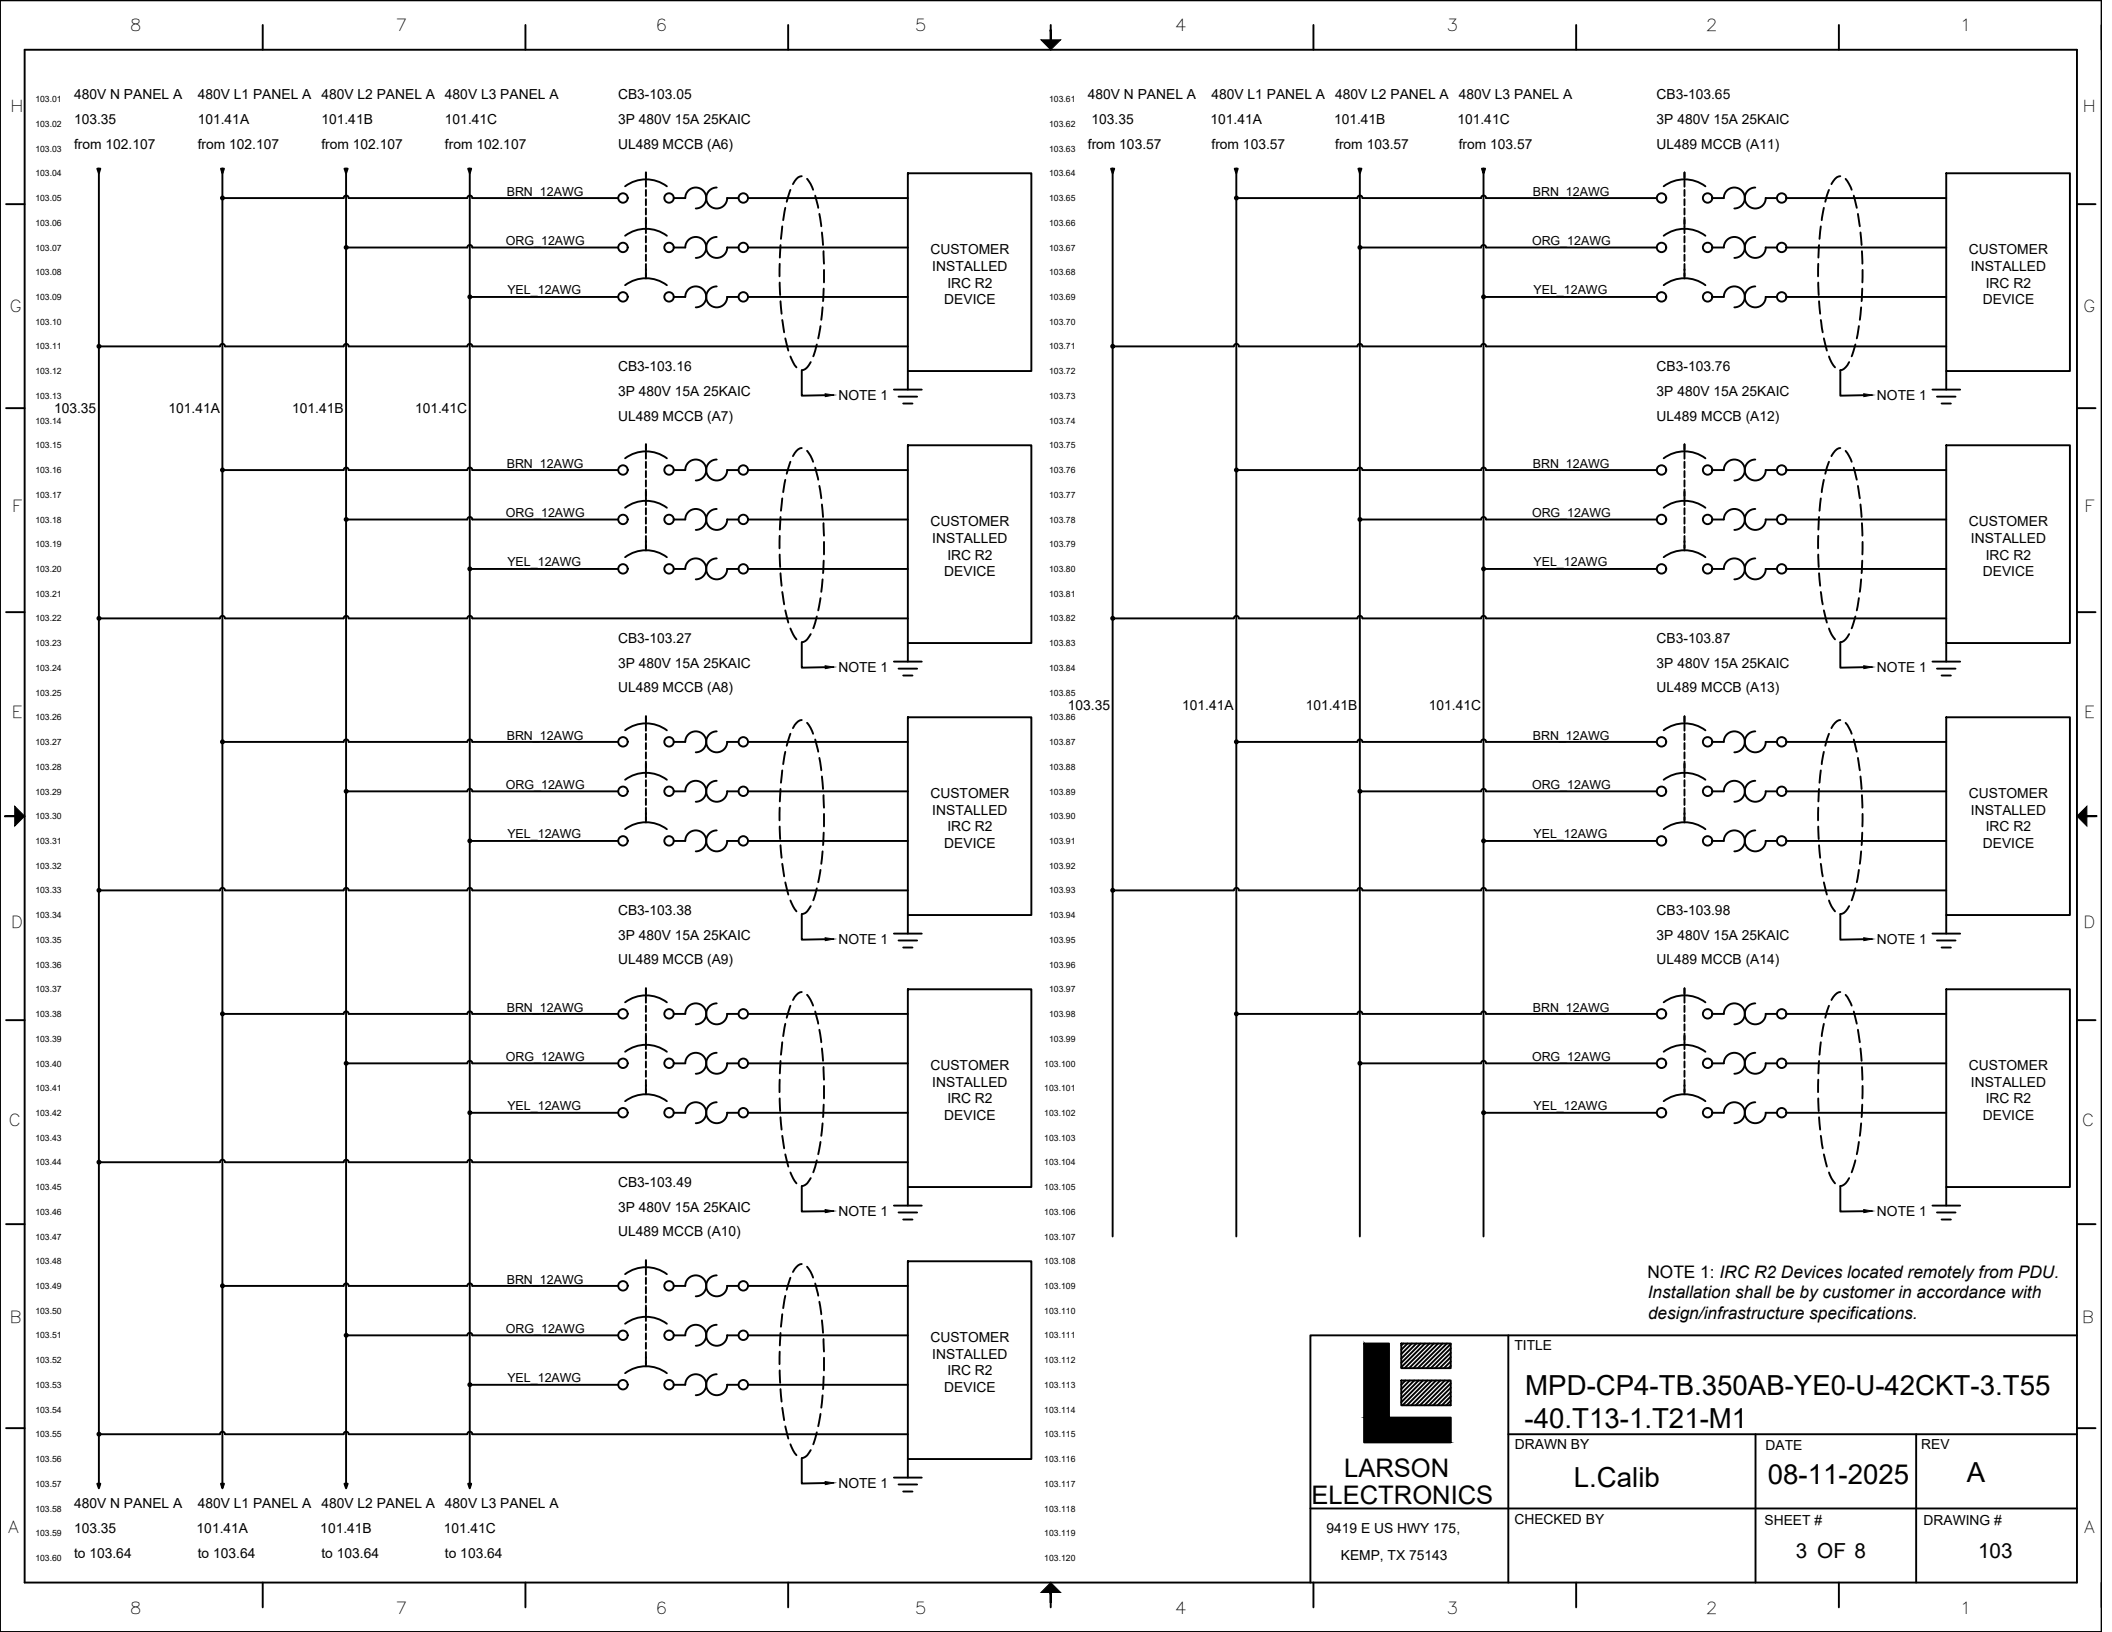


NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY: L.Calib	DATE: 08-11-2025	REV: A	
CHECKED BY:	SHEET #: 3 OF 8	DRAWING #: 103	

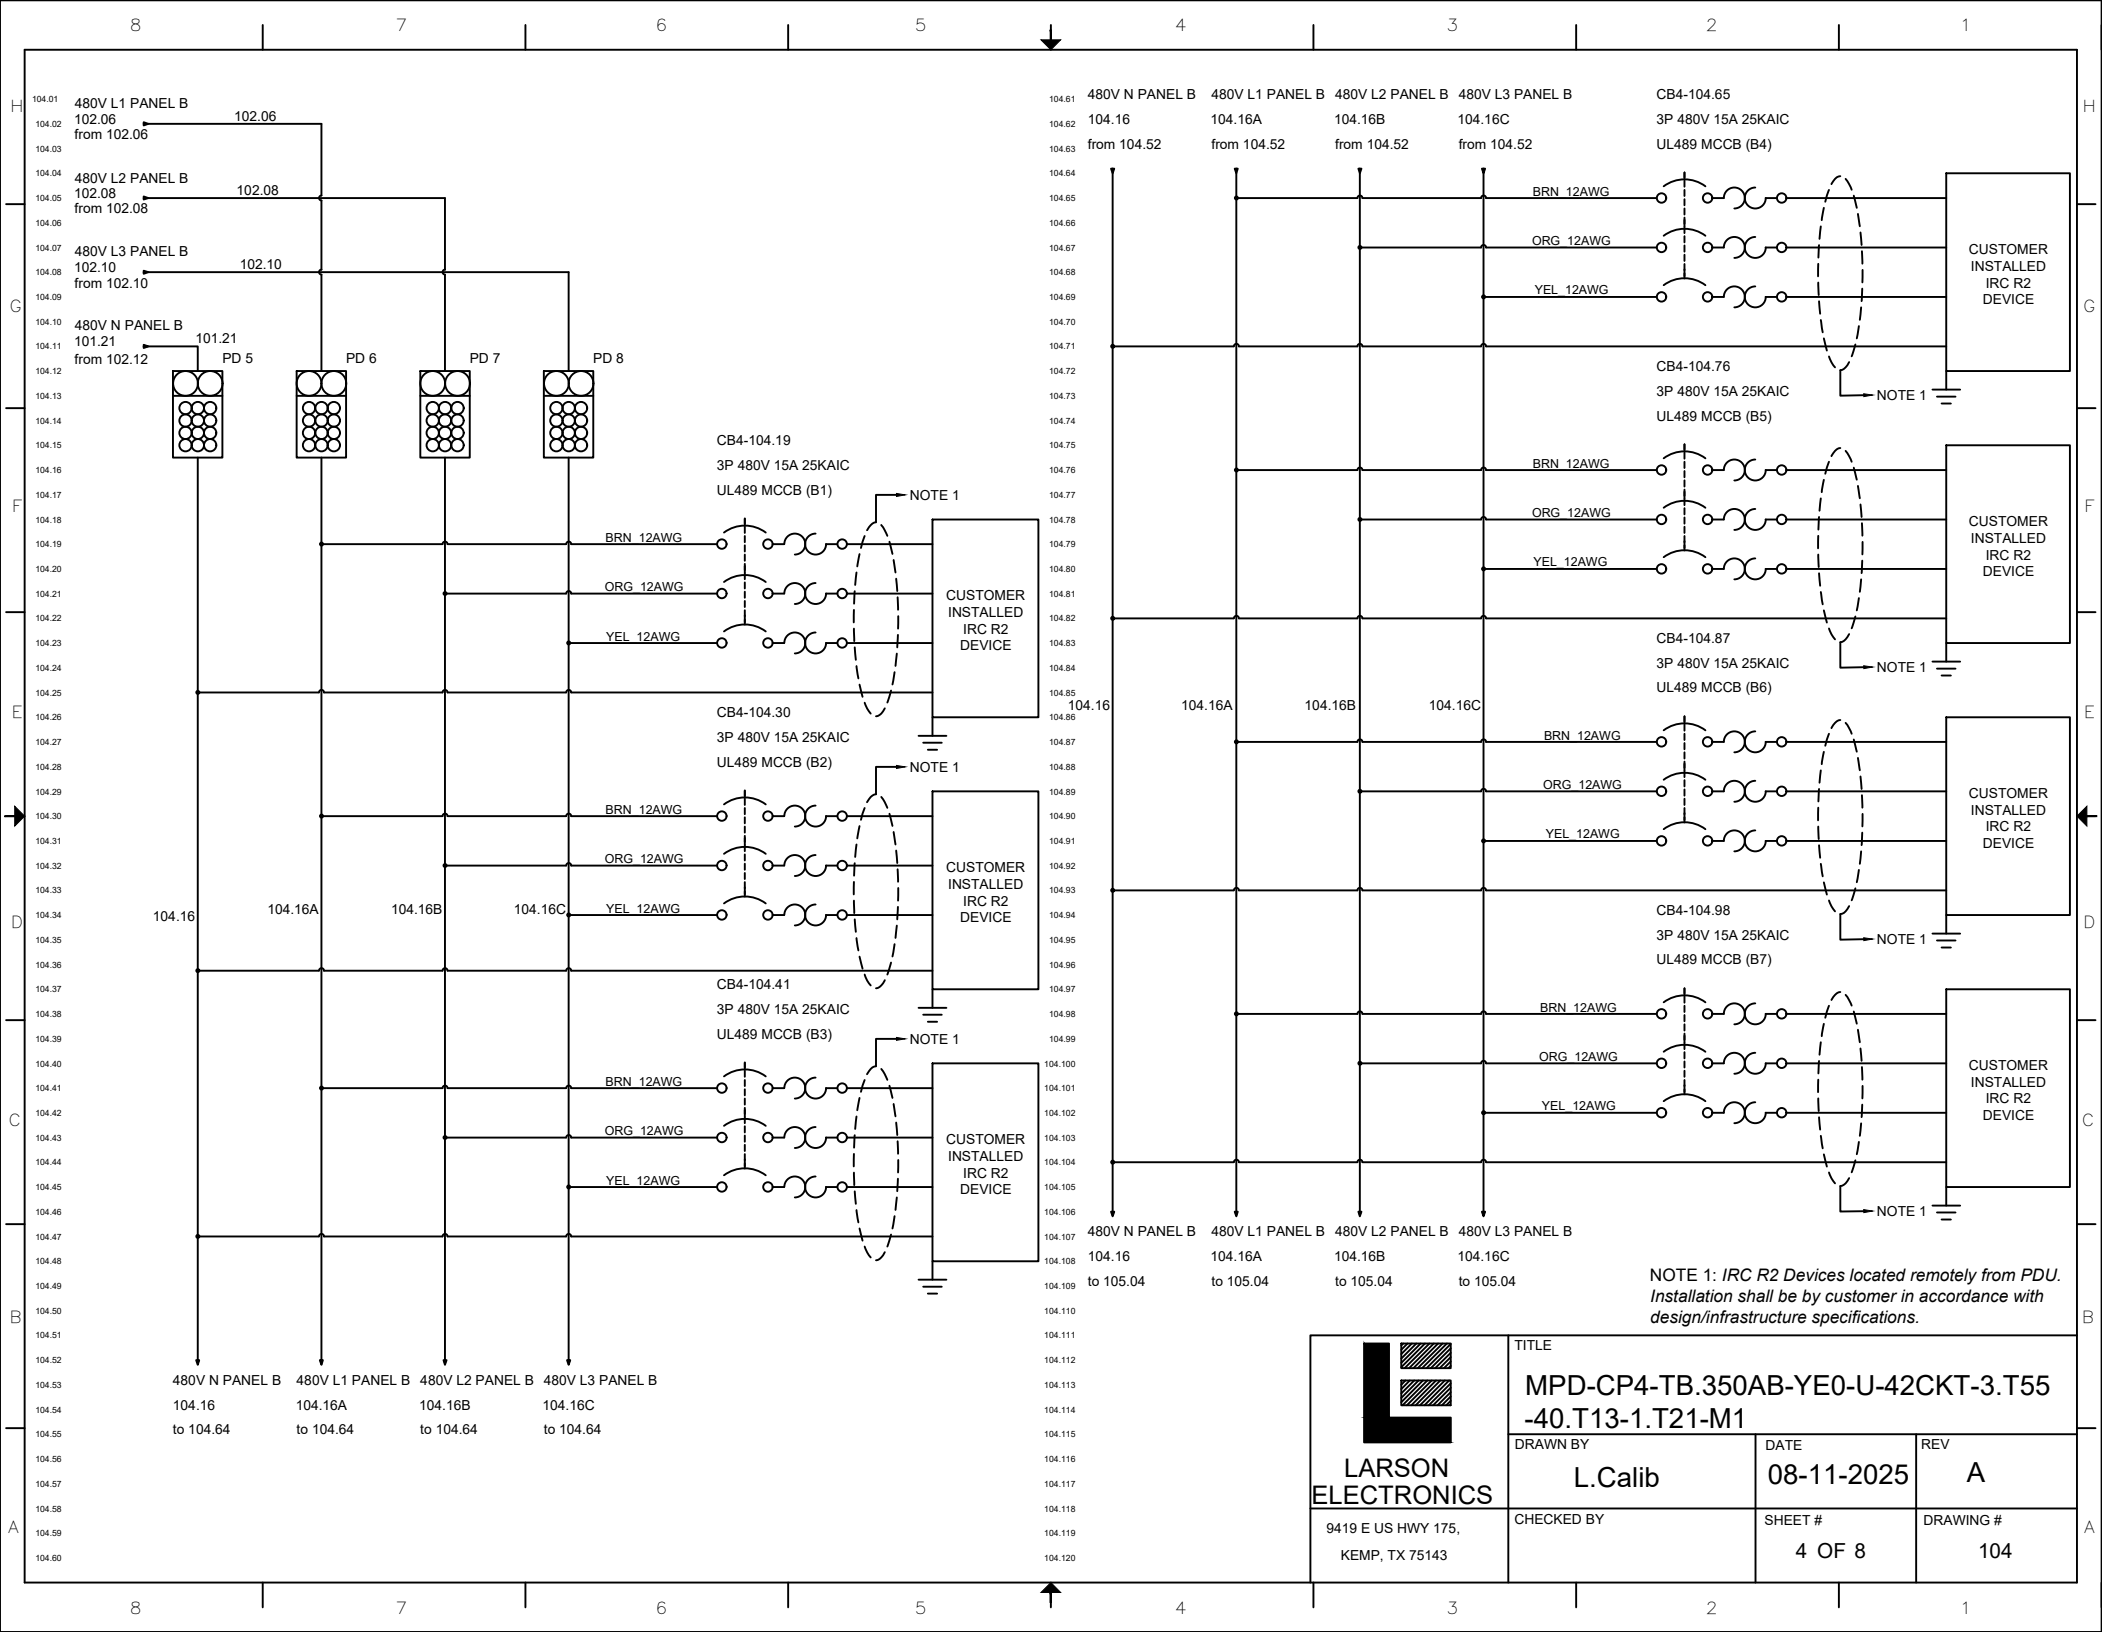
480V L1 PANEL B
102.06
from 102.06
102.06
480V L2 PANEL B
102.08
from 102.08
102.08
480V L3 PANEL B
102.10
from 102.10
102.10
480V N PANEL B
101.21
from 102.12
101.21
PD 5
PD 6
PD 7
PD 8
CB4-104.19
3P 480V 15A 25KAIC
UL489 MCCB (B1)
NOTE 1
BRN 12AWG
ORG 12AWG
YEL 12AWG
CUSTOMER INSTALLED IRC R2 DEVICE
CB4-104.30
3P 480V 15A 25KAIC
UL489 MCCB (B2)
CB4-104.41
3P 480V 15A 25KAIC
UL489 MCCB (B3)
104.16
104.16A
104.16B
104.16C
480V N PANEL B
104.16
to 104.64
480V L1 PANEL B
104.16A
to 104.64
480V L2 PANEL B
104.16B
to 104.64
480V L3 PANEL B
104.16C
to 104.64
480V N PANEL B
104.16
from 104.52
480V L1 PANEL B
104.16A
from 104.52
480V L2 PANEL B
104.16B
from 104.52
480V L3 PANEL B
104.16C
from 104.52
CB4-104.65
3P 480V 15A 25KAIC
UL489 MCCB (B4)
CB4-104.76
3P 480V 15A 25KAIC
UL489 MCCB (B5)
CB4-104.87
3P 480V 15A 25KAIC
UL489 MCCB (B6)
CB4-104.98
3P 480V 15A 25KAIC
UL489 MCCB (B7)
480V N PANEL B
104.16
to 105.04
480V L1 PANEL B
104.16A
to 105.04
480V L2 PANEL B
104.16B
to 105.04
480V L3 PANEL B
104.16C
to 105.04
NOTE 1: IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1
DRAWN BY
L.Calib
DATE
08-11-2025
REV
A
CHECKED BY
SHEET #
4 OF 8
DRAWING #
104

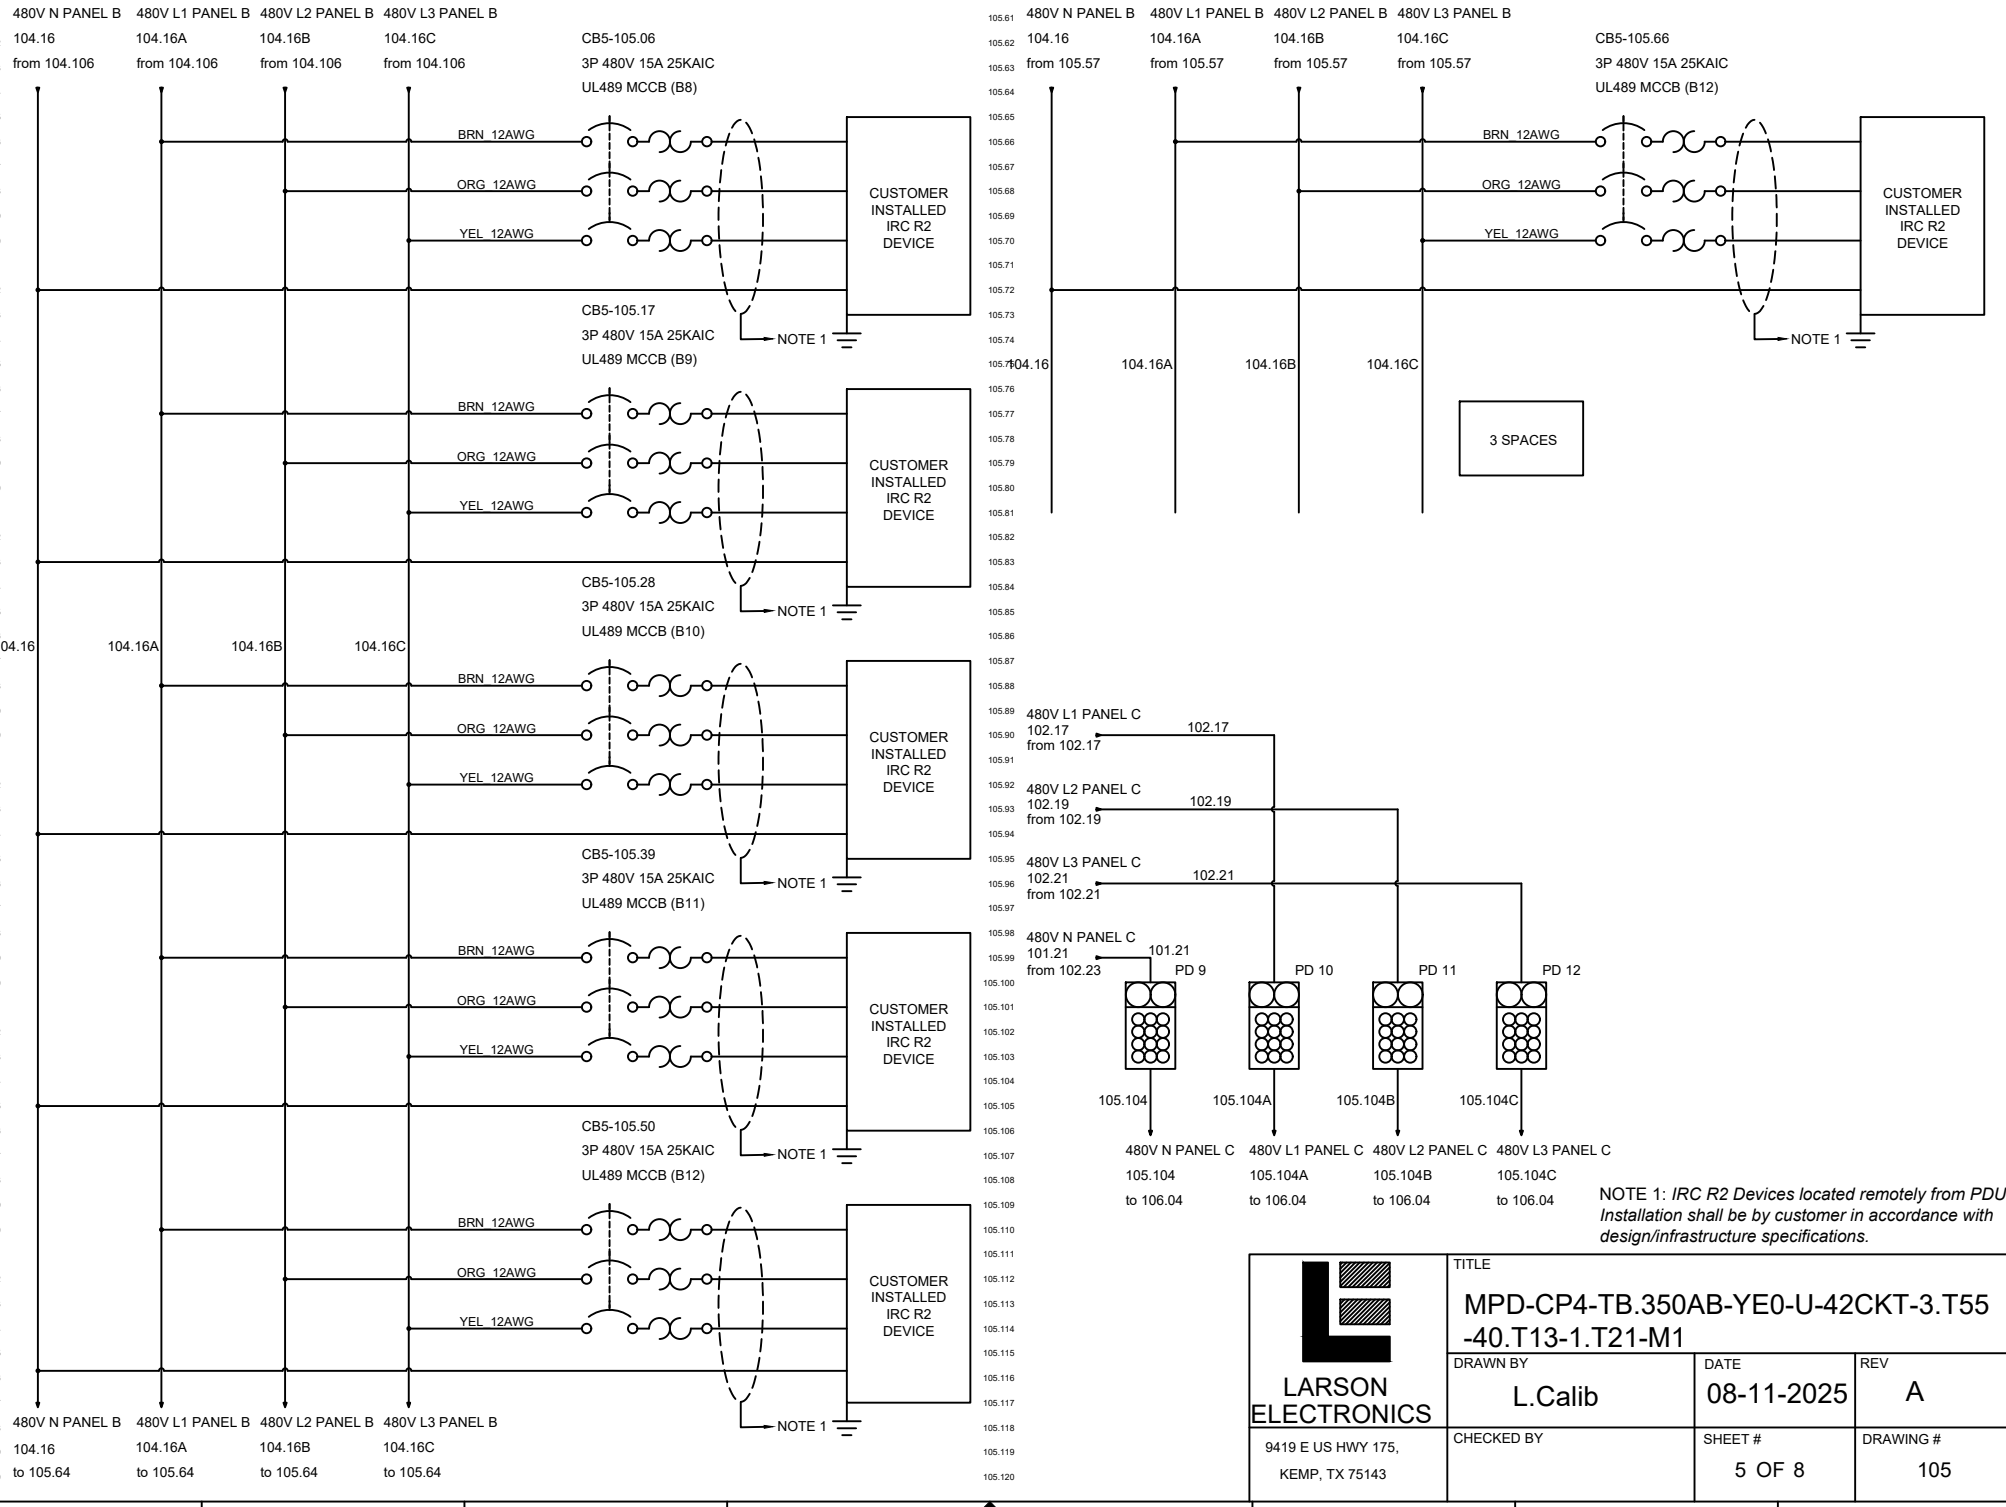


NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS

9419 E US HWY 175,
KEMP, TX 75143


TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	5 OF 8	105	

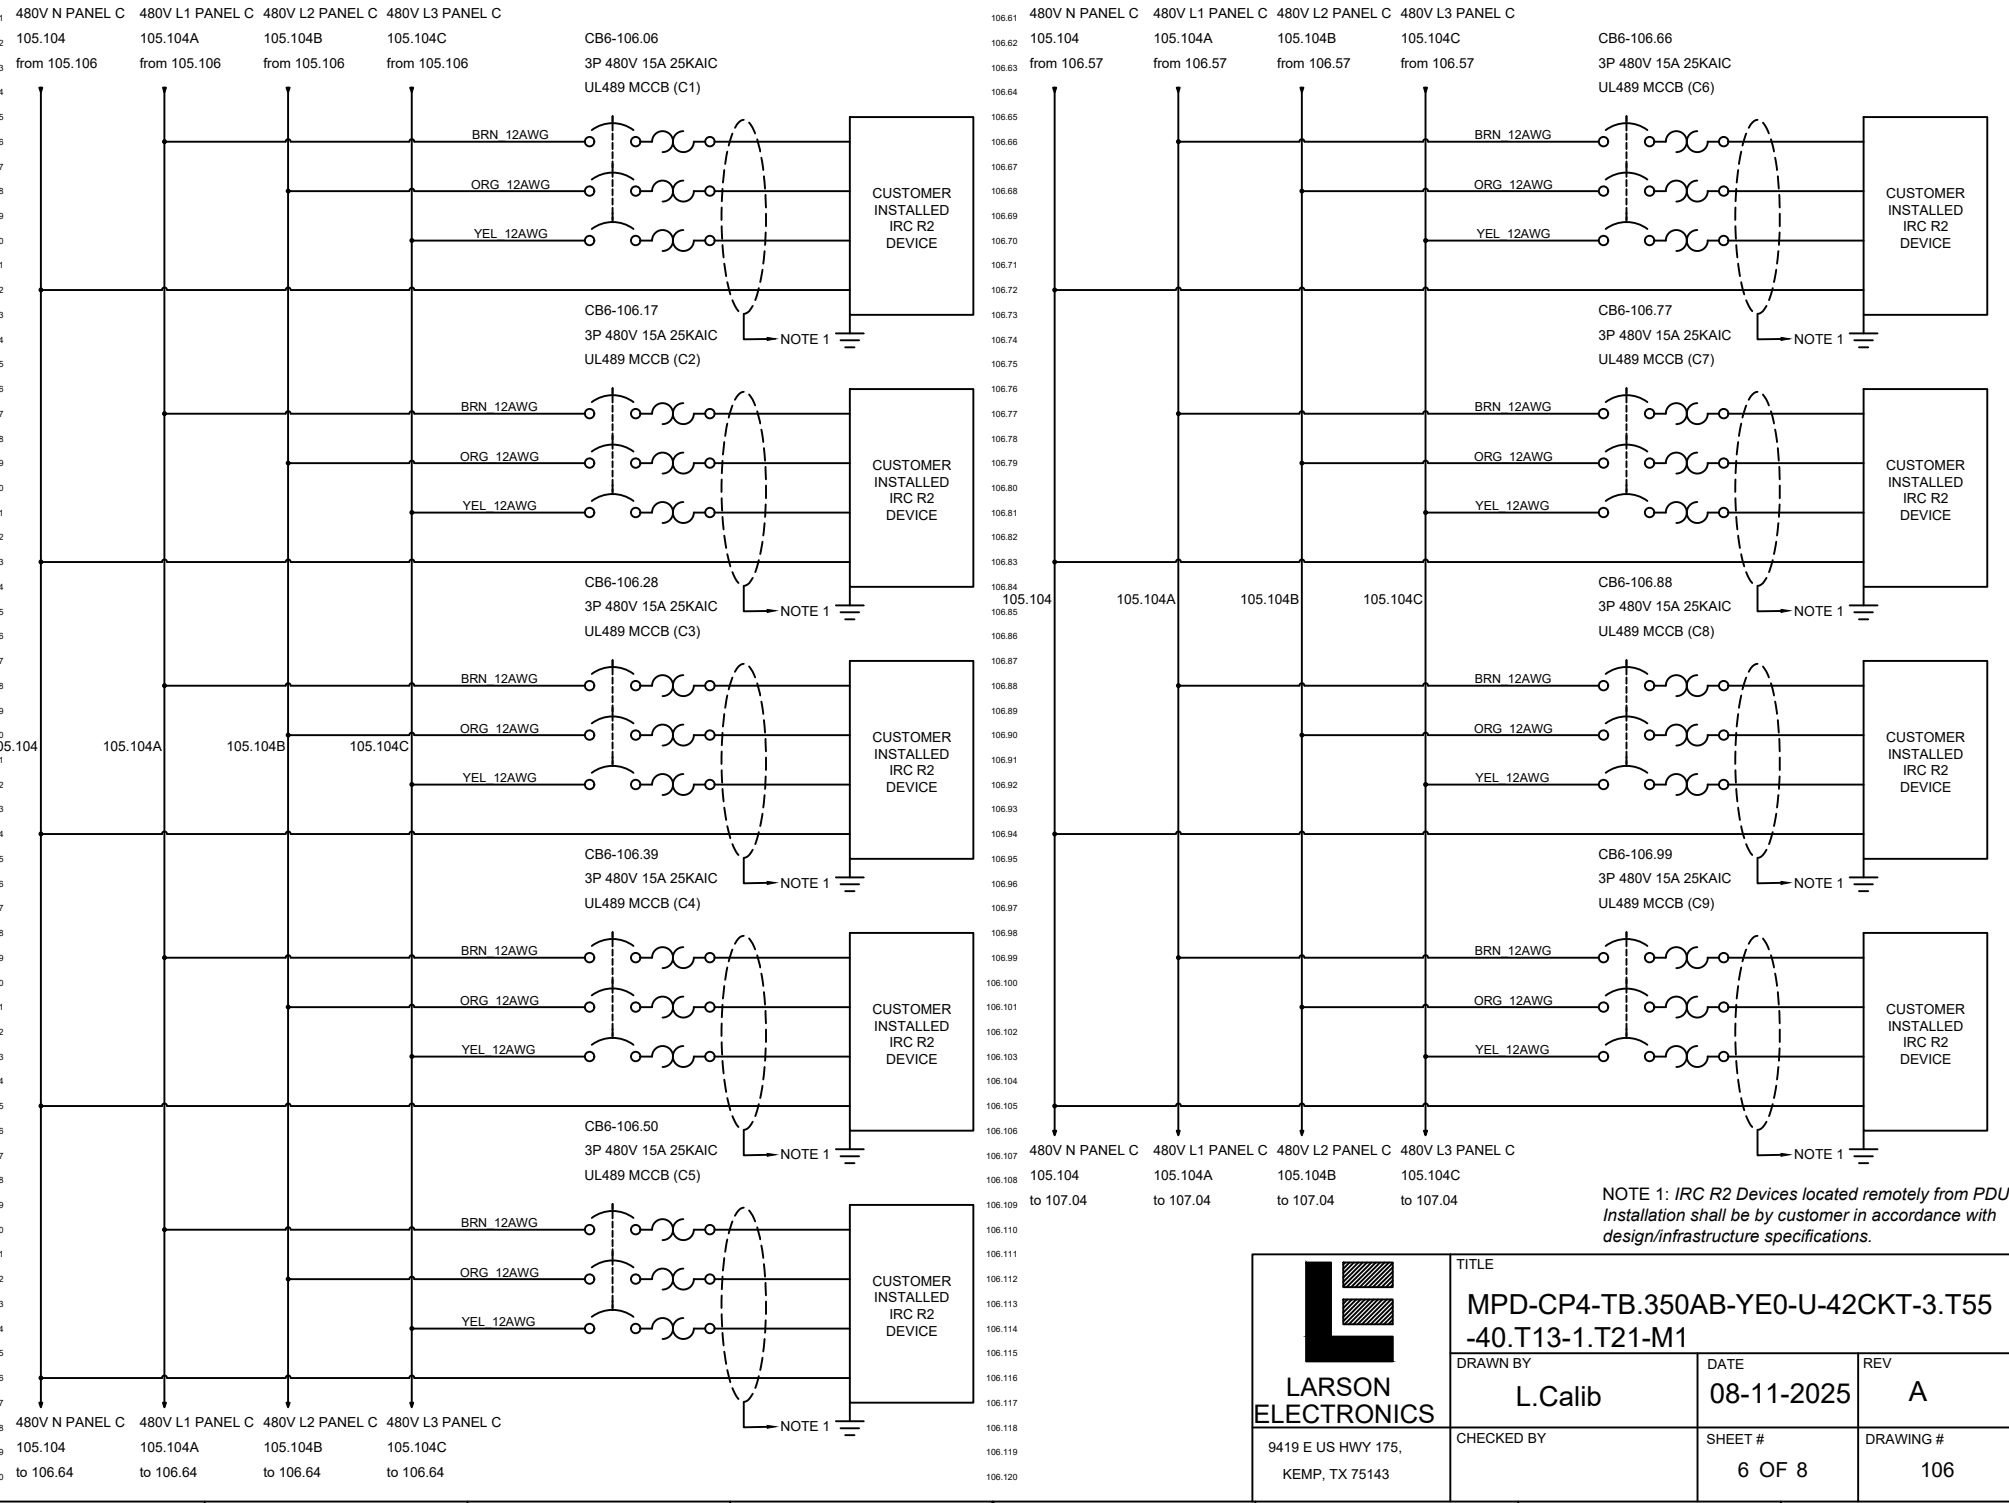

NOTE 1: *IRC R2 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	6 OF 8	106	

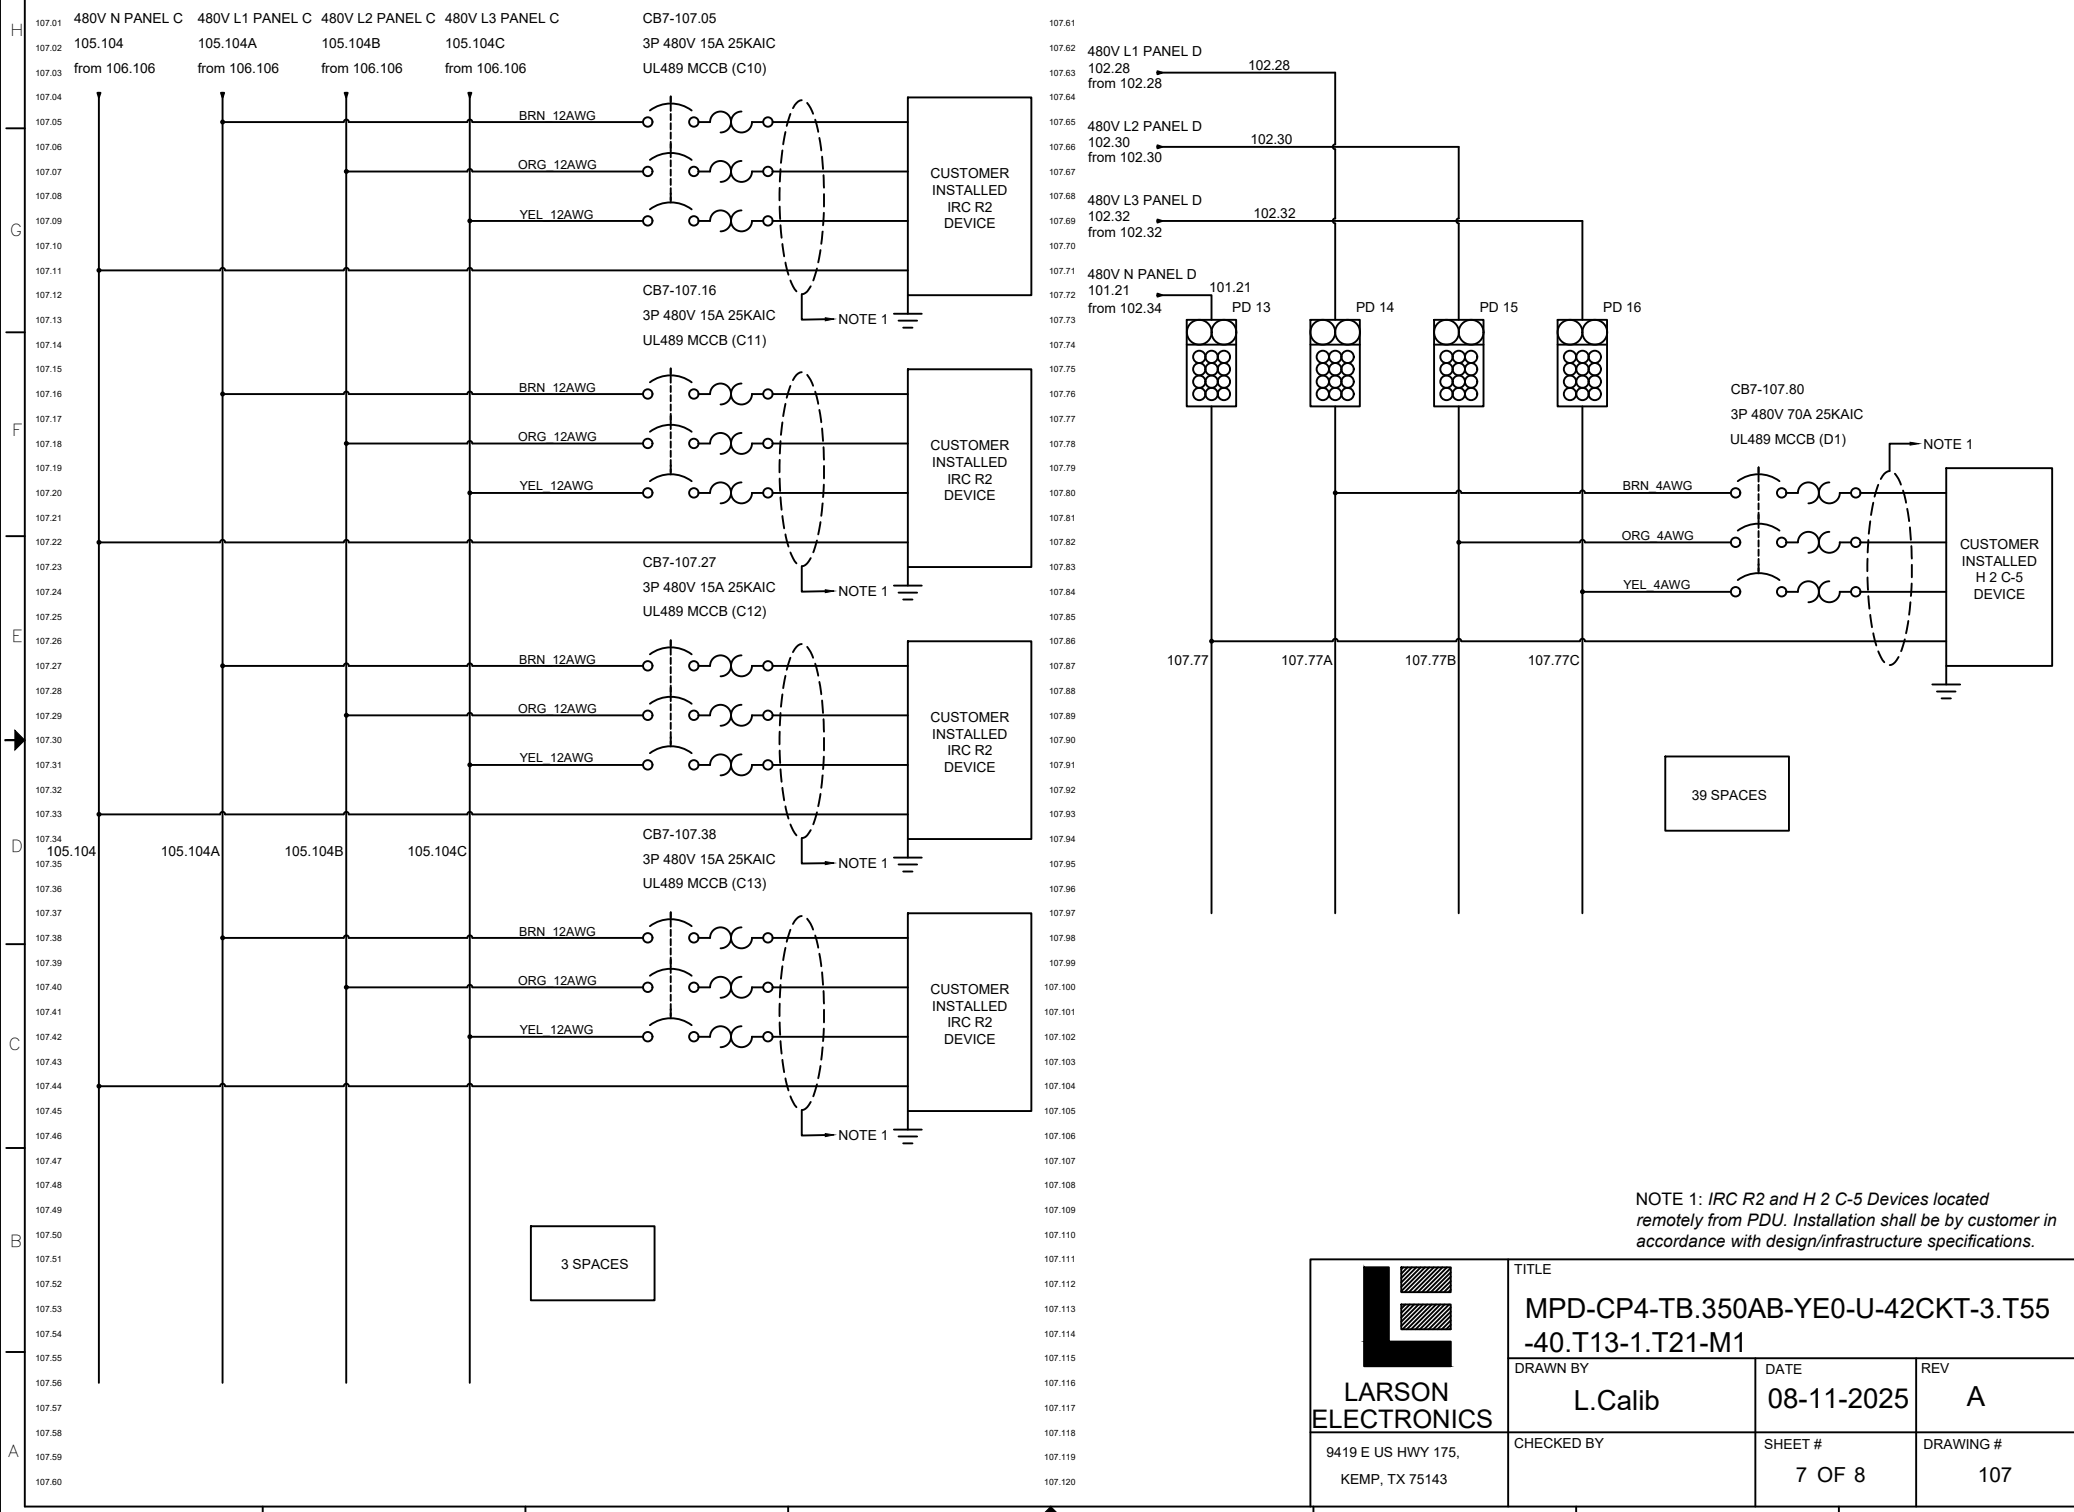

NOTE 1: *IRC R2 and H 2 C-5 Devices located remotely from PDU. Installation shall be by customer in accordance with design/infrastructure specifications.*

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE			
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1			
DRAWN BY	DATE	REV	
L.Calib	08-11-2025	A	
CHECKED BY	SHEET #	DRAWING #	
	7 OF 8	107	

TAGS	QTY	CATALOG	DESCRIPTION
2 HOLE GRND LUG	1	UNV00007136	2 HOLE GROUND LUG
CB7-107.80	1	UNV00015179	3P 70A 250/480V DIN RAIL MCCB
CB1-101.28 CB2-102.06 CB2-102.17 CB2-102.28	4	UNV00015187	3P 480V 225A UL489 MCCB
CB1-101.06	1	UNV00020377	3P 350A 480V UL489 MOLDED CASE CIRCUIT BREAKER
CB2-102.46 CB2-102.66 CB2-102.77 CB2-102.88 CB2-102.99 CB3-103.05 CB3-103.16 CB3-103.27 CB3-103.38 CB3-103.49 CB3-103.65 CB3-103.76 CB3-103.87 CB3-103.98 CB4-104.19 CB4-104.30 CB4-104.41 CB4-104.65 CB4-104.76 CB4-104.87 CB4-104.98 CB5-105.06 CB5-105.17 CB5-105.28 CB5-105.39 CB5-105.50 CB5-105.66 CB6-106.06 CB6-106.17 CB6-106.28 CB6-106.39 CB6-106.50 CB6-106.66 CB6-106.77 CB6-106.88 CB6-106.99 CB7-107.05 CB7-107.16 CB7-107.27 CB7-107.38	40		3P 15A 480V UL489 MOLDED CASE CIRCUIT BREAKER
T01-101.20 T01-101.20A T01-101.20B T01-101.20C	4	UNV00014768	22 HOLE 10IN BUS BAR

TAGS	QTY	CATALOG	DESCRIPTION
PD 1 PD 10 PD 11 PD 12 PD 13 PD 14 PD 15 PD 16 PD 2 PD 3 PD 4 PD 5 PD 6 PD 7 PD 8 PD 9	16	UNV00015085	POWER DISRIBUTION BLOCK 2-12 OPENING 570A
GRND BAR KIT 1 GRND BAR KIT 2 GRND BAR KIT 3 GRND BAR KIT 4	4	UNV00013942C	GROUND BAR KIT

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE
MPD-CP4-TB.350AB-YE0-U-42CKT-3.T55-40.T13-1.T21-M1

DRAWN BY	DATE	REV
L.Calib	08-11-2025	A
CHECKED BY	SHEET #	DRAWING #
	8 OF 8	107

Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

Evaluated Listings:

ETL: UL 1640 - NEC / United States standards
ETL: CAN/CSA-C22.2 No. 14 – CEC / Canada standards

The MGL, MPD, MGS, WAL Series are certified to NEC and CEC standards for power distribution systems. These units are constructed using individual components certified to NEC and CEC standards, and are built to UL 1640 and CAN/CSA C22.2 No 14.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX
Date of issue: September 11, 2019

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the statements(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

The MGL, MPD, MGS, WAL Series from Larson Electronics LLC utilize components certified to NEC and CEC standards. Larson Electronics LLC specifies wiring device standard designations (e.g. NEMA 5-20R, NEMA L6-30R, CS8265C) in the electrical diagrams and spec sheet of each product. Unless specified, the brands of components used, which may vary based on availability at the time of build, include but are not limited to: Hubbell, Leviton, Molex, Daniel Woodhead, Legrand, Eaton, Thomas & Betts, Russel Stroll, Meltric, Mennekes, ABB Group, Emerson, Appleton, Crouse Hinds, Killark, R.Stahl, or other certified equipment manufacturers.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

TECHNICAL INFORMATION

POWDURA® POLYESTER TGIC
POWDER COATING

PRODUCT DESCRIPTION

PLR2-60002
RAL 5010 GENT BLUE

POWDURA® Polyester TGIC Powder Coatings are recommended for a broad range of interior/exterior functional and decorative applications.

Advantages:

- Provides excellent overbake resistance
- Good chemical resistance
- Very good outdoor exposure qualities
- Wide range of special effects available
- Available in a broad range of colors

Many applications, including:
Steel Furniture
Refrigeration
Electronic Cabinetry
Scaffolding
Electrical Equipment
Instrument Housings

Appliances
Sporting Goods

Storage: Powdura® Powder Coatings should be kept in a dry and cool area at temperatures below 80°F (27°C). When not in use, store powder in sealed containers: fine powders are hygroscopic.

Substrate Preparation: Substrate should be free of grease, oil, dirt, fingerprints, drawing compounds, any contamination, and surface preparation treatments to ensure optimum adhesion and coating performance properties. The use of a chemical conversion coating prior to the application of a powder coating is strongly recommended.

Testing: Due to the wide variety of substrates, surface preparation methods, application methods, and environments, the customer should test the complete system for adhesion, compatibility and performance prior to full-scale application.

CAUTIONS

Thoroughly review product SDS prior to using this product. Please consult your local sales representative or your local Sherwin-Williams facility for additional information.

Special Advisory: River texture type finishes are unique finishes that may vary with application, film thickness and cure conditions. Light colors and very dark colors may occasionally show colored specks that appear as contamination. This is the nature of this type of finish and cannot be predicted or controlled. Thorough cleaning is required when switching to a normal smooth powder coating to prevent craters in the smooth finish.

APPLICATION

Cure Schedule:	10 MIN @ 400F
Film Thickness Range(mils):	3.0-5.0

ATTRIBUTES

Specific Gravity(g/ml):	1.72
Coverage at 1.0 Mil(ft^2/lb):	112.4
60° Gloss: (ASTM D-523)	15-30
Adhesion: (ASTM D-3359)	5B
Flexibility: (ASTM D-522)	Pass 1/8"
Pencil Hardness: (ASTM D-3363)	H-2H
Impact Resistance(in.lb): (ASTM D-2794)	Dir 100 in-lbs Rev 100 in-lbs

Note: Performance measured using 24-gauge Bonderite® 1000 test panels.

Shelf Life:	12 Months

Sherwin-Williams recommends that all material be used in FIFO order (first in - first out). Materials that exceed the recommended shelf life should be tested prior to use.

Note:
Product Data Sheets are periodically updated to reflect new information relating to the product. It is important that the customer obtain the most recent Product Data Sheet for the product being used. The information, rating and opinions stated above pertain to the material currently offered and represent the results of tests believed to be reliable. However, due to variations in customer handling and methods of application, which are not known, or under our control, The Sherwin-Williams Company cannot make any warranties or guaranties as to the end results.

08 00

Grove City Product Mod

24-Mar-2020

Material Safety Data Sheet

To Whom It May Concern,

Larson Electronics LLC MGL, MPD, MGS, WAL Series industrial line of portable power distribution systems are considered "ARTICLES" under 29 CFR 1910-1200, the OSHA Hazard Communication Standard, and do not require a Material Safety Data Sheet (MSDS).

Articles are specifically exempt from the regulations of this standard. OSHA defines an article as follows:

1910-1200(c) – Article means a manufactured item other than a fluid or particle:

i. Which is formed to a specific shape or design during manufacture;
ii. Which has end use function(s) dependent in whole or in part upon its shape or design during end use; and
iii. Which under normal conditions does not release more than very small quantities.

Regards,

Ray Smith
Larson Electronics, LLC.

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

<- Back

Product Description

Title:	STAGE & STUDIO PORTABLE WIRING COMPARTMENTS
Company:	LARSON ELECTRONICS LLC - Kemp, TX USA
Product Information:	Power Distribution System, Model Nos. MGL, MPD, MGS, WAL series; Followed by AAK-PBB.FFF-SCC.GGG-EEXCCC.DDD; Where AA = 2,3,5,7,9,15,20,25,30,45,50,75; BB = 1P, 3P; FFF = 480,240,208,120; CC = 1P,3P; GGG = 480,240,208,120; EE = # of outlets; CCC = voltage; DDD = outlet amperage.
Evaluated to the following:	A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Stage & Studio Portable Wiring Compartments (UL-1640) and are identified with the ETL Listed Mark.

<- Back

Contact Us

Americas+1-888-347-5478
(or +1-312-906-7801)
Email
dirlist@intertek.com

Intertek Home
Product Directories

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. Learn more...

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. Learn more...

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

intertek
Total Quality. Assured.



<- Back

Product Description

Title:	INDUSTRIAL CONTROL EQUIPMENT
Company:	LARSON ELECTRONICS LLC - Kemp, TX USA
Product Information:	Industrial Control Panels For General Use. Power Distribution System, Model Nos. MGL, MPD, MGS series; Followed by AAK-PBB.FFF-SCC.GGG-EEXCCC.DDD; Where AA = 2,3,5,7,9,15,20,25,30,45,50,75; BB = 1P, 3P; FFF = 480,240,208,120; CC = 1P,3P; GGG = 480,240,208,120; EE = # of outlets; CCC = voltage; DDD = outlet amperage.
Evaluated to the following:	A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Industrial Control Equipment (CAN/CSA-C22.2 No. 14) and are identified with the cETL Listed Mark.

<- Back

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478 (or +1-847-660-7407)
Email
etldirectory@intertek.com

Intertek Home
Product Directories
DLP on mobile devices

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. Learn more...

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. Learn more...

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

The MGL, MPD, MGS, WAL series complies with the below standards set forth by the listed Association's requirements. Purchased and manufactured components are evaluated to Larson Electronics LLC Quality Control Management system per ISO 9001:2015. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

Evaluated Standards:

AISC: Structural steel skid design
NFPA 70: National Electrical Code
ASTM A36: Standard Specification for Carbon Structural Steel
ASTM A123: Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A489: Standard Specification for Carbon Steel Lifting Eyes
ASTM A502: Standard Specification for Rivets, Steel, Structural
ASTM A563: Standard Specification for Carbon and Alloy Steel Nuts
ASTM A500: Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
ASTM B172: Standard Specification for Rope-Lay-Stranded Copper Conductors Having Bunch-Stranded Members, for Electrical Conductors
ASTM D7803: Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Powder Coating
SAE J429: Mechanical and Material Requirements for Externally Threaded Fasteners
AWS D1.1: Structural Welding – Steel
ICEA S-58-679: Standard for Control, Instrumentation and Thermocouple Extension Conductor Identification
ICEA S-75-381: Portable and Power Feeder Cables for Use in Mines and Similar Applications
NEMA OFP 1-2017: Protection of Receptacle Outlets in Wet Locations According to the National Electrical Code

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

NEMA PB 1-2011: Panelboards
NEMA ST 20-2014: Dry Type Transformers for General Applications
NEMA WD 1-1999 (R2015): General Color Requirements for Wiring Devices
ANSI C80.1-2015: American National Standard for Electric Rigid Steel Conduit
ANSI C119.4-2016: American National Standard for Electric Connectors
ANSI Z535.4-2011: American National Standard for Product Safety Signs and Labels
ANSI/IEC 60529-2004 (R2011): American National Standard for Degrees of Protection Provided by Enclosures (IP Code)

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

Evaluated Listings:

CE: DIRECTIVE 2014/35/EU - LOW VOLTAGE DIRECTIVE
CE: DIRECTIVE 2014/30/EU - EMC DIRECTIVE
CE: Regulation (EC) No 1907/2006 - REACH REGULATION
CE: DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

The MGL, MPD, MGS, WAL series complies with the essential protection requirements of the European Parliament of the Council Directive for Low Voltage Directive, EMC Directive, REACH Regulation, and RoHS Directive. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

Evaluated Listings:

CE: Regulation (EC) No 1907/2006 - REACH REGULATION
CE: DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

This is to certify that products offered by Larson Electronics LLC comply with the Reduction of Hazardous Substances (RoHS) directives. Directive 2002/95/EC became effective on 1 July 2006. It restricts the use of six substances in the manufacture of electrical and electronic equipment. This directive was revised in June 2011 and is now referred to as directive 2011/65/EU. Directive 2015/863/EU amending Annex II to Directive 2011/65/EU announced plans to add four substances from 22 July 2019.

We hereby certify that the equipment specified above conforms to the Directive(s) by containing less of the restricted substances than the stated limits.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

Evaluated Listings:

CE: Regulation (EC) No 1907/2006 - REACH REGULATION

This letter establishes the opinion of Larson Electronics LLC regarding the status, under the current European Union (“EU”) Regulations on Registration, Evaluation, Authorization, and Restriction of Chemical Substances (“REACH”).

REACH does not apply to manufactured products which are referred to as “completed articles”. Substances (chemicals) are subject to REACH registration, NOT products.

In addition, Articles are exempt from the REACH requirements if (a) the Article does not contain a substance of very high concern or candidate substance in an amount exceeding 0.1% weight by weight, and (b) if substances present in the Article in excess of 1 ton per year per importer are not expected nor intended to be released.

Based on communication with our raw material suppliers, we conclude that to the best of our knowledge our products requiring REACH compliance do not contain any of the currently listed SVHC in concentrations of 0.1% or above.

Accordingly, we foresee no registration or pre-registration requirement for the products we supply.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager

LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664

Frequently Asked Questions (FAQ)

There are no Faqs