Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664

## MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1

# 300 KVA Distribution Skid, 480V-208Y/120V 3PH, (2) L14-30R (2) L6-30R (2) 6-15R (12) L5-20R (16) 5-20R GFCI Duplex Outlets, Open Cube Skid w/ Lockable Casters, 6' Cord w/ R&S DS4504MP000 Inlet, NEMA 3R

**Product ID: 331251**



Image: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1

**Larson Electronics LLC manufactures a wide variety of products, including custom built to spec designs. The pictures displayed for this unit are a general representation of form factor for the product line and may not accurately represent this exact configuration in every detail due to custom builds and changes between similar products in our standard catalog. The specifics for this configuration are listed in the specification table and supporting documentation (CAD files, Dimensional Drawing, Name Plate Diagram, Wiring Diagram, etc.). This means that specific details (receptacles, plugs, wires, connections, mounting brackets, external finishes, etc.) may not be accurately represented in images vs specifications. Please review specifications and do not order based solely on images.**

**MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 - Temporary Power Distribution System**

**Line-in Cord:** 6FT 500MCM 4/C Type W Cord [2000V] + 6FT 2 AWG 1/C Type W Cord [2000V]
**Line-in Cord Cap:** R&S DS4504MP000 4P5W 400A Pin & Sleeve Male Plug [480V]
**Primary Voltage (V):** 480V AC Delta
**Primary Phase (PH):** 3-Phase (3PH)
**Primary Frequency (HZ):** 60 Hz (60-cycles)
**Primary Panel:** 480V 3PH 400A MCCB N3R
**Primary Breaker(s):** N/A
**Primary Outlet(s):** N/A
**Primary Protection:** MCCB Circuit Breaker
**Transformer (KVA):** 300KVA 480V to 208Y/120V 3PH
**Secondary Voltage (V):** 208Y/120V AC Wye
**Secondary Phase (PH):** 3-Phase (3PH)
**Secondary Frequency (HZ):** 60 Hz (60-cycles)
**Secondary Panel:** 208Y/120V 833A MLO N3R
**Secondary Breaker(s):** (4) 30A 2P MCB [250V]; (2) 15A 2P MCB [250V]; (20) 20A 1P MCB [125V]
**Secondary Outlet(s):** (2) L14-30R NEMA Twist-Lock Receptacle [125/250V]; (2) L6-30R NEMA Twist-Lock Receptacle [250V]; (2) 6-15R NEMA Duplex Receptacle [250V]; (12) L5-20R NEMA Twist-Lock Receptacle [125V]; (16) 5-20R NEMA Duplex-GFCI [125V]
**Secondary Protection:** MCB Circuit Breakers; GFCI's
**Form Factor:** Blue Powder Coated Steel Open Cube Skid w/ Lockable Casters
**Frame Material:** Steel

**Ratings**

**Max Primary OCP:** 400A @ 480V

**Max Secondary Output:** 833A @ 208V
NEMA 3R
Made in the USA
NRTL Certified to UL 1640
NRTL Certified to CSA C22.2 No. 14

**Powder Coat Finish Standards:**
Complies with ASTM D-523
Complies with ASTM D-3359
Complies with ASTM D-522
Complies with ASTM D-3363
Complies with ASTM D-2794

**Frame Finish:** High-Strength TGIC Polyester Powder Coated Blue
**Lifting Eyelet:** (4) Top Located
**Skid Pockets:** (2) Bottom Located
**Casters:** (4) Locking Casters
**Dimensions:** (*Please note that dimensions are approximate and subject to change*) 80"-L x 44"-W x 73"-H
**Weight:** (*Please note that weight is approximate and subject to change*) 2500 lb
Larson Electronics manufactures a wide variety of custom power distribution systems. The pictures displayed for this unit are a general representation of form factor and may not accurately represent this exact configuration in every detail due to being custom builds. The specifics for this configuration are listed in the specification table and one-line diagram.

**Special Orders - Special Requirements**
Contact us for special requirements
**Intl:** 1-214-616-6180
**Toll Free:** 1-800-369-6671

**Fax:** 1-903-765-7664

**E-mail:** sales@larsonelectronics.com

*All grounding shall comply with state and local codes and meet the minimum requirements of the National Electronic Code section 250*

**Made in Texas**

**The MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 from Larson Electronics is a Power Distribution Substation that converts three-phase 480V AC Delta electrical current to three-phase 208Y/120V AC Wye. This power distribution unit provides operators the ability to safely tap into and distribute 480V AC Delta power from a variety of sources including generators and direct grid power.**

***PLEASE NOTE: ANY FREE SHIPPING OFFERS DO NOT APPLY TO POWER DISTRIBUTION PANELS, TRANSFORMERS, OR SUBSTATIONS****

The MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 temporary power distribution system gives operators the ability to power their 208 volt and 120 volt equipment from a single system.

**Operation:**

• Primary Voltage: 480V AC Delta 3PH

• Primary Panel: 480V 3PH 400A MCCB N3R

• Primary Breaker(s): N/A

• Primary Outlet(s): N/A

• Transformer: 300KVA 480V to 208Y/120V 3PH

• Secondary Voltage: 208Y/120V AC Wye 3PH

• Secondary Panel: 208Y/120V 833A MLO N3R

• Secondary Breaker(s): (4) 30A 2P MCB [250V]; (2) 15A 2P MCB [250V]; (28) 20A 1P MCB [125V]

• Secondary Outlet(s): (2) L14-30R NEMA Twist-Lock Receptacle [125/250V]; (2) L6-30R NEMA Twist-Lock Receptacle [250V]; (2) 6-15R NEMA Duplex Receptacle [250V]; (12) L5-20R NEMA Twist-Lock Receptacle [125V]; (16) 5-20R NEMA Duplex-GFCI [125V]

*See specification table at the top of the page for more information about the power distribution system.

**Protective Construction:** This temporary power distribution unit features an open frame cube design and is ruggedly constructed to withstand demanding conditions and industrial applications. The model is equipped with bottom-located forklift skid pockets and four top-located lifting eyelets, which allows easy lifting with cable or chain hooks. Four locking casters at the base provides mobility around work sites.

The power distribution system is constructed of steel with a polyester powder coated blue finish for durability against dirt, moisture, and mild corrosion. This special coating creates a high-strength barrier for protection from accidental bumps and scratches. The TGIC polyester powder coat finish offers reliable resistance against chemicals, UV light (sun light), and degrading elements in outdoor locations. Our powder coating solution ensures robust color retention for many years without fading. Custom colors, such as black, grey, desert tan, or forest green, and galvanized finishes are available upon request. Non-standard powder coat colors or galvanized finishes may increase price and lead times.

The transformer and load center/distribution assembly is mounted to a standard steel cube style frame resulting in an extremely stable, durable, and mobile power distribution platform. This temporary power distribution solution can be modified to meet the needs of job-site receptacle requirements. Larger units are available upon request and can be equipped with skids or trailer mounted.

**Certification:** All units are built in accordance to NFPA 70 (National Electric Code) and NRTL certified to UL 1640. All equipment is NEMA 3R rated for indoor and outdoor use and provide a degree of protection against dirt, water, and ice. NEMA 4 and NEMA 4X equipment can be equipped upon request.

**Grounding:** Transformer is grounded to the frame and we provide a grounding lug on the frame for the earth ground.
~Please check all motor loads for dual rated motors that will work 208 or 240.~


**Applications:** This power distribution system is ideal for indoor or outdoor use and applications including but not limited to, construction sites, plant maintenance, plant turnarounds, shows, exhibits, and shipyard operations. These power distribution systems are popularly used in applications where external power sources are often necessary. We also offer class rated transformers for use within explosion proof and hazardous location environments.


**Custom Built Systems Available:** Larson Electronics is a manufacturer and we can build portable power distribution systems to your specifications. Although we carry several models of portable power distribution systems in stock, we can deliver custom ordered units almost as quickly as our prebuilt units. If this model does not meet your needs, please contact us at 1-800-369-6671 or sales@larsonelectronics.com to discuss your specific requirements.

| REV | DESCRIPTION | DATE |
|---|---|---|
| A | QUOTE UPDATE | 02/04/2026 |

# MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1


LARSON ELECTRONICS®

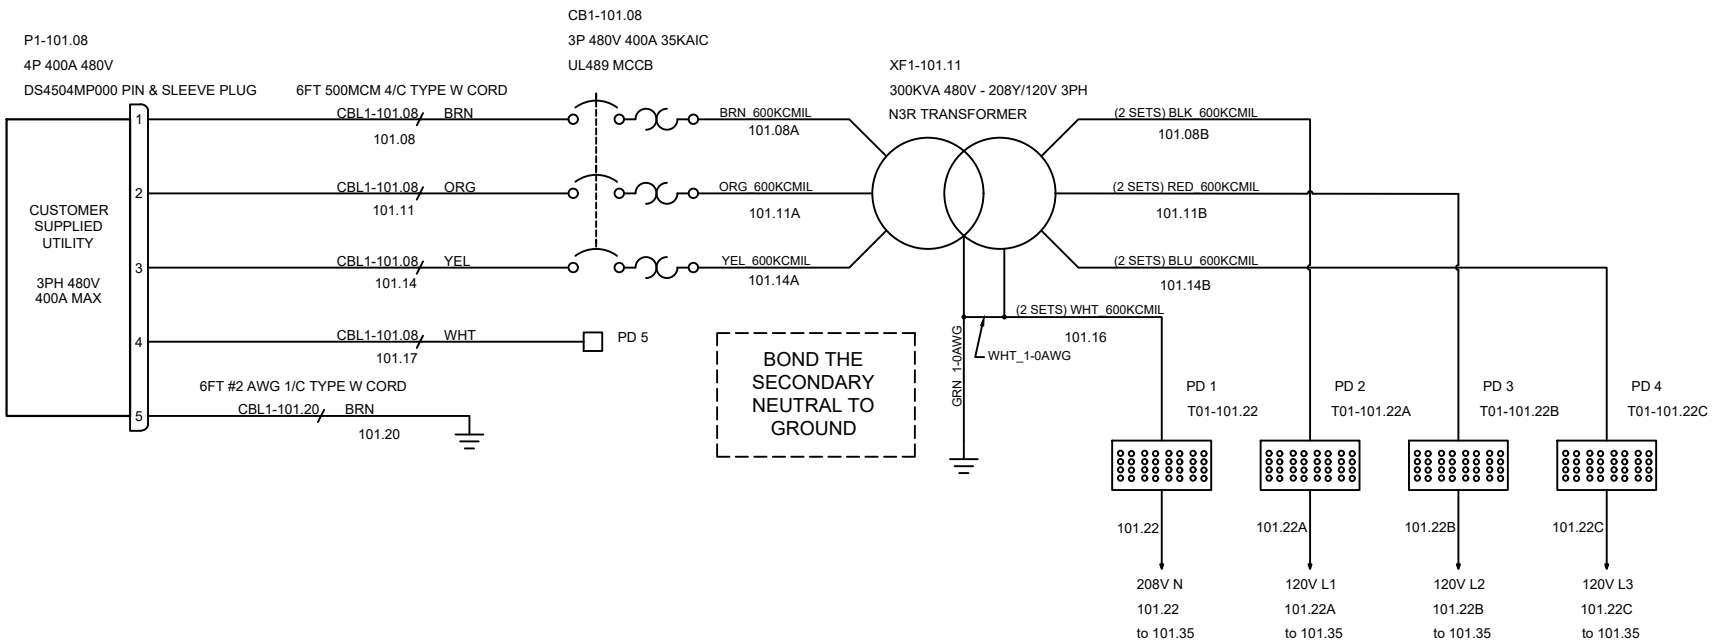

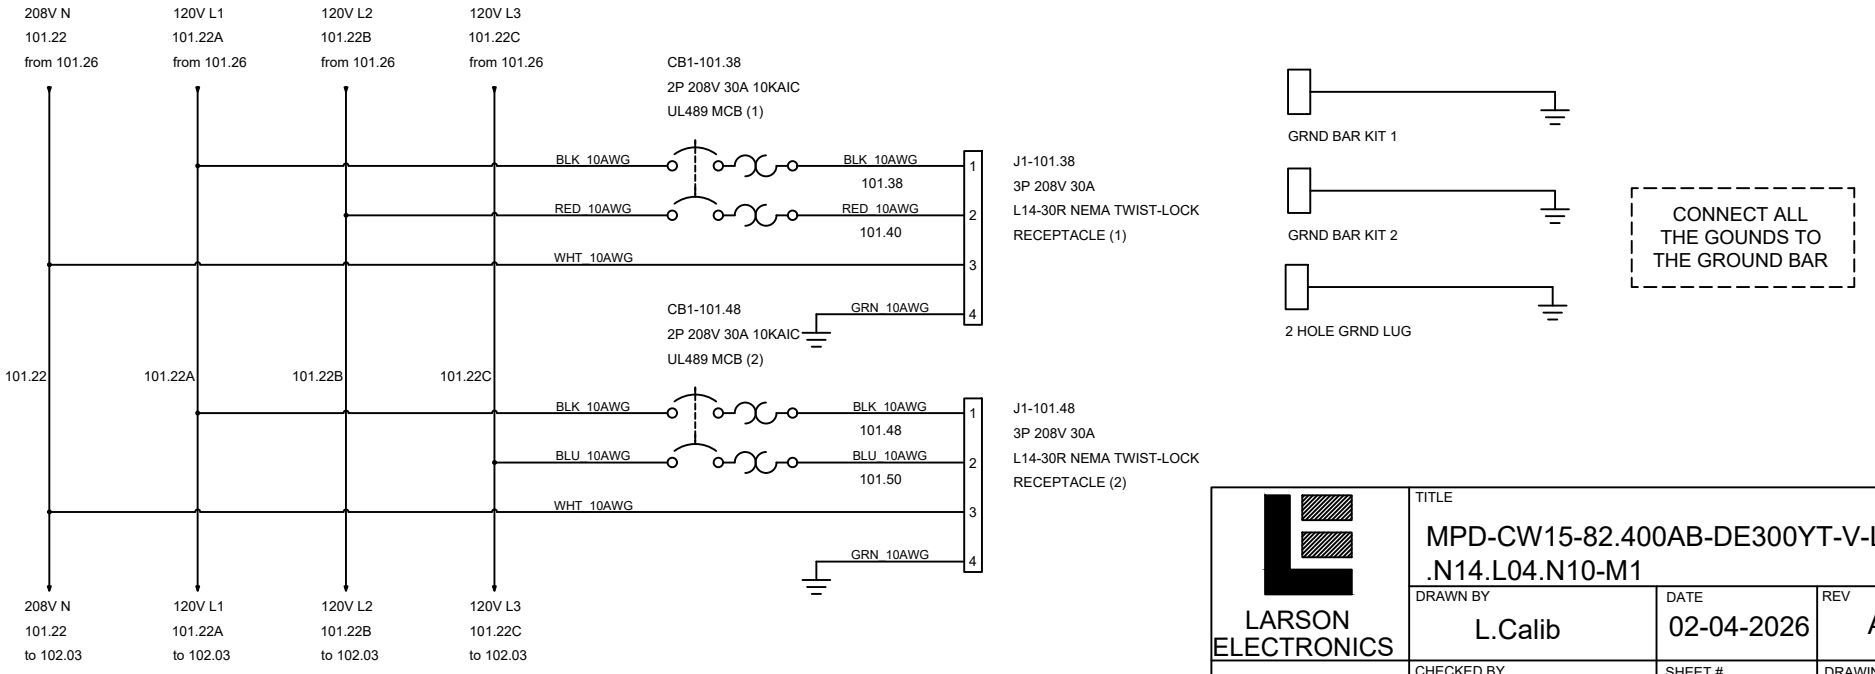
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

| | | | |
|---|---|---|---|
| TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 | | | |
| DRAWN BY: L.Calib | DATE: 02-04-2026 | REV: A | |
| CHECKED BY: | SHEET #: 1 OF 5 | DRAWING #: 101 | |

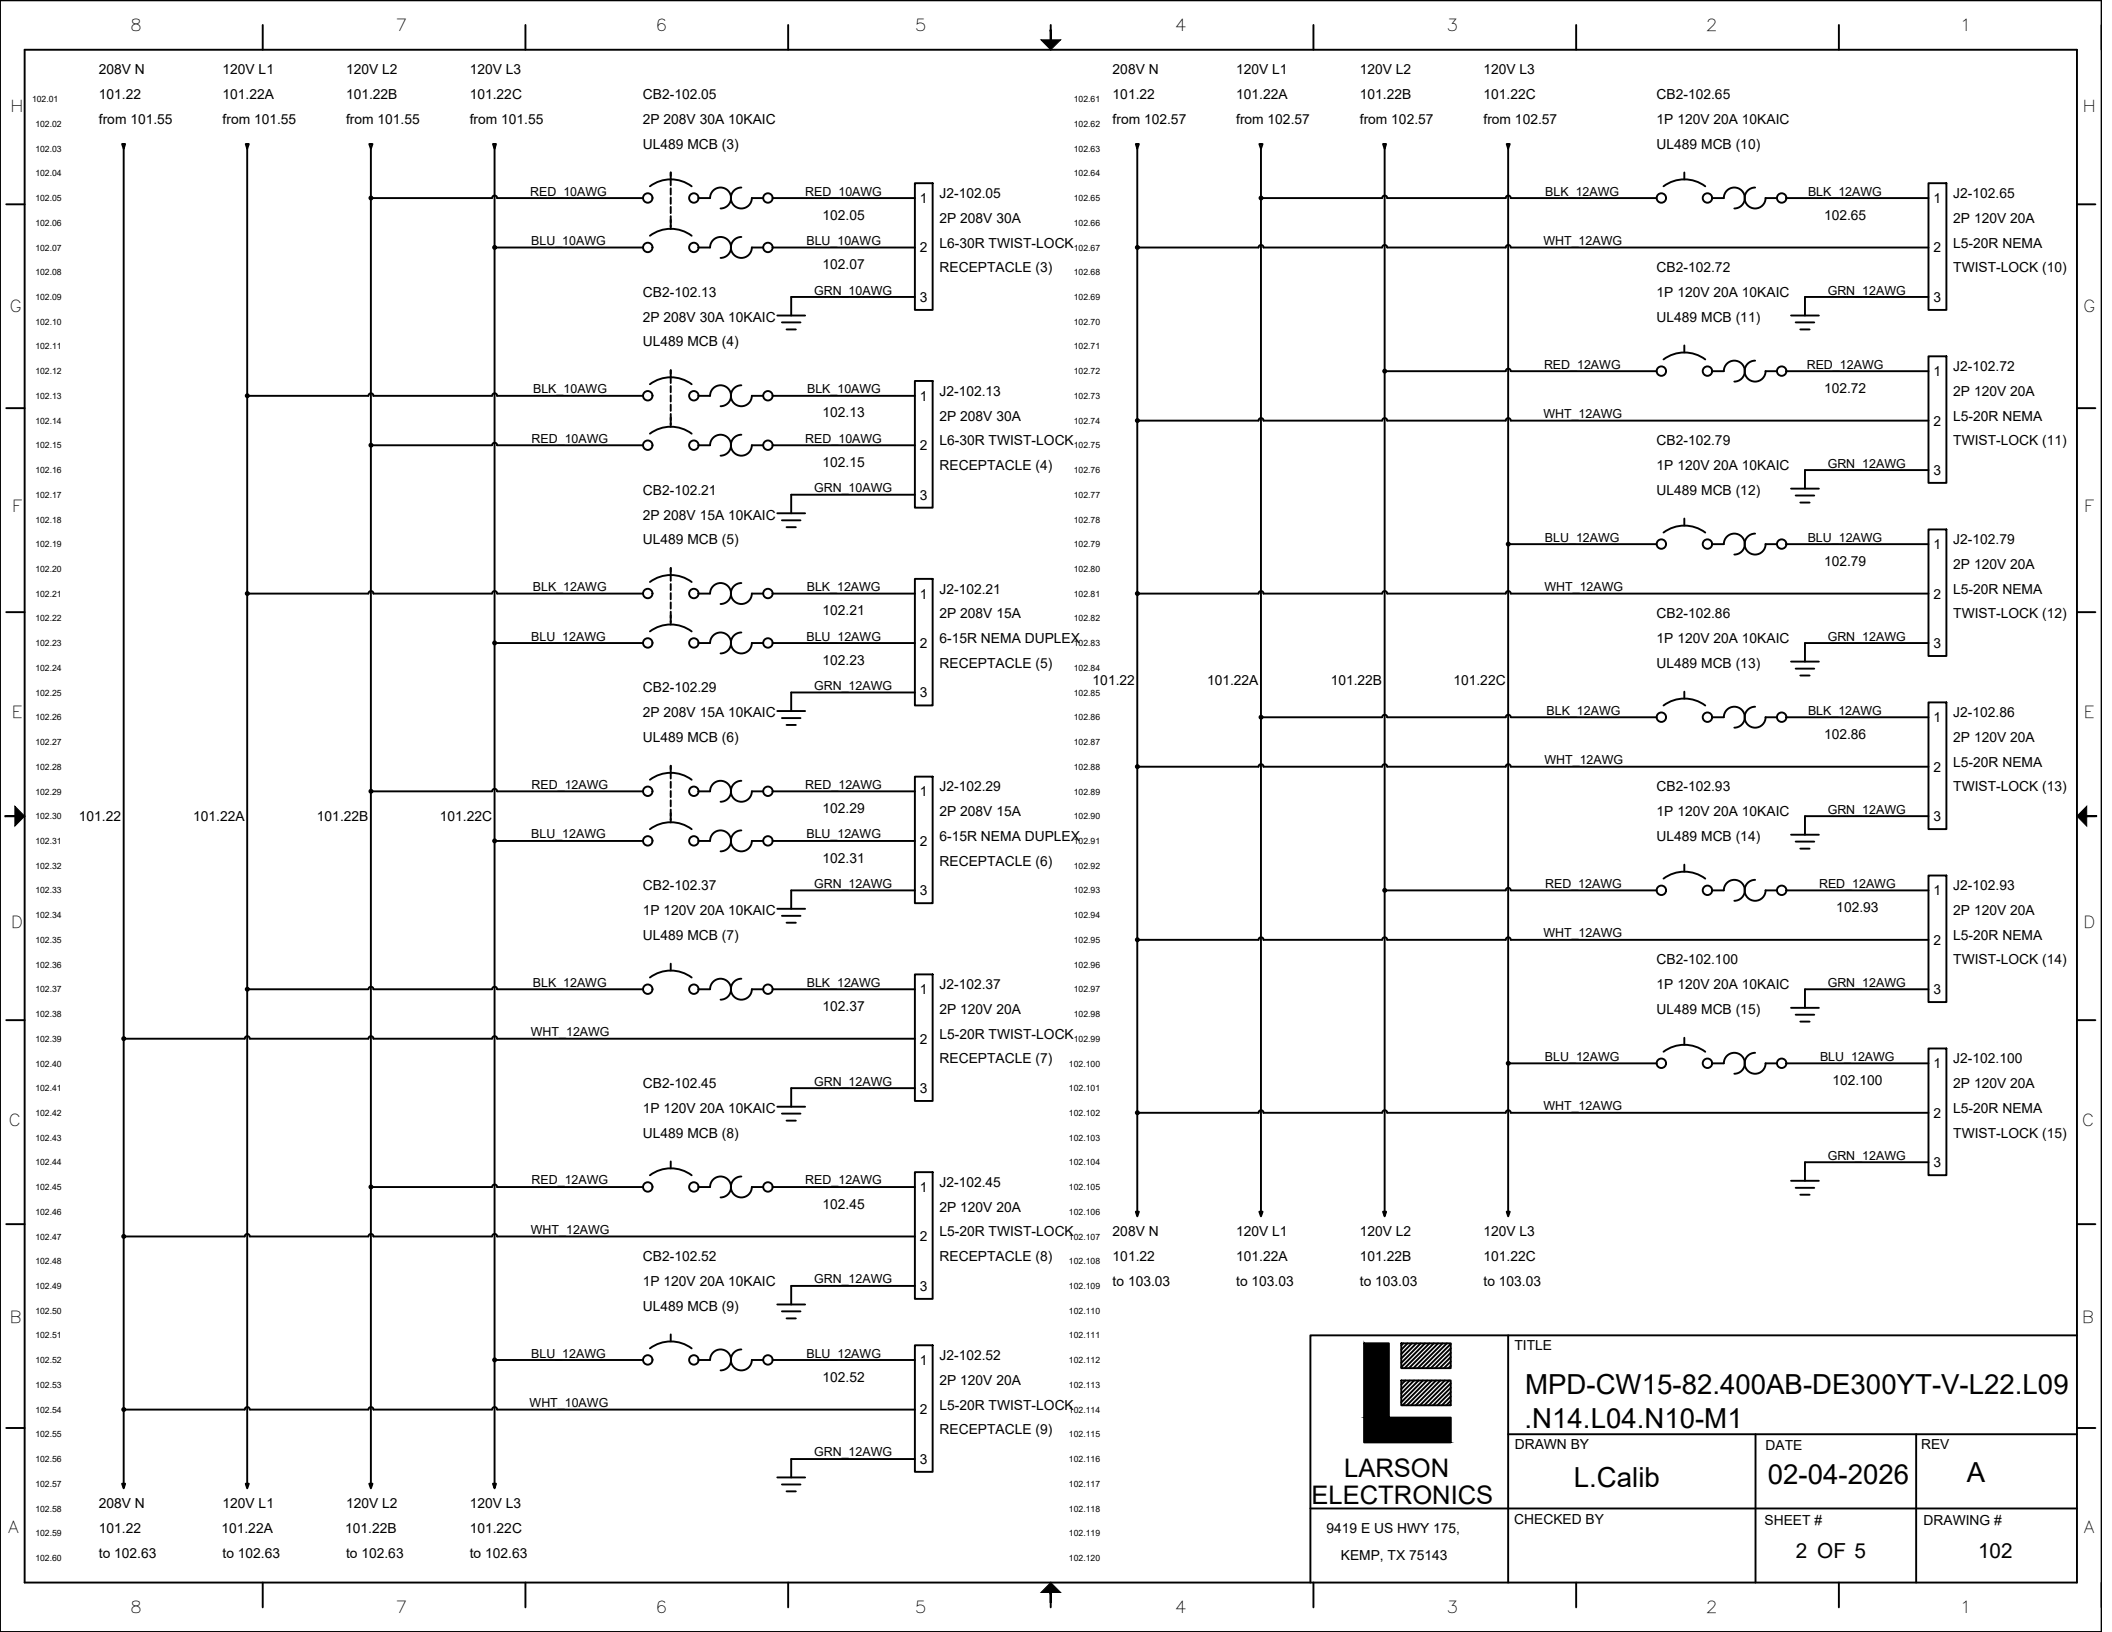




LARSON ELECTRONICS

9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 02-04-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 2 OF 5 | 102 |

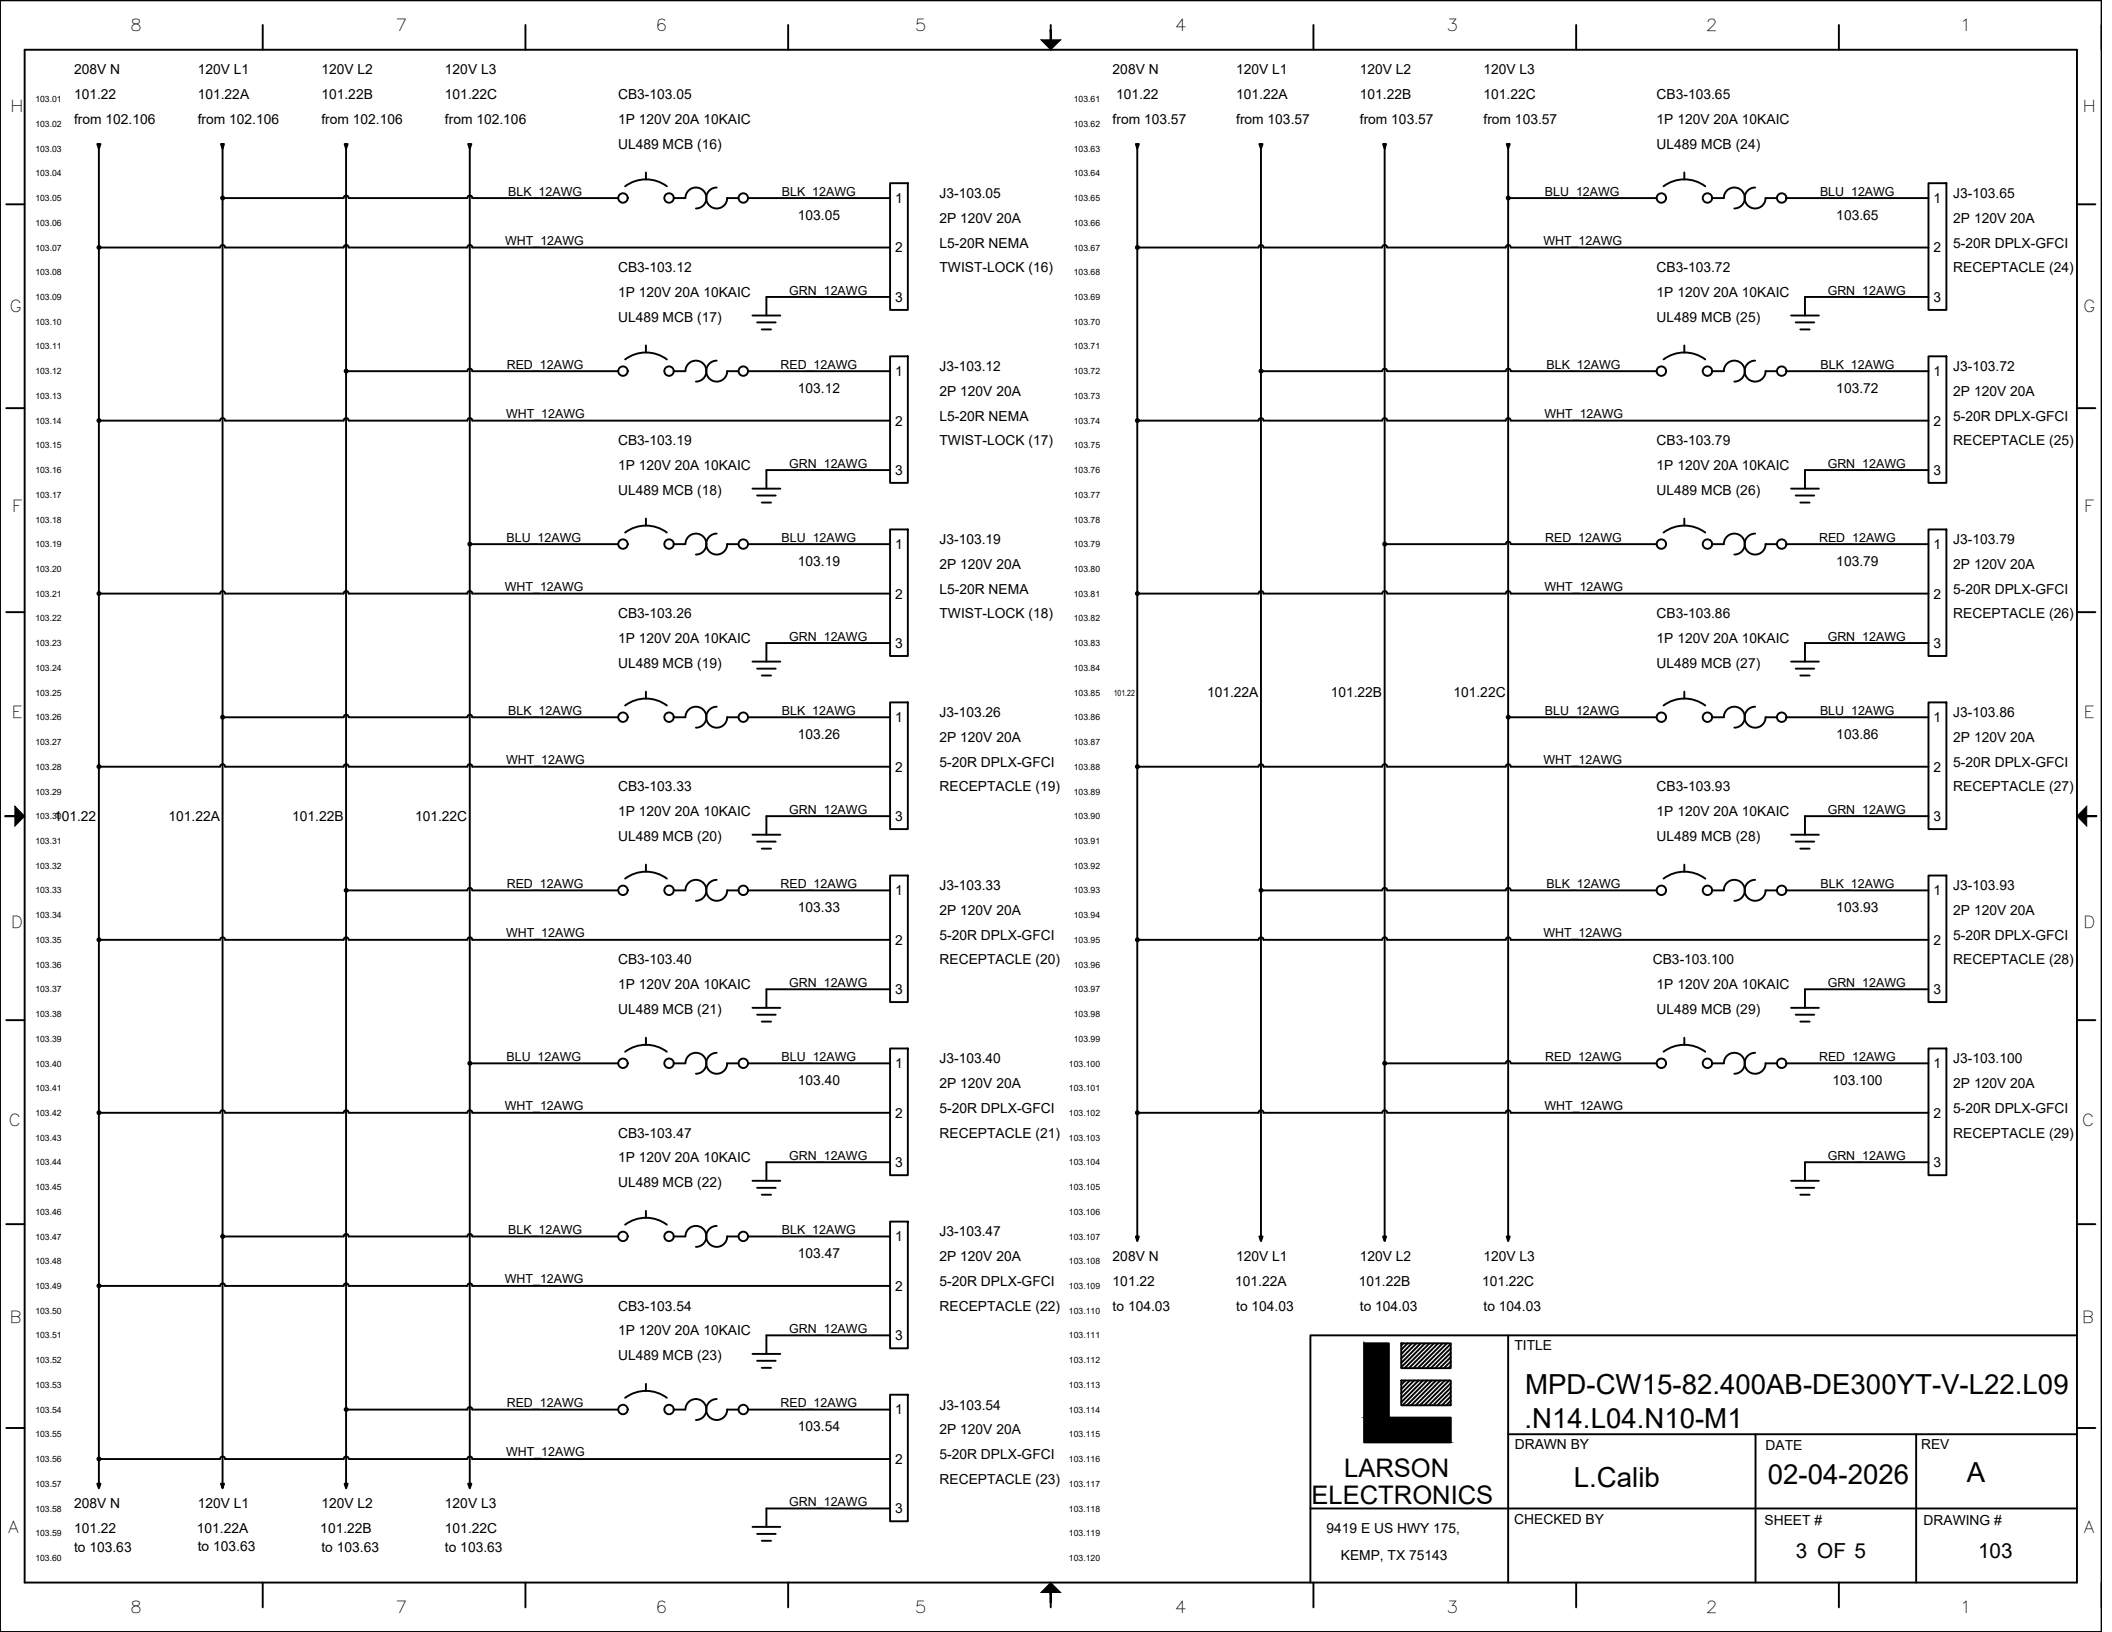
208V N
101.22
from 102.106
120V L1
101.22A
from 102.106
120V L2
101.22B
from 102.106
120V L3
101.22C
from 102.106
CB3-103.05
1P 120V 20A 10KAIC
UL489 MCB (16)
BLK 12AWG
BLK 12AWG
103.05
WHT 12AWG
J3-103.05
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (16)
CB3-103.12
1P 120V 20A 10KAIC
UL489 MCB (17)
GRN 12AWG
RED 12AWG
RED 12AWG
103.12
J3-103.12
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (17)
CB3-103.19
1P 120V 20A 10KAIC
UL489 MCB (18)
BLU 12AWG
BLU 12AWG
103.19
J3-103.19
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (18)
CB3-103.26
1P 120V 20A 10KAIC
UL489 MCB (19)
103.26
J3-103.26
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (19)
CB3-103.33
1P 120V 20A 10KAIC
UL489 MCB (20)
101.22
101.22A
101.22B
101.22C
103.33
J3-103.33
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (20)
CB3-103.40
1P 120V 20A 10KAIC
UL489 MCB (21)
103.40
J3-103.40
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (21)
CB3-103.47
1P 120V 20A 10KAIC
UL489 MCB (22)
103.47
J3-103.47
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (22)
CB3-103.54
1P 120V 20A 10KAIC
UL489 MCB (23)
103.54
J3-103.54
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (23)
208V N
101.22
to 103.63
120V L1
101.22A
to 103.63
120V L2
101.22B
to 103.63
120V L3
101.22C
to 103.63
208V N
101.22
from 103.57
120V L1
101.22A
from 103.57
120V L2
101.22B
from 103.57
120V L3
101.22C
from 103.57
CB3-103.65
1P 120V 20A 10KAIC
UL489 MCB (24)
BLU 12AWG
BLU 12AWG
103.65
J3-103.65
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (24)
CB3-103.72
1P 120V 20A 10KAIC
UL489 MCB (25)
BLK 12AWG
BLK 12AWG
103.72
J3-103.72
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (25)
CB3-103.79
1P 120V 20A 10KAIC
UL489 MCB (26)
RED 12AWG
RED 12AWG
103.79
J3-103.79
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (26)
CB3-103.86
1P 120V 20A 10KAIC
UL489 MCB (27)
103.86
J3-103.86
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (27)
CB3-103.93
1P 120V 20A 10KAIC
UL489 MCB (28)
103.93
J3-103.93
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (28)
CB3-103.100
1P 120V 20A 10KAIC
UL489 MCB (29)
103.100
J3-103.100
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (29)
208V N
101.22
to 104.03
120V L1
101.22A
to 104.03
120V L2
101.22B
to 104.03
120V L3
101.22C
to 104.03
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CW15-82.400AB-DE300YT-V-L22.L09
.N14.L04.N10-M1
DRAWN BY
L.Calib
DATE
02-04-2026
REV
A
CHECKED BY
SHEET #
3 OF 5
DRAWING #
103

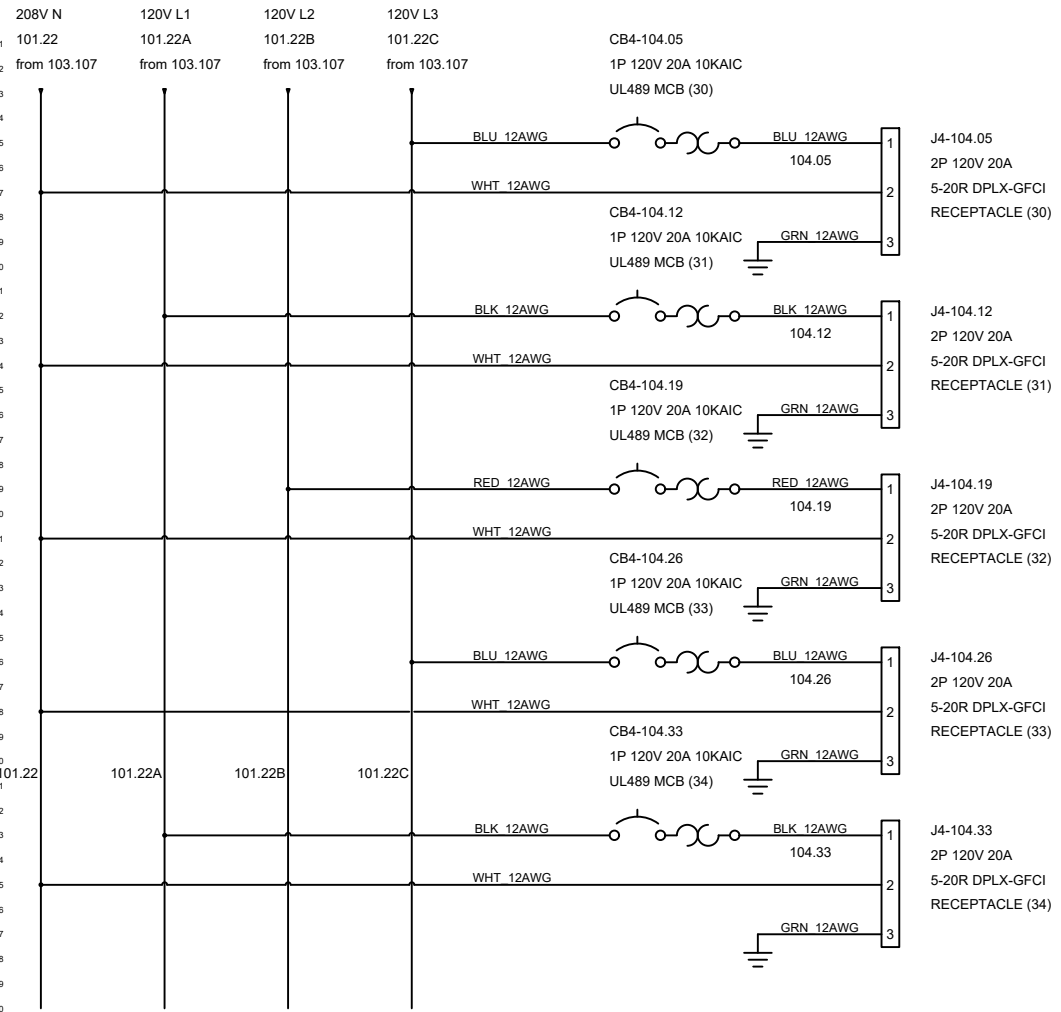


| | | | |
|---|---|---|---|
| LARSON ELECTRONICS<br>9419 E US HWY 175,<br>KEMP, TX 75143 | TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 | | |
| | DRAWN BY: L.Calib | DATE: 02-04-2026 | REV: A |
| | CHECKED BY: | SHEET #: 4 OF 5 | DRAWING #: 104 |

| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| J2-102.05<br>J2-102.13 | 2 | UNV00016830 | L6-30R COVER AND RECEPTACLE |
| J2-102.21<br>J2-102.29 | 2 | UNV00012450 | 2P 240V 15A 6-15R LOCKING RECEPTACLE |
| 2 HOLE GRND LUG | 1 | UNV00007136 | 2 HOLE GROUND LUG |
| J2-102.100<br>J2-102.37<br>J2-102.45<br>J2-102.52<br>J2-102.65<br>J2-102.72<br>J2-102.79<br>J2-102.86<br>J2-102.93<br>J3-103.05<br>J3-103.12<br>J3-103.19 | 12 | UNV00005543 | 1P 120V 20A L5-20R LOCKING RECEPTACLE |
| J3-103.100<br>J3-103.26<br>J3-103.33<br>J3-103.40<br>J3-103.47<br>J3-103.54<br>J3-103.65<br>J3-103.72<br>J3-103.79<br>J3-103.86<br>J3-103.93<br>J4-104.05<br>J4-104.12<br>J4-104.19<br>J4-104.26<br>J4-104.33 | 16 | UNV00014533 | 5-20R 1P 20A 125V GFCI RECEPTACLE |
| J1-101.38<br>J1-101.48 | 2 | UNV00006737 | 2P 250V 30A L14-30R LOCKING RECEPTACLE |
| P1-101.08 | 1 | | R&S DS4504MP000 4P5W 400A Circuit Breaker Plug |
| CB2-102.100<br>CB2-102.37<br>CB2-102.45<br>CB2-102.52<br>CB2-102.65<br>CB2-102.72<br>CB2-102.79<br>CB2-102.86<br>CB2-102.93<br>CB3-103.05<br>CB3-103.100<br>CB3-103.12<br>CB3-103.19<br>CB3-103.26<br>CB3-103.33<br>CB3-103.40<br>CB3-103.47<br>CB3-103.54<br>CB3-103.65<br>CB3-103.72<br>CB3-103.79<br>CB3-103.86<br>CB3-103.93<br>CB4-104.05<br>CB4-104.12<br>CB4-104.19<br>CB4-104.26<br>CB4-104.33 | 28 | UNV00017491 | 1P 125V 20A 10KA UL489 DIN RAIL MOUNT BREAKER |

| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| CB1-101.38<br>CB1-101.48<br>CB2-102.05<br>CB2-102.13 | 4 | UNV00017628 | 2P 240V 30A UL489 CIRCUIT BREAKER |
| CB2-102.21<br>CB2-102.29 | 2 | | BK63HU 2P C15A 10kA 240VAC UL489 DIN RAIL |
| CB1-101.08 | 1 | UNV00015189 | 3P 480V 400A UL489 MOLDED CASE CIRCUIT BREAKER |
| T01-101.22<br>T01-101.22A<br>T01-101.22B<br>T01-101.22C | 4 | UNV00014768 | 22 HOLE 10IN BUS BAR |
| PD 5 | 1 | UNV00008889 | 250 Kcmil-6 AWG Double Barrel Mechanical Lug |
| CBL1-101.08 | 1 | | 500MCM 4/C TYPE W CORD |
| CBL1-101.20 | 1 | UNV00012863 | 2 AWG 1/C TYPE W 2KV |
| GRND BAR KIT 1<br>GRND BAR KIT 2 | 2 | UNV00013942C | GROUND BAR KIT |
| XF1-101.11 | 1 | UNV00019745 | 3PH 480V-208Y/120V 300KVA N3R AL TRANSFORMER |

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143


TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1


| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 02-04-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 5 OF 5 | 105 |

| REV | DESCRIPTION | DATE |
|---|---|---|
| A | QUOTE UPDATE | 02/04/2026 |

# MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1


LARSON ELECTRONICS®

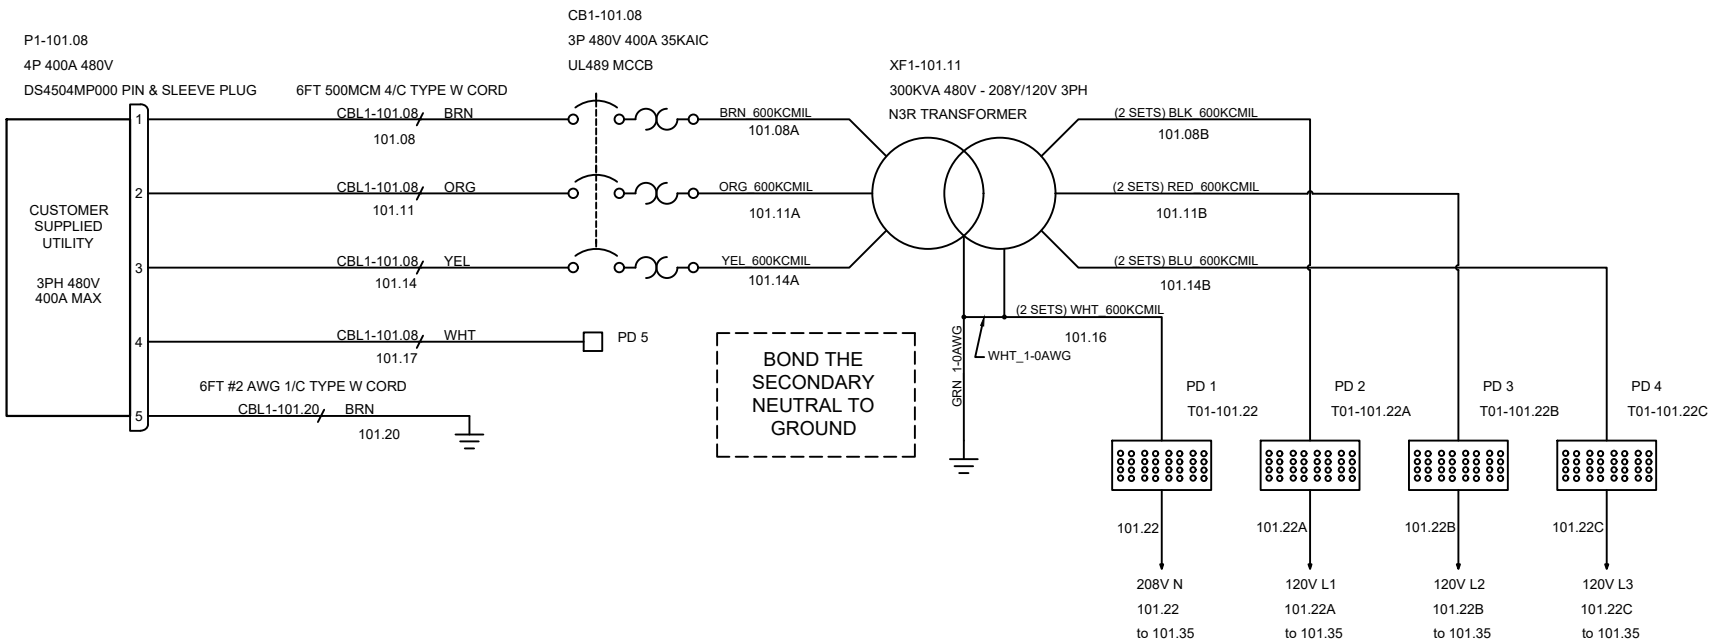

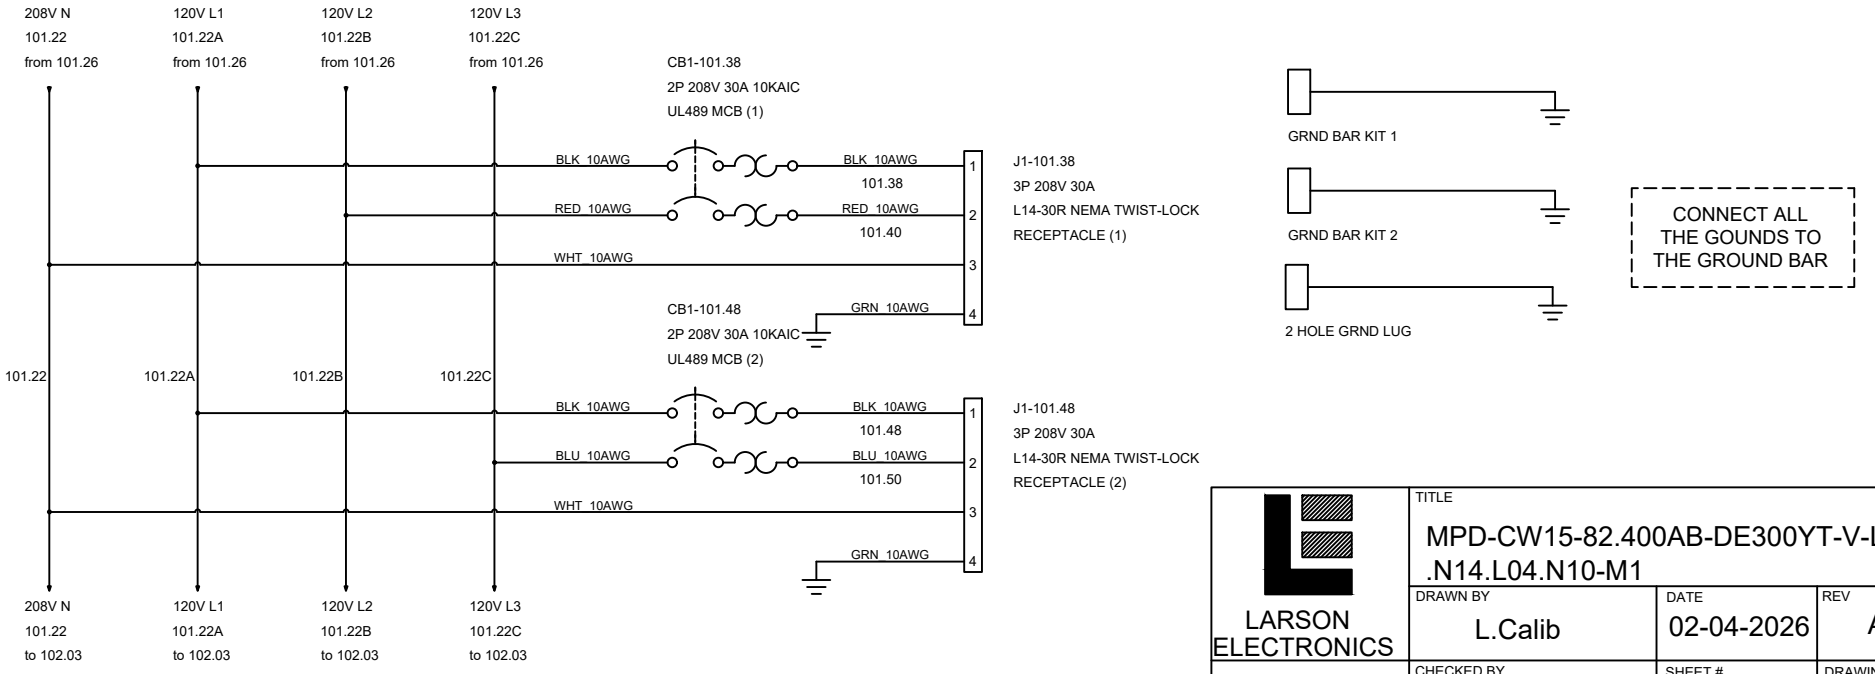
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

| | | | |
|---|---|---|---|
| TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 | | | |
| DRAWN BY: L.Calib | DATE: 02-04-2026 | REV: A | |
| CHECKED BY: | SHEET #: 1 OF 5 | DRAWING #: 101 | |

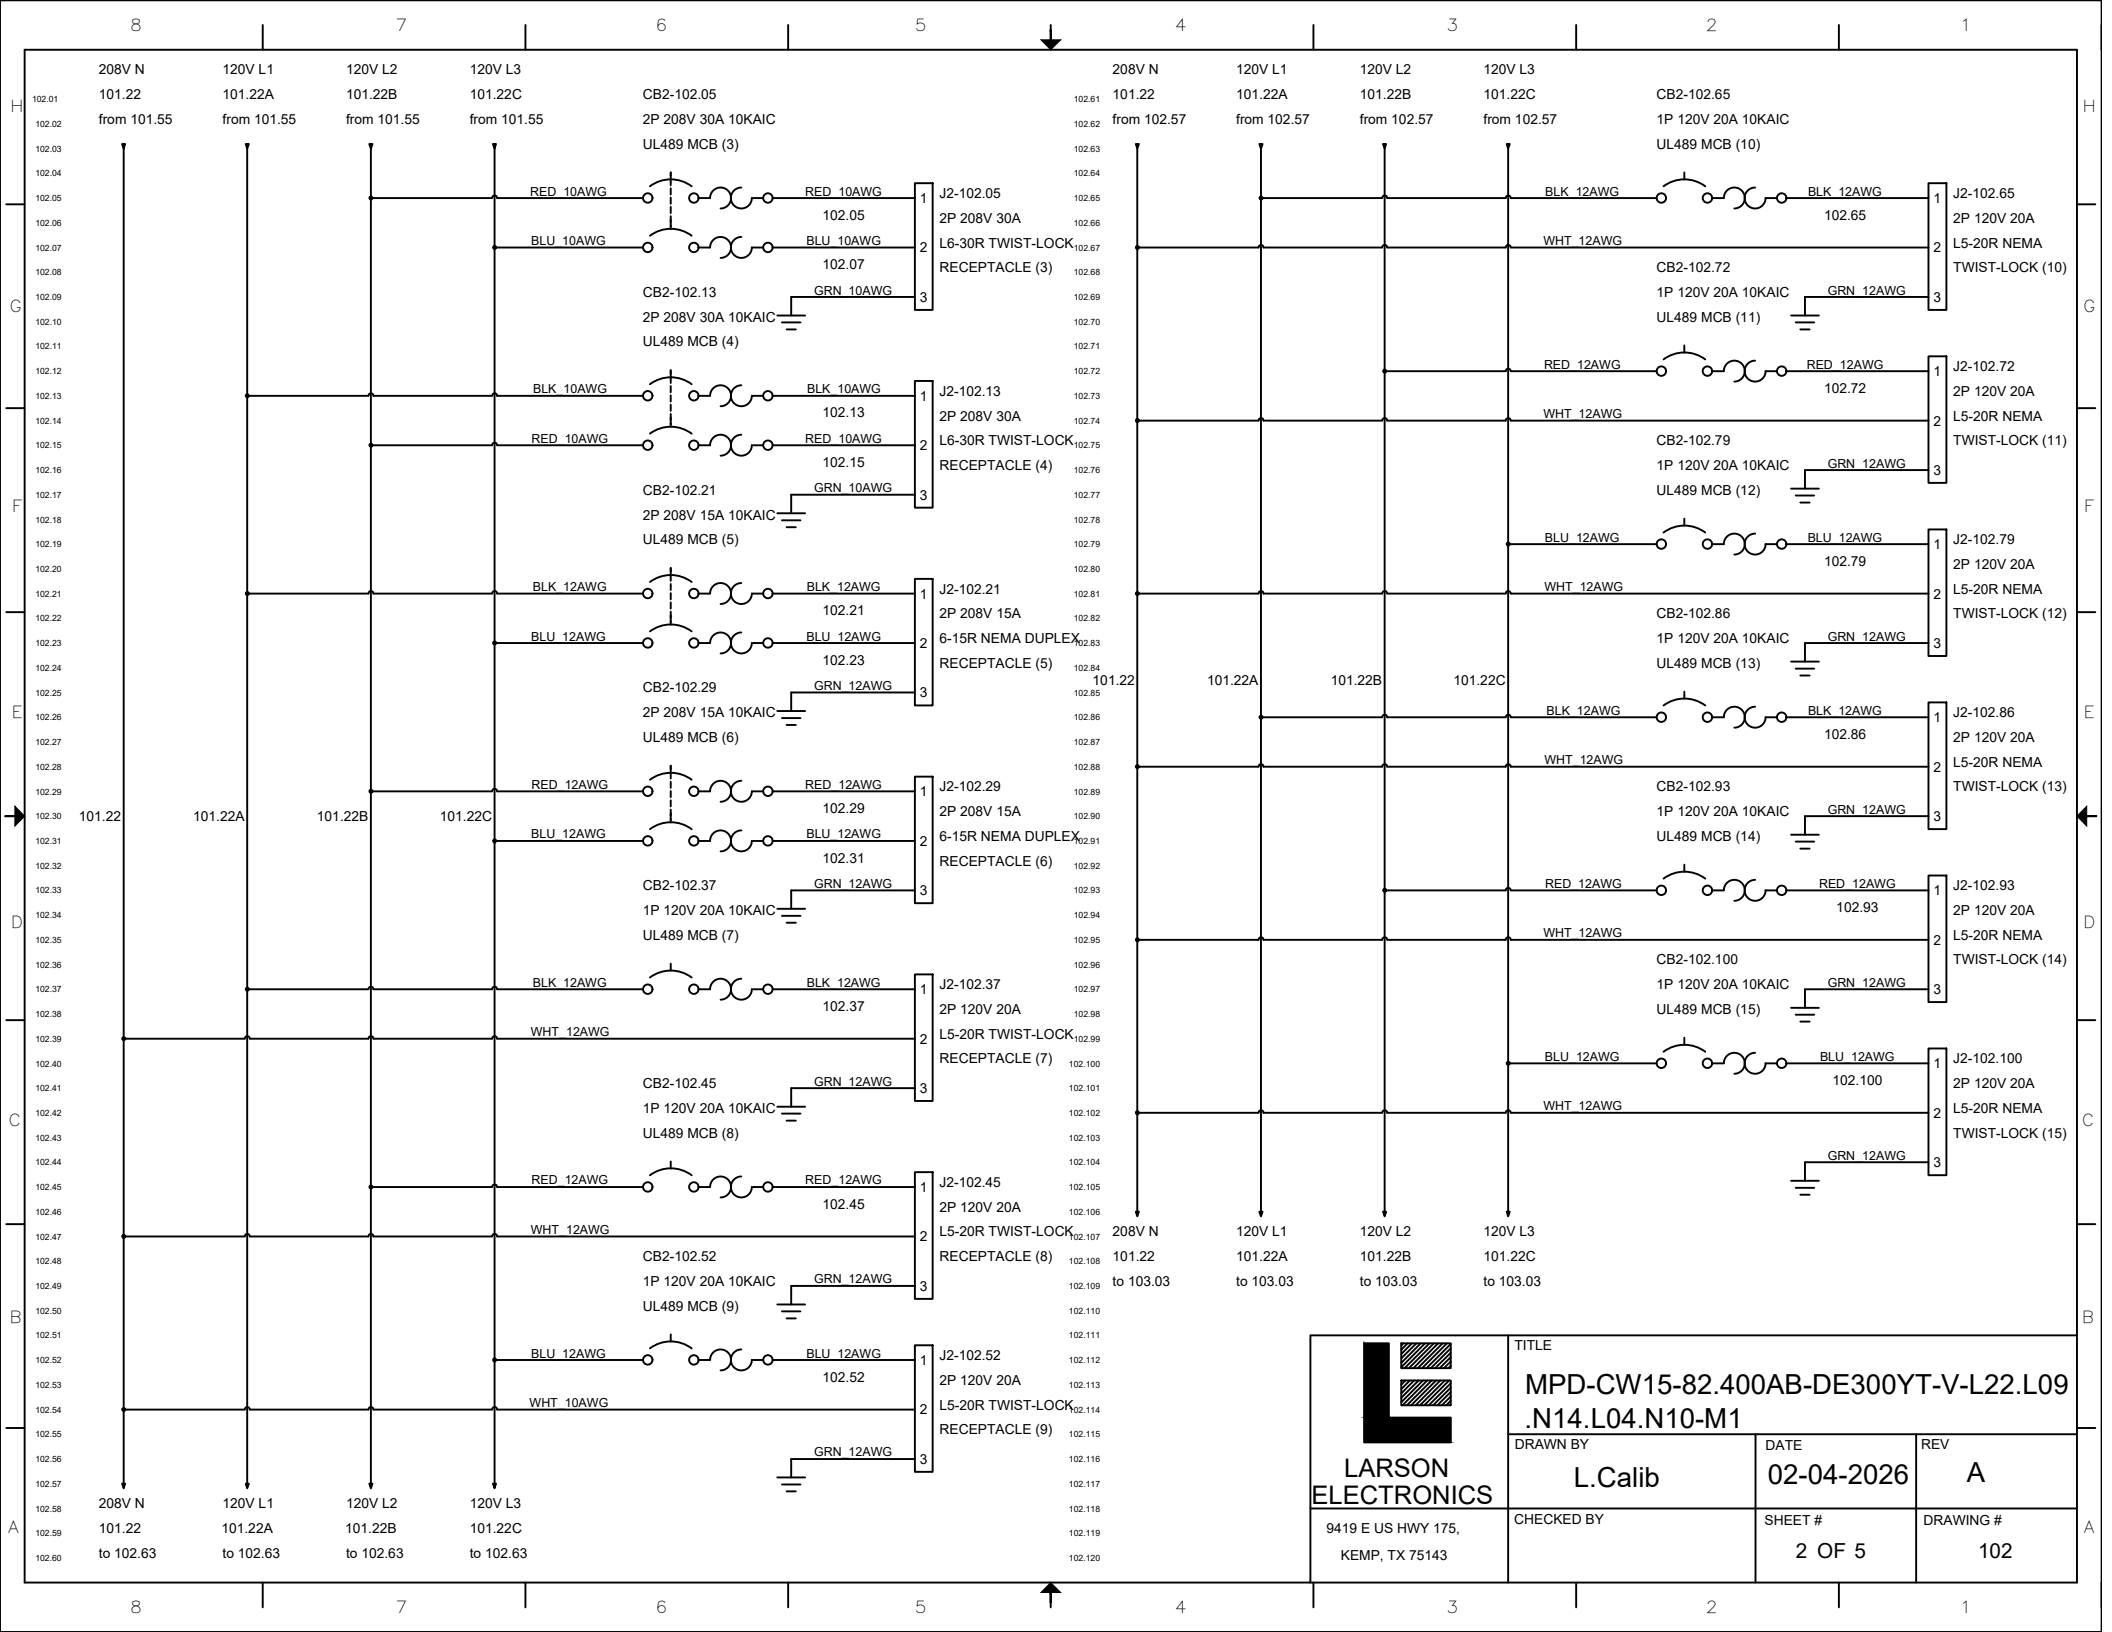




LARSON ELECTRONICS

9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 02-04-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 2 OF 5 | 102 |

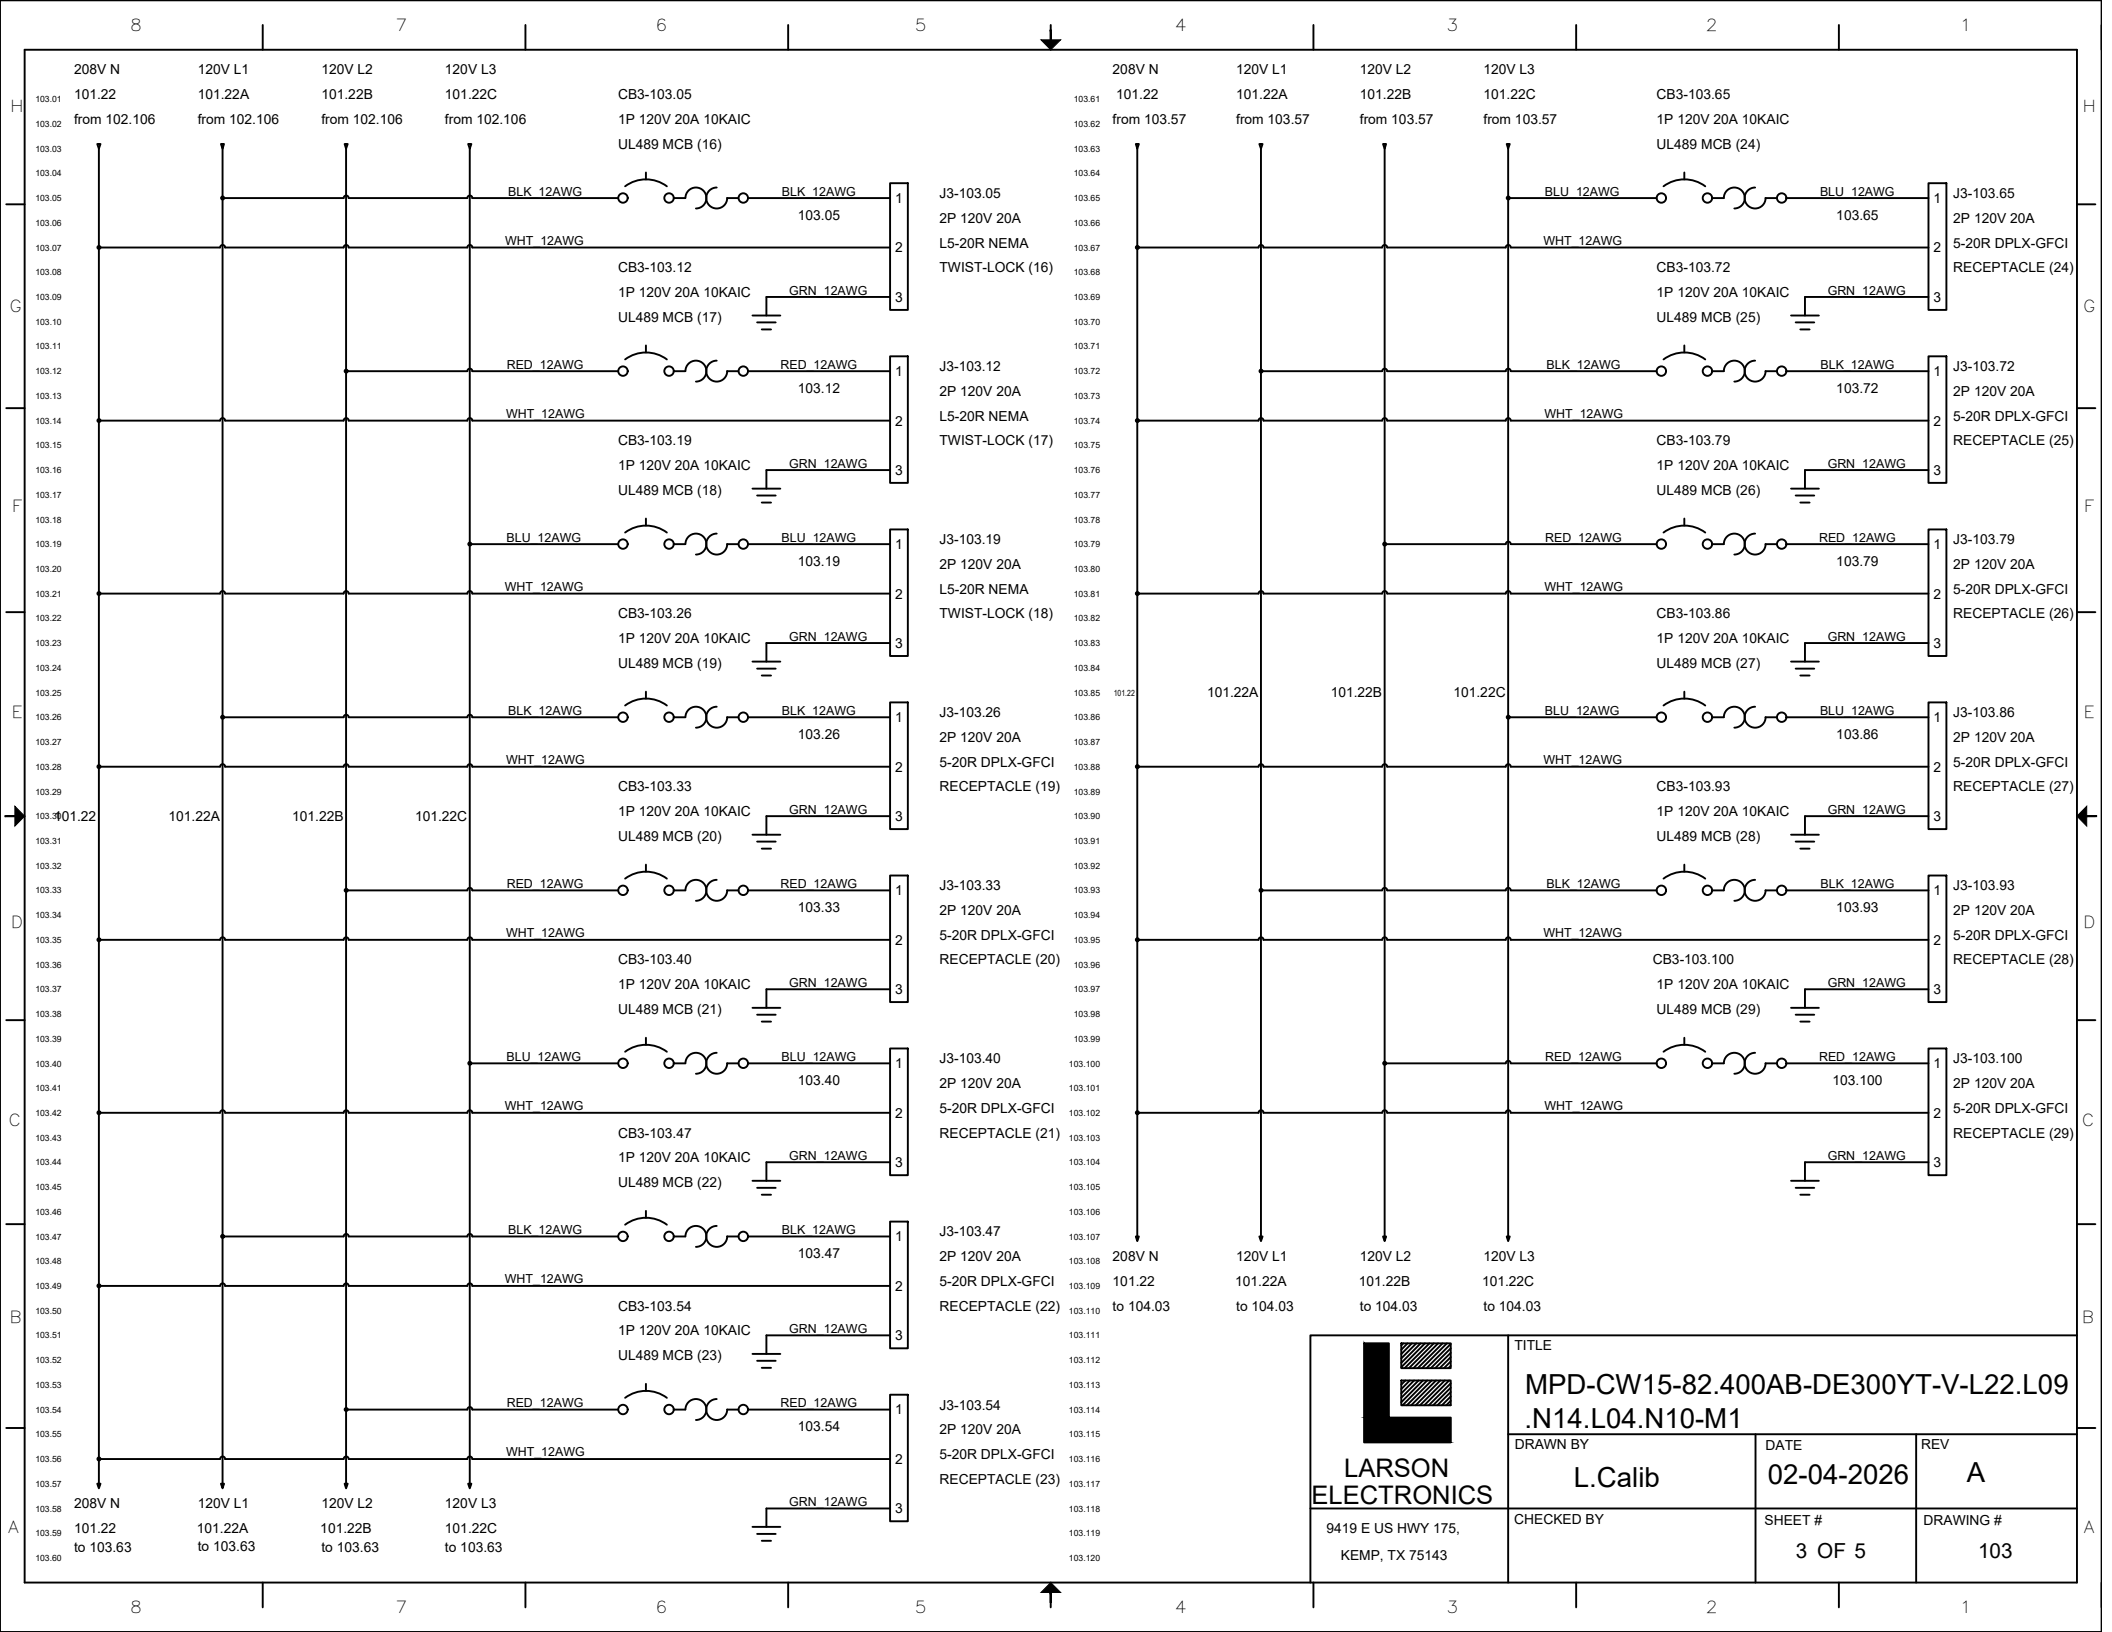
208V N
101.22
from 102.106
120V L1
101.22A
from 102.106
120V L2
101.22B
from 102.106
120V L3
101.22C
from 102.106
CB3-103.05
1P 120V 20A 10KAIC
UL489 MCB (16)
BLK 12AWG
BLK 12AWG
103.05
WHT 12AWG
J3-103.05
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (16)
CB3-103.12
1P 120V 20A 10KAIC
UL489 MCB (17)
GRN 12AWG
RED 12AWG
RED 12AWG
103.12
J3-103.12
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (17)
CB3-103.19
1P 120V 20A 10KAIC
UL489 MCB (18)
BLU 12AWG
BLU 12AWG
103.19
J3-103.19
2P 120V 20A
L5-20R NEMA
TWIST-LOCK (18)
CB3-103.26
1P 120V 20A 10KAIC
UL489 MCB (19)
103.26
J3-103.26
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (19)
CB3-103.33
1P 120V 20A 10KAIC
UL489 MCB (20)
101.22
101.22A
101.22B
101.22C
103.33
J3-103.33
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (20)
CB3-103.40
1P 120V 20A 10KAIC
UL489 MCB (21)
103.40
J3-103.40
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (21)
CB3-103.47
1P 120V 20A 10KAIC
UL489 MCB (22)
103.47
J3-103.47
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (22)
CB3-103.54
1P 120V 20A 10KAIC
UL489 MCB (23)
103.54
J3-103.54
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (23)
208V N
101.22
to 103.63
120V L1
101.22A
to 103.63
120V L2
101.22B
to 103.63
120V L3
101.22C
to 103.63
208V N
101.22
from 103.57
120V L1
101.22A
from 103.57
120V L2
101.22B
from 103.57
120V L3
101.22C
from 103.57
CB3-103.65
1P 120V 20A 10KAIC
UL489 MCB (24)
BLU 12AWG
BLU 12AWG
103.65
J3-103.65
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (24)
CB3-103.72
1P 120V 20A 10KAIC
UL489 MCB (25)
BLK 12AWG
BLK 12AWG
103.72
J3-103.72
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (25)
CB3-103.79
1P 120V 20A 10KAIC
UL489 MCB (26)
RED 12AWG
RED 12AWG
103.79
J3-103.79
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (26)
CB3-103.86
1P 120V 20A 10KAIC
UL489 MCB (27)
103.86
J3-103.86
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (27)
CB3-103.93
1P 120V 20A 10KAIC
UL489 MCB (28)
103.93
J3-103.93
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (28)
CB3-103.100
1P 120V 20A 10KAIC
UL489 MCB (29)
103.100
J3-103.100
2P 120V 20A
5-20R DPLX-GFCI
RECEPTACLE (29)
208V N
101.22
to 104.03
120V L1
101.22A
to 104.03
120V L2
101.22B
to 104.03
120V L3
101.22C
to 104.03
LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143
TITLE
MPD-CW15-82.400AB-DE300YT-V-L22.L09
.N14.L04.N10-M1
DRAWN BY
L.Calib
DATE
02-04-2026
REV
A
CHECKED BY
SHEET #
3 OF 5
DRAWING #
103

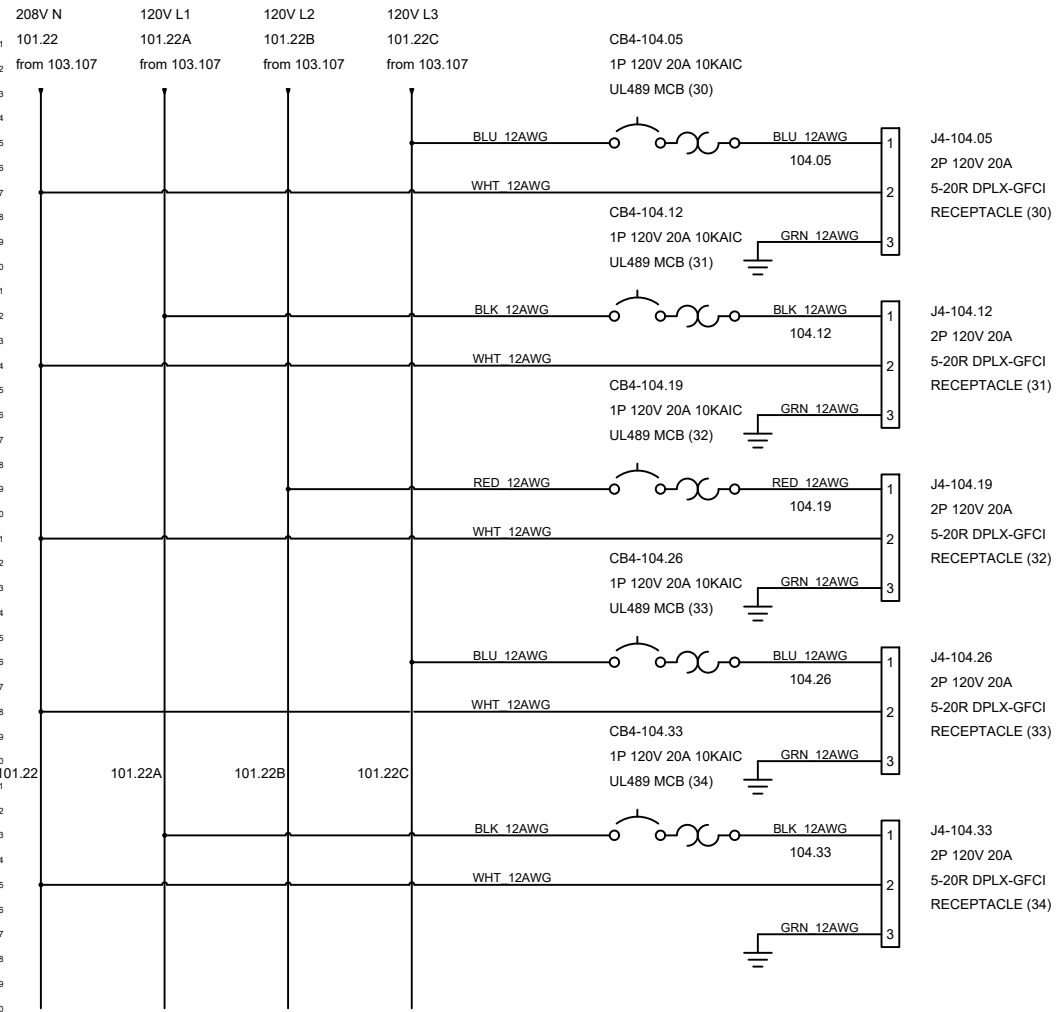


| | | | |
|---|---|---|---|
| LARSON ELECTRONICS<br>9419 E US HWY 175,<br>KEMP, TX 75143 | TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1 | | |
| | DRAWN BY: L.Calib | DATE: 02-04-2026 | REV: A |
| | CHECKED BY: | SHEET #: 4 OF 5 | DRAWING #: 104 |

| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| J2-102.05<br>J2-102.13 | 2 | UNV00016830 | L6-30R COVER AND RECEPTACLE |
| J2-102.21<br>J2-102.29 | 2 | UNV00012450 | 2P 240V 15A 6-15R LOCKING RECEPTACLE |
| 2 HOLE GRND LUG | 1 | UNV00007136 | 2 HOLE GROUND LUG |
| J2-102.100<br>J2-102.37<br>J2-102.45<br>J2-102.52<br>J2-102.65<br>J2-102.72<br>J2-102.79<br>J2-102.86<br>J2-102.93<br>J3-103.05<br>J3-103.12<br>J3-103.19 | 12 | UNV00005543 | 1P 120V 20A L5-20R LOCKING RECEPTACLE |
| J3-103.100<br>J3-103.26<br>J3-103.33<br>J3-103.40<br>J3-103.47<br>J3-103.54<br>J3-103.65<br>J3-103.72<br>J3-103.79<br>J3-103.86<br>J3-103.93<br>J4-104.05<br>J4-104.12<br>J4-104.19<br>J4-104.26<br>J4-104.33 | 16 | UNV00014533 | 5-20R 1P 20A 125V GFCI RECEPTACLE |
| J1-101.38<br>J1-101.48 | 2 | UNV00006737 | 2P 250V 30A L14-30R LOCKING RECEPTACLE |
| P1-101.08 | 1 | | R&S DS4504MP000 4P5W 400A Circuit Breaker Plug |
| CB2-102.100<br>CB2-102.37<br>CB2-102.45<br>CB2-102.52<br>CB2-102.65<br>CB2-102.72<br>CB2-102.79<br>CB2-102.86<br>CB2-102.93<br>CB3-103.05<br>CB3-103.100<br>CB3-103.12<br>CB3-103.19<br>CB3-103.26<br>CB3-103.33<br>CB3-103.40<br>CB3-103.47<br>CB3-103.54<br>CB3-103.65<br>CB3-103.72<br>CB3-103.79<br>CB3-103.86<br>CB3-103.93<br>CB4-104.05<br>CB4-104.12<br>CB4-104.19<br>CB4-104.26<br>CB4-104.33 | 28 | UNV00017491 | 1P 125V 20A 10KA UL489 DIN RAIL MOUNT BREAKER |

| TAGS | QTY | CATALOG | DESCRIPTION |
|---|---|---|---|
| CB1-101.38<br>CB1-101.48<br>CB2-102.05<br>CB2-102.13 | 4 | UNV00017628 | 2P 240V 30A UL489 CIRCUIT BREAKER |
| CB2-102.21<br>CB2-102.29 | 2 | | BK63HU 2P C15A 10kA 240VAC UL489 DIN RAIL |
| CB1-101.08 | 1 | UNV00015189 | 3P 480V 400A UL489 MOLDED CASE CIRCUIT BREAKER |
| T01-101.22<br>T01-101.22A<br>T01-101.22B<br>T01-101.22C | 4 | UNV00014768 | 22 HOLE 10IN BUS BAR |
| PD 5 | 1 | UNV00008889 | 250 Kcmil-6 AWG Double Barrel Mechanical Lug |
| CBL1-101.08 | 1 | | 500MCM 4/C TYPE W CORD |
| CBL1-101.20 | 1 | UNV00012863 | 2 AWG 1/C TYPE W 2KV |
| GRND BAR KIT 1<br>GRND BAR KIT 2 | 2 | UNV00013942C | GROUND BAR KIT |
| XF1-101.11 | 1 | UNV00019745 | 3PH 480V-208Y/120V 300KVA N3R AL TRANSFORMER |

LARSON ELECTRONICS
9419 E US HWY 175,
KEMP, TX 75143

TITLE: MPD-CW15-82.400AB-DE300YT-V-L22.L09.N14.L04.N10-M1

| DRAWN BY | DATE | REV |
|---|---|---|
| L.Calib | 02-04-2026 | A |
| CHECKED BY | SHEET # | DRAWING # |
| | 5 OF 5 | 105 |

Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664



# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the standard(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

**Evaluated Listings:**

**ETL:** UL 1640 - NEC / United States standards
**ETL:** CAN/CSA-C22.2 No. 14 – CEC / Canada standards

The MGL, MPD, MGS, WAL Series are certified to NEC and CEC standards for power distribution systems. These units are constructed using individual components certified to NEC and CEC standards, and are built to UL 1640 and CAN/CSA C22.2 No 14.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX
Date of issue: September 11, 2019

Signature: James Thomas

Name: James Thomas
Position: Operations Manager


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the statements(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

The MGL, MPD, MGS, WAL Series from Larson Electronics LLC utilize components certified to NEC and CEC standards. Larson Electronics LLC specifies wiring device standard designations (e.g. NEMA 5-20R, NEMA L6-30R, CS8265C) in the electrical diagrams and spec sheet of each product. Unless specified, the brands of components used, which may vary based on availability at the time of build, include but are not limited to: Hubbell, Leviton, Molex, Daniel Woodhead, Legrand, Eaton, Thomas & Betts, Russel Stroll, Meltric, Mennekes, ABB Group, Emerson, Appleton, Crouse Hinds, Killark, R.Stahl, or other certified equipment manufacturers.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

# TECHNICAL INFORMATION

**POWDURA® POLYESTER TGIC**
**POWDER COATING**

## PRODUCT DESCRIPTION

**PLR2-60002**
**RAL 5010 GENT BLUE**

**POWDURA® Polyester TGIC Powder Coatings** are recommended for a broad range of interior/exterior functional and decorative applications.

**Advantages:**

- Provides excellent overbake resistance
- Good chemical resistance
- Very good outdoor exposure qualities
- Wide range of special effects available
- Available in a broad range of colors

Many applications, including:
Steel Furniture
Refrigeration
Electronic Cabinetry
Scaffolding
Electrical Equipment
Instrument Housings

Appliances
Sporting Goods

**Storage:** Powdura® Powder Coatings should be kept in a dry and cool area at temperatures below 80°F (27°C). When not in use, store powder in sealed containers: fine powders are hygroscopic.

**Substrate Preparation:** Substrate should be free of grease, oil, dirt, fingerprints, drawing compounds, any contamination, and surface preparation treatments to ensure optimum adhesion and coating performance properties. The use of a chemical conversion coating prior to the application of a powder coating is strongly recommended.

**Testing:** Due to the wide variety of substrates, surface preparation methods, application methods, and environments, the customer should test the complete system for adhesion, compatibility and performance prior to full-scale application.

## CAUTIONS

Thoroughly review product SDS prior to using this product. Please consult your local sales representative or your local Sherwin-Williams facility for additional information.

**Special Advisory:** River texture type finishes are unique finishes that may vary with application, film thickness and cure conditions. Light colors and very dark colors may occasionally show colored specks that appear as contamination. This is the nature of this type of finish and cannot be predicted or controlled. Thorough cleaning is required when switching to a normal smooth powder coating to prevent craters in the smooth finish.

## APPLICATION

| | |
|---|---|
| **Cure Schedule:** | 10 MIN @ 400F |
| **Film Thickness Range**(mils): | 3.0-5.0 |

## ATTRIBUTES

| | |
|---|---|
| **Specific Gravity**(g/ml): | 1.72 |
| **Coverage at 1.0 Mil**($ft^2$/lb): | 112.4 |
| **60° Gloss:** (ASTM D-523) | 15-30 |
| **Adhesion:** (ASTM D-3359) | 5B |
| **Flexibility:** (ASTM D-522) | Pass 1/8" |
| **Pencil Hardness:** (ASTM D-3363) | H-2H |
| **Impact Resistance**(in.lb): (ASTM D-2794) | Dir 100 in-lbs<br>Rev 100 in-lbs |

**Note:** Performance measured using 24-gauge Bonderite® 1000 test panels.

| | |
|---|---|
| **Shelf Life:** | 12 Months |

Sherwin-Williams recommends that all material be used in FIFO order ( first in - first out). Materials that exceed the recommended shelf life should be tested prior to use.

**Note:**
Product Data Sheets are periodically updated to reflect new information relating to the product. It is important that the customer obtain the most recent Product Data Sheet for the product being used. The information, rating and opinions stated above pertain to the material currently offered and represent the results of tests believed to be reliable. However, due to variations in customer handling and methods of application, which are not known, or under our control, The Sherwin-Williams Company cannot make any warranties or guaranties as to the end results.

08 00

Grove City Product Mod

24-Mar-2020

# Material Safety Data Sheet

To Whom It May Concern,

Larson Electronics LLC MGL, MPD, MGS, WAL Series industrial line of portable power distribution systems are considered "ARTICLES" under 29 CFR 1910-1200, the OSHA Hazard Communication Standard, and do not require a Material Safety Data Sheet (MSDS).

Articles are specifically exempt from the regulations of this standard. OSHA defines an article as follows:

1910-1200(c) – Article means a manufactured item other than a fluid or particle:

i. Which is formed to a specific shape or design during manufacture;
ii. Which has end use function(s) dependent in whole or in part upon its shape or design during end use; and
iii. Which under normal conditions does not release more than very small quantities.

Regards,

Ray Smith
Larson Electronics, LLC.



LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

<- Back

## Product Description

| | |
|---|---|
| **Title:** | STAGE & STUDIO PORTABLE WIRING COMPARTMENTS |
| **Company:** | LARSON ELECTRONICS LLC - Kemp, TX USA |
| **Product Information:** | Power Distribution System, Model Nos. MGL, MPD, MGS, WAL series; Followed by AAK-PBB.FFF-SCC.GGG-EEXCCC.DDD; Where AA = 2,3,5,7,9,15,20,25,30,45,50,75; BB = 1P, 3P; FFF = 480,240,208,120; CC = 1P,3P; GGG = 480,240,208,120; EE = # of outlets; CCC = voltage; DDD = outlet amperage. |
| **Evaluated to the following:** | A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Stage & Studio Portable Wiring Compartments (UL-1640) and are identified with the ETL Listed Mark. |

<- Back

**Contact Us**

Americas+1-888-347-5478
(or +1-312-906-7801)
Email
dirlist@intertek.com

Intertek Home
Product Directories

**Inspector Center**

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. Learn more...

**News**

Intertek Unveils New Design for Product Safety and Quality Certification Marks. Learn more...

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

intertek
Total Quality. Assured.




<- Back

## Product Description

| | |
|---|---|
| **Title:** | INDUSTRIAL CONTROL EQUIPMENT |
| **Company:** | LARSON ELECTRONICS LLC - Kemp, TX USA |
| **Product Information:** | Industrial Control Panels For General Use.<br><br>Power Distribution System, Model Nos. MGL, MPD, MGS series; Followed by AAK-PBB.FFF-SCC.GGG-EEXCCC.DDD; Where AA = 2,3,5,7,9,15,20,25,30,45,50,75; BB = 1P, 3P; FFF = 480,240,208,120; CC = 1P,3P; GGG = 480,240,208,120; EE = # of outlets; CCC = voltage; DDD = outlet amperage. |
| **Evaluated to the following:** | A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Industrial Control Equipment (CAN/CSA-C22.2 No. 14) and are identified with the cETL Listed Mark. |

<- Back

### Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478 (or +1-847-660-7407)
Email
etldirectory@intertek.com

Intertek Home
Product Directories
DLP on mobile devices

### Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. Learn more...

### News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. Learn more...

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the standard(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

The MGL, MPD, MGS, WAL series complies with the below standards set forth by the listed Association's requirements. Purchased and manufactured components are evaluated to Larson Electronics LLC Quality Control Management system per ISO 9001:2015. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

**Evaluated Standards:**

**AISC:** Structural steel skid design
**NFPA 70:** National Electrical Code
**ASTM A36:** Standard Specification for Carbon Structural Steel
**ASTM A123:** Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
**ASTM A153:** Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
**ASTM A489:** Standard Specification for Carbon Steel Lifting Eyes
**ASTM A502:** Standard Specification for Rivets, Steel, Structural
**ASTM A563:** Standard Specification for Carbon and Alloy Steel Nuts
**ASTM A500:** Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
**ASTM B172:** Standard Specification for Rope-Lay-Stranded Copper Conductors Having Bunch-Stranded Members, for Electrical Conductors
**ASTM D7803:** Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Powder Coating
**SAE J429:** Mechanical and Material Requirements for Externally Threaded Fasteners
**AWS D1.1:** Structural Welding – Steel
**ICEA S-58-679:** Standard for Control, Instrumentation and Thermocouple Extension Conductor Identification
**ICEA S-75-381:** Portable and Power Feeder Cables for Use in Mines and Similar Applications
**NEMA OFP 1-2017:** Protection of Receptacle Outlets in Wet Locations According to the National Electrical Code


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

**NEMA PB 1-2011:** Panelboards
**NEMA ST 20-2014:** Dry Type Transformers for General Applications
**NEMA WD 1-1999 (R2015):** General Color Requirements for Wiring Devices
**ANSI C80.1-2015:** American National Standard for Electric Rigid Steel Conduit
**ANSI C119.4-2016:** American National Standard for Electric Connectors
**ANSI Z535.4-2011:** American National Standard for Product Safety Signs and Labels
**ANSI/IEC 60529-2004 (R2011):** American National Standard for Degrees of Protection Provided by Enclosures (IP Code)

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the standard(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

**Evaluated Listings:**

**CE:** DIRECTIVE 2014/35/EU - LOW VOLTAGE DIRECTIVE
**CE:** DIRECTIVE 2014/30/EU - EMC DIRECTIVE
**CE:** Regulation (EC) No 1907/2006 - REACH REGULATION
**CE:** DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

The MGL, MPD, MGS, WAL series complies with the essential protection requirements of the European Parliament of the Council Directive for Low Voltage Directive, EMC Directive, REACH Regulation, and RoHS Directive. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the standard(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

**Evaluated Listings:**

**CE:** Regulation (EC) No 1907/2006 - REACH REGULATION
**CE:** DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

This is to certify that products offered by Larson Electronics LLC comply with the Reduction of Hazardous Substances (RoHS) directives. Directive 2002/95/EC became effective on 1 July 2006. It restricts the use of six substances in the manufacture of electrical and electronic equipment. This directive was revised in June 2011 and is now referred to as directive 2011/65/EU. Directive 2015/863/EU amending Annex II to Directive 2011/65/EU announced plans to add four substances from 22 July 2019.

We hereby certify that the equipment specified above conforms to the Directive(s) by containing less of the restricted substances than the stated limits.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager



LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

# Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

**Declare the following equipment conforms to the standard(s) as listed:**

Model: MGL, MPD, MGS, WAL Series
Description: Power Distribution Systems

**Evaluated Listings:**

**CE:** Regulation (EC) No 1907/2006 - REACH REGULATION

This letter establishes the opinion of Larson Electronics LLC regarding the status, under the current European Union (“EU”) Regulations on Registration, Evaluation, Authorization, and Restriction of Chemical Substances (“REACH”).

REACH does not apply to manufactured products which are referred to as “completed articles”. Substances (chemicals) are subject to REACH registration, NOT products.

In addition, Articles are exempt from the REACH requirements if (a) the Article does not contain a substance of very high concern or candidate substance in an amount exceeding 0.1% weight by weight, and (b) if substances present in the Article in excess of 1 ton per year per importer are not expected nor intended to be released.

Based on communication with our raw material suppliers, we conclude that to the best of our knowledge our products requiring REACH compliance do not contain any of the currently listed SVHC in concentrations of 0.1% or above.

Accordingly, we foresee no registration or pre-registration requirement for the products we supply.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: James Thomas

Name: James Thomas
Position: Operations Manager


LARSON ELECTRONICS LLC • 9419 E US HWY 175 • KEMP, TX 75143
p: 1-800-369-6671 • intl: 903-498-3363 • f: 903-498-3364 • sales@larsonelectronics.com

Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664

# Frequently Asked Questions (FAQ)

There are no Faqs