

EPSW-20A

Explosion Proof Switch

Product ID: 46902



Image: EPSW-20A

Larson Electronics LLC manufactures a wide variety of products, including custom built to spec designs. The pictures displayed for this unit are a general representation of form factor for the product line and may not accurately represent this exact configuration in every detail due to custom builds and changes between similar products in our standard catalog. The specifics for this configuration are listed in the specification table and supporting documentation (CAD files, Dimensional Drawing, Name Plate Diagram, Wiring Diagram, etc.). This means that specific details (receptacles, plugs, wires, connections, mounting brackets, external finishes, etc.) may not be accurately represented in images vs specifications. Please review specifications and do not order based solely on images.

EPSW-20A Explosion Proof Tumbler Switch

Switch Voltage Rating: 120-277 VAC & 12-24 VDC

Switch Current Rating: 20 Amps- 1 HP @120 Vac & 2 HP @ 240 Vac & 10 Amps @ 12-24 VDC

Grounding: Single Internal Housing Ground Screw

Configuration: Feed Through, Front Switch

Hub Qty: (2) Feed Through or (1) Dead End

Hub Size:) Feed Through or (1) Dead End

Unit Materials: Box/Receptacle- Malleable Aluminum, Sealing Chamber-Aluminum

Finish: Triple-coat—Zinc Electroplate, Chromate, Epoxy powder coat

Insulation: Integral Bushings in Conductor Openings

Mounting: External Mounting Lugs on Body

Unit Dimensions: 3.00"-W X 4.69"-D X 6.13 "-L

Switch Type: Single Pole

Ambient Operating Temp: -20°C to +50°C

Dimensions: 6.49" x 3.13" x 4.04"

Certifications - Compliance

Class 1 Division 1 & 2 Groups C, D

Class 2 Division 1 & 2 Groups E, F, G

Class 3

NEMA 7 Groups C & D

NEMA 9 Groups E, F, G

Special Orders - Special Requirements

Contact us for special requirements

Toll Free: 1-800-369-6671

Fax: 1-903-765-7664

E-mail: sales@larsonelectronics.com

The Larson Electronics EPSW-20A Explosion Proof Feed Through Tumbler Switch is UL Listed Class 1 Division 1 & 2 and Class 2 Division 1 & 2 and provides a safe and secure method for operators to interrupt power before connecting and disconnecting portable or stationary electrical devices and equipment in hazardous locations.


This explosion proof tumbler switch is ideal for operators seeking a high quality explosion proof switch rated for use in hazardous areas designated Class 1 Division 1 and Class 2

Division 1. This explosion proof switch is rated at 20 amps-120-277 Vac and 1 HP at 120 Vac and 2 HP at 240 Vac & rated at 10 amps 12-24 VDC. The entire unit is constructed of malleable aluminum and contains an internal sealing chamber constructed of copper free aluminum. This unit is easily wall mounted via integral mounting tabs at two corners of the housing and provides two 1/2" hub openings located on the top and the bottom of the housing for running electrical conductors in a feed through configuration. A bushing seal at each conductor opening prevents damage to wiring insulation.

This unit is rated to handle electrical loads of 120-277 VAC up to 20 amps and is suitable for use in environments where combustible dusts and particulates may be present.



[Click Photo to Enlarge](#)

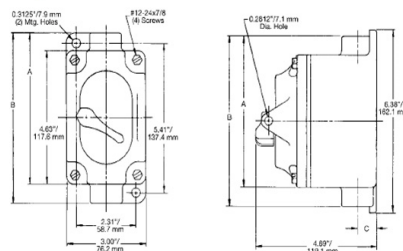

[Click Photo to Enlarge](#)

The EPSW-20A explosion proof switch cover and housing box is constructed of malleable aluminum with all arcing devices contained within an explosion proof labyrinth switch for the highest protection possible. This design does not require external sealing fittings. Each 1/2" hub opening is fitted with an integral bushing to prevent fraying or damage to insulation. Two external mounting lugs provide simple and secure mounting of the unit to walls and flat surfaces. The unit box, switch, and face plate are all included with the product.


1/2" NPT tapped conduit openings are provided on the top and bottom of the unit in feed through versions while dead end versions have a single conduit hub, providing easy and secure connection to main power line supplies.


Suggested Applications: Manufacturing, Industrial, Warehouse, Lighting, Lighting, Wet areas or Locations Where Combustible Dust is Present.

REV	DESCRIPTION	DATE
A	PRODUCTION RELEASE	10/25/2021

EPSW-20A-XX-XX-1P



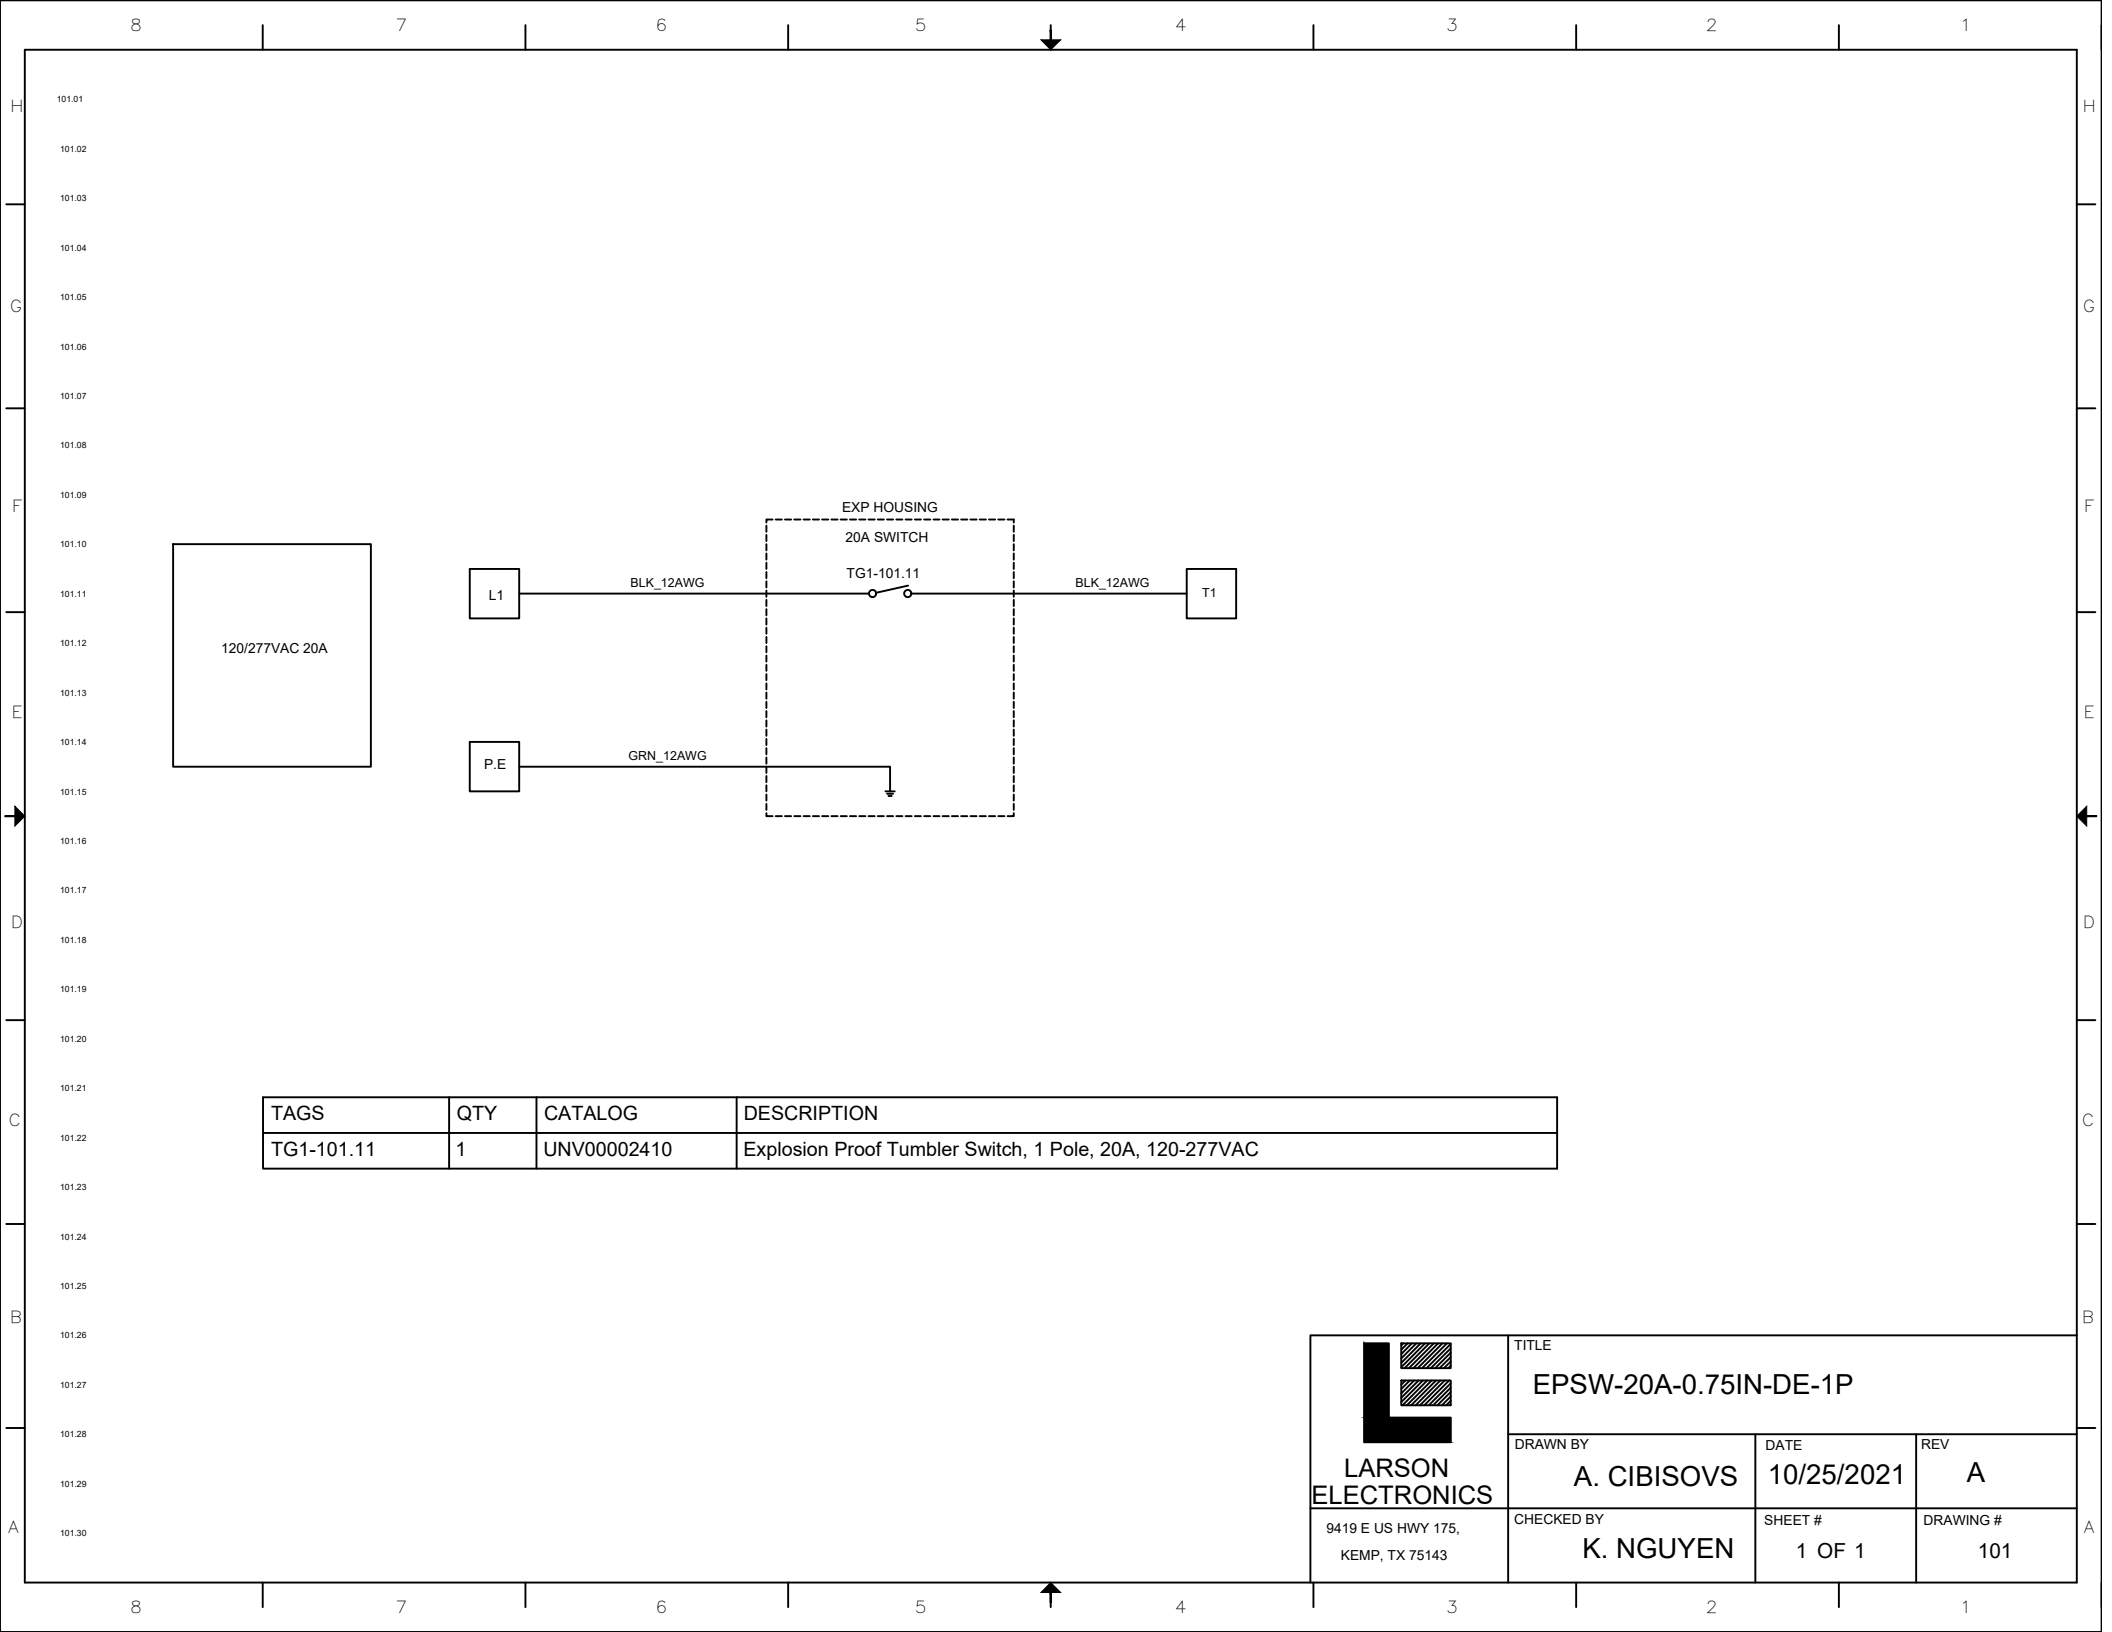

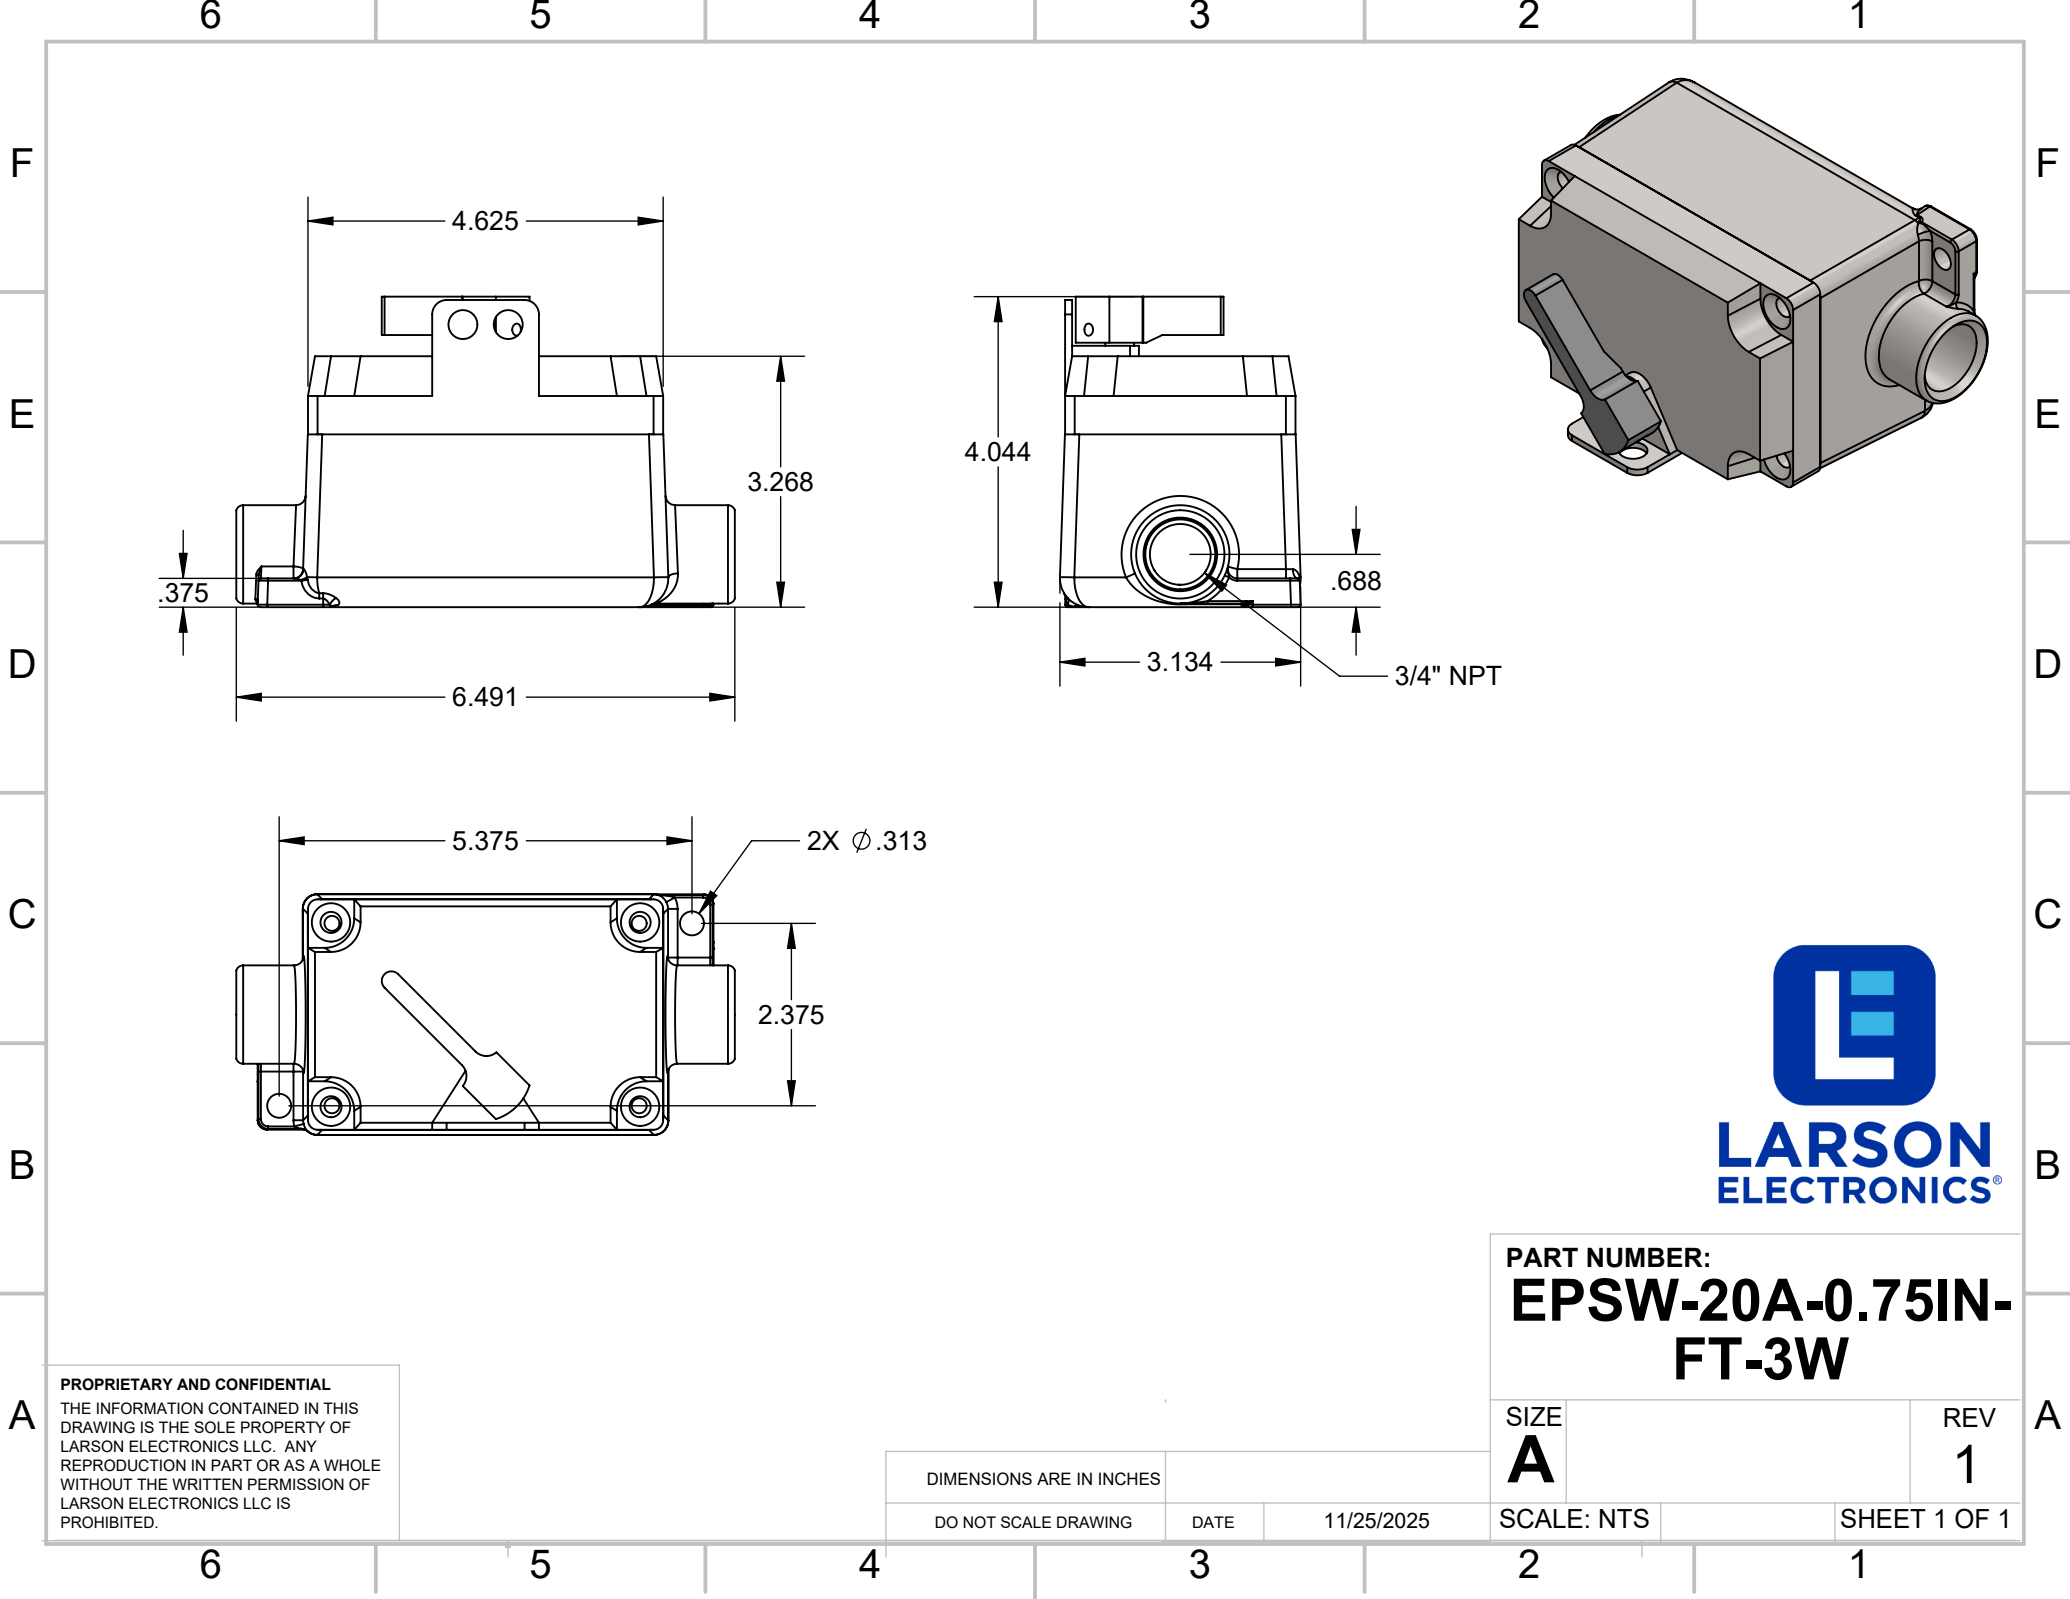





Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671



www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.765.7664

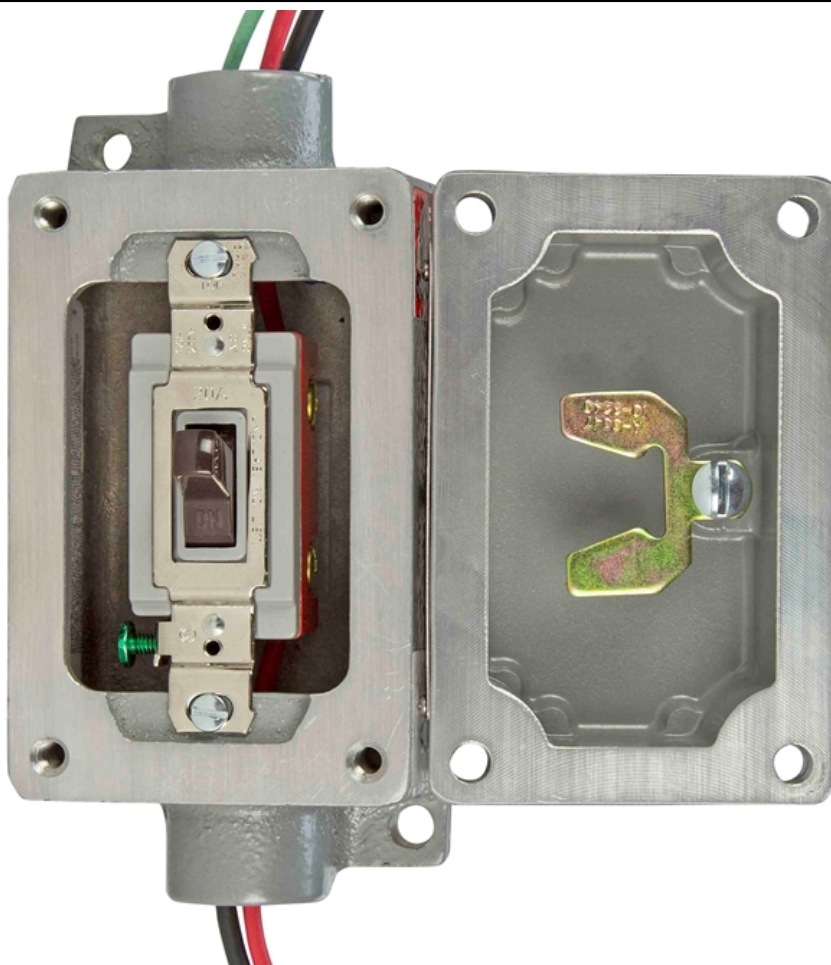



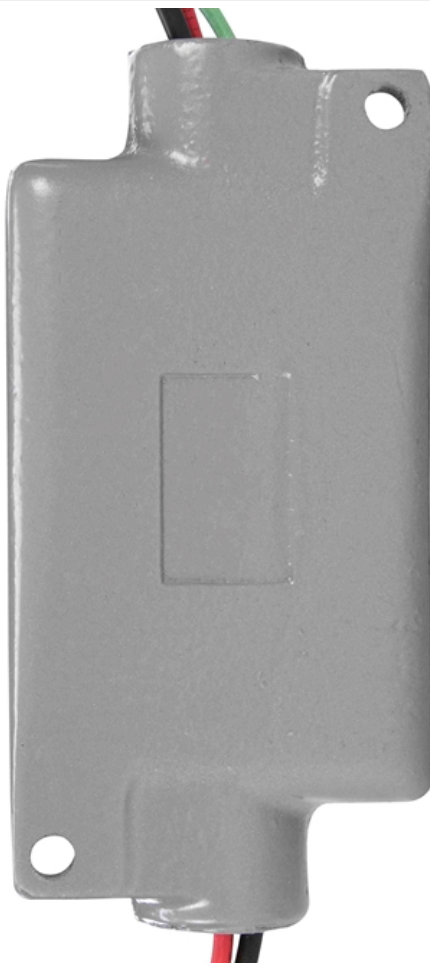



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: EPSW-20A Series
Description: Explosion Proof Switch

Evaluated Listings:

UL: E10501; E150827 - NEC / United States standards

CSA: 011712_C_000 - CEC / Canada standards

ETL: Modifications to enclosure under UL 1203, UL 508A – NEC / United States standards

ETL: Modifications to enclosure under CSA C22.2 No. 14, No. 30, No. 25– CEC / Canadian standards

The EPSW-20A Series is certified to NEC, CEC, ATEX, and IEC Ex standards for hazardous locations for:

- NEC: Class I, Divisions 1&2, Groups C, D; Class II, Divisions 1&2, Groups E, F, G
- NEC: Class I, Zones 1 & 2, Groups IIB, IIA
- CEC: Class I, Divisions 1&2, Groups C, D; Class II, Divisions 1&2, Groups E, F, G
- CEC: Class I, Zones 1 & 2, Groups IIB, IIA

The EPSW-20A Series is comprised of a Killark XS Series switch cover and Killark SWB Series device box. This device enclosure may be modified with custom hub locations and external or internal mounting accessories, custom mounting of electronics, wire connections. This assembly is built to NEC and CEC standards for hazardous locations.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: *James Thomas*

Name: James Thomas
Position: Operations Manager

[<- Back](#)

Product Description

Title: INDUSTRIAL CONTROL PANELS
Company: LARSON ELECTRONICS LLC - Kemp, TX USA
Product Information: Industrial Control Panels For General Use.
Evaluated to the following: A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Industrial Control Panels (UL-508A) and are identified with the ETL Listed Mark.

[<- Back](#)

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478
(or +1-847-660-7407)
Email
etldirectory@intertek.com

[Intertek Home](#)
[Product Directories](#)
[DLP on mobile devices](#)

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. [Learn more...](#)

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. [Learn more...](#)

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

[<- Back](#)

Product Description

Title: EXPLOSION-PROOF & DUST IGNITION-PROOF ELECTRICAL EQUIPMENT FOR USE IN HAZARDOUS (CLASSIFIED) LOCATIONS

Company: LARSON ELECTRONICS LLC - Kemp, TX USA

Product Information: Explosion-proof or dust-ignition-proof Industrial Control Panels for use in Hazardous (Classified) Locations, Model Nos. Custom Industrial Control Panels

Evaluated to the following: A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Explosion-Proof and Dust Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations (UL-1203) and are identified with the ETL Listed Mark.

[<- Back](#)

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478
(or +1-847-660-7407)
Email
etldirectory@intertek.com

[Intertek Home](#)
[Product Directories](#)
[DLP on mobile devices](#)

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. [Learn more...](#)

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. [Learn more...](#)

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

[<- Back](#)

Product Description

Title: INDUSTRIAL CONTROL EQUIPMENT
Company: LARSON ELECTRONICS LLC - Kemp, TX USA
Product Information: Industrial Control Panels For General Use.
Industrial Control Panels Relating to Hazardous (Classified) Locations, Custom Industrial Control Panels.

Power Distribution System, Model Nos. MGL, MPD, MGS series;
Followed by AAK-PBB.FFF-SCC.GGG-EEXCCC.DDD; Where AA = 2,3,5,7,9,15,20,25,30,45,50,75; BB = 1P, 3P; FFF = 480,240,208,120; CC = 1P,3P; GGG = 480,240,208,120; EE = # of outlets; CCC = voltage; DDD = outlet amperage.

Evaluated to the following: A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Industrial Control Equipment (CAN/CSA-C22.2 No. 14) and are identified with the cETL Listed Mark.

[<- Back](#)

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478
(or +1-847-660-7407)
Email
etldirectory@intertek.com

[Intertek Home](#)
[Product Directories](#)
[DLP on mobile devices](#)

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. [Learn more...](#)

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. [Learn more...](#)

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

[<- Back](#)

Product Description

Title: ENCLOSURES
Company: LARSON ELECTRONICS LLC - Kemp, TX USA
Product Information: Explosion-proof or dust-ignition-proof Industrial Control Panels for use in Hazardous (Classified) Locations, Model Nos. Custom Industrial Control Panels

Luminaires, Model Nos. EPL-48-2L-LED-SFC, EPL-24-2L-LED-SFC. for use in Hazardous Locations: Class I, Div. 1, Groups C and D T5 or T6 -20°C < Tamb < 40°C Class II, Div. 1., Groups E, F, and G; Class III Div.1 T3B -20°C < Tamb < 40°C

Evaluated to the following: A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Enclosures for use in Class II, Groups E, F, G Hazardous Locations (CAN/CSA-C22.2 No. 25) and are identified with the cETL Listed Mark.

[<- Back](#)

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478
(or +1-847-660-7407)
Email
etldirectory@intertek.com

[Intertek Home](#)
[Product Directories](#)
[DLP on mobile devices](#)

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. [Learn more...](#)

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. [Learn more...](#)

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.

[<- Back](#)

Product Description

Title: EXPLOSION-PROOF ENCLOSURES FOR USE IN CLASS I HAZARDOUS LOCATIONS

Company: LARSON ELECTRONICS LLC - Kemp, TX USA

Product Information: Explosion-proof or dust-ignition-proof Industrial Control Panels for use in Hazardous (Classified) Locations, Model Nos. Custom Industrial Control Panels

Evaluated to the following: A representative sample of the listed devices have been tested, investigated and found to comply with the requirements of the Standard(s) for Explosion-Proof Enclosures for Use in Class I Hazardous Locations (CAN/CSA-C22.2 No. 30) and are identified with the cETL Listed Mark.

[<- Back](#)

Contact Us

ETL listed products that are in doubt or for products that do not appear in the directory, please request a verification of certification.
Americas+1-888-347-5478
(or +1-847-660-7407)
Email
etldirectory@intertek.com

[Intertek Home](#)
[Product Directories](#)
[DLP on mobile devices](#)

Inspector Center

Get up-to-date information on everything from our Accreditations to our Certifications and Marks. [Learn more...](#)

News

Intertek Unveils New Design for Product Safety and Quality Certification Marks. [Learn more...](#)

© 2010 Intertek All Rights Reserved.
All other product or service names are the property of their respective owners.



Material Safety Data Sheet

To Whom It May Concern,

The Larson Electronics LLC EPSW industrial line of explosion proof switches and controls for hazardous locations are considered “ARTICLES” under 29 CFR 1910-1200, the OSHA Hazard Communication Standard, and do not require a Material Safety Data Sheet (MSDS). This document does not expire.

Articles are specifically exempt from the regulations of this standard. OSHA defines an article as follows:

1910-1200(c) – Article means a manufactured item other than a fluid or particle:

- i. Which is formed to a specific shape or design during manufacture;
- ii. Which has end use function(s) dependent in whole or in part upon its shape or design during end use; and
- iii. Which under normal conditions does not release more than very small quantities.

The “hazardous location” and “explosion proof” are terminology for the environment where these products will be installed. This is not to be confused with “hazardous materials;” this product does not contain any hazardous materials.

Regards,

Ray Smith
Larson Electronics, LLC.

CERTIFICATE OF COMPLIANCE

Certificate Number 20180111-E10501
Report Reference E10501-19660802
Issue Date 2018-JANUARY-11

Issued to: KILLARK, DIV OF HUBBELL INC (DELAWARE)
3940 MARTIN LUTHER KING DR
ST LOUIS, MO 63113 USA

**This is to certify that
representative samples of** Snap Switches for Use in Hazardous Locations
(See Addendum Page.)

Have been investigated by UL in accordance with the
Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 1203, Explosion-Proof and Dust-Ignition-Proof Electrical
Equipment for Use in Hazardous (Classified) Locations.

Additional Information: See the UL Online Certifications Directory at
www.ul.com/database for additional information

Only those products bearing the UL Certification Mark should be considered as being covered by UL's
Certification and Follow-Up Service.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please
contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



CERTIFICATE OF COMPLIANCE


Certificate Number 20180111-E10501
Report Reference E10501-19660802
Issue Date 2018-JANUARY-11

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Addendum –

USL - Series XS snap switches and FXS factory sealed snap switches for use in hazardous locations, Class I, Groups C and D, and Class II, Groups E, F, and G with the following designations and ratings.

Cat. Nos. XS-1 through -14, -17 through -21, and -41 through -46, or FXS-1 through -12, with Suffix 1C, 2C, 3C, 4C, 5C, 6C, 7C, 8C, 9C, 1D, 2D, 3D, 5D, 7D, 1T, 2T, 3T, or 4T. The suffix may be repeated up to five times for XS Series and one suffix for FXS Series.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



CERTIFICATE OF COMPLIANCE

Certificate Number 20121228-E150827
Report Reference E150827 - 20001227
Issue Date 2012-DECEMBER-28

Issued to: KILLARK, DIV OF HUBBELL INC (DELAWARE)
3940 MARTIN LUTHER KING DR
ST LOUIS MO 63113

**This is to certify that
representative samples of**

ENCLOSURE ACCESSORIES FOR USE IN HAZARDOUS
LOCATIONS

Enclosure accessories for use in Class I, Groups C and D;
Class II, Groups E, F, and G and Class III Hazardous
Locations.

Enclosure bodies Cat. No. SWB followed by s.: -01 through
-14, -17 through -21, -31 through -38 and -41 through -46.

Have been investigated by UL in accordance with the
Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 1203 - Explosion-Proof and Dust-Ignition-Proof
Electrical Equipment for Use in Hazardous (Classified)
Locations

Additional Information: See the UL Online Certifications Directory at
www.ul.com/database for additional information

Only those products bearing the UL Classification Mark should be considered as being covered by
UL's Classification and Follow-Up Service.

The UL Classification Mark includes: UL in a circle: with the word "CLASSIFIED"  (as shown); a control
number (may be alphanumeric) assigned by UL; a statement to indicate the extent of UL's evaluation of
the product; and the product category name (product identity) as indicated in the appropriate UL
Directory.

Look for the UL Classification Mark on the product.



William R. Carney, Director, North American Certification Programs

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please
contact a local UL Customer Service Representative at www.ul.com/contactus





CERTIFICATION RECORD

The company named below has been authorized by CSA International to represent the products listed in this record as "CSA Certified" and to affix the CSA Mark to these products according to the terms and conditions of the CSA Service Agreement and applicable CSA program requirements (including additional Markings).

File No: 011712_C_000

Class No: 6248 01 SWITCHES Snap - For Hazardous Locations

SUBMITTOR

4501218 Killark, Div of Hubbell Inc.
(Delaware)
2112 Fenton Logistics Park Blvd
Fenton, Missouri 63026
United States

FACTORIES

4501218 Killark, Div of Hubbell Inc.
(Delaware)
2112 Fenton Logistics Park Blvd
Fenton, Missouri 63026
United States

September 17, 2012 (Replaces: July 28, 1998)

Class I, Groups C and D; Class II, Groups E, F and G; Class III:

- Series XP, XPB, XSP, Cat Nos XP-, XPB-, XSP-1 to -14 incl., -17 to -21 incl., with suffix numbers 1, 2 or 3 (these suffixes may be repeated up to five times).
- Series XDT, XDTF, Cat Nos XDT-, XDTF-1 to -14 incl., -17 to -21 incl., with or without suffix numbers or 3 (these suffixes, singly or in combination, may be repeated up to five times).
- Series XS, XT, Cat Nos XS-1, XT-1, each through -14, -17 through -21, and -41 through -46 with suffix number 1C, 2C, 3C, 4C, 5C, 6C, 7C, 8C, 9C, 1D, 2D, 3D, 5D, 7D, 1T, 2T, 3T or 4T. The suffix numbers may be repeated up to five times.

Note: Series XT and XT assemblies suitable for Encl 3 designation when provided with a Certified breather drain/fitting.

Max electrical ratings for above switches are as follows:

Series	Style	Ampere Rating		HP Rating
		125V	250V	230V ac, 250V
XP, XPB, XSP	1-pole	20	10	-

XDT, XDTF	2-pole	-	20	2
	3-way	10	5	-
	1-pole	10	5	-
	2-pole	10	10	-
	3-way	10	5	-
	Switch	Switch		-
XS, XT:	Suffix	Rating	Suffix	Rating
	-1C, -3C, -4C	R1	-1T	R8, R9
	-2C	R1, R3, R4		
	-5C, -6C, -7C	R1, R3, R5	-2T	R8, R9, R11
	-8C	R6	-3T	R8, R10
	-1D, -2D, -3D	R2, R4, R7		Alt., R8, R9
	-5D, -7D	R2, R3, R5	-4T	R13, R14
Switch Rating				
R1	120/277V 20A	R8		125V, 20A T
R2	120/277V 30A	R9		250V, 20A
R3	1 hp, 120V ac	R10		250V, 10A
R4	2 hp, 240V ac	R11		2 hp, 230V ac, 250V dc
R5	1 hp, 240V ac	R12		125V, 10A
R6	15A, 240/480V ac	R13		250V, 5A
	3 ph, 3 hp			
	240V ac	R14		125V, 10A T
	5 hp, 480V ac	R15		125V, 20A
R7	2 hp, 120V ac			

Class I, Groups C and D; Class II, Groups E, F and G; Class III; (Factory Sealed),(Component Packaged):

- Tumbler switches, single or double gang, Series FXS, Cat Nos FXS-1 to 12, followed by Suffix 1C to 6C, rated 20A, 120/277V ac; Cat Nos FXS-1 to -12 followed by Suffix 8C, rated 15A, 240/480V ac, 3 ph, 3 hp-240V ac; 5 hp-480V ac; Cat Nos FXS-1 to -12 followed by Suffix 9C, rated 20A-125V ac; 10A-250V ac; Cat Nos FXS-1 to -12, followed by Suffix 1, 2, 3, 5, 7 followed by Suffix D, rated 30A, 120/277V ac, 1 ph; Cat No FXS-1 to -12 followed by the following suffix:

Suffix		125V	250V	230V
1T	1 pole	20T	20	-
2T	2 pole	20T	20	2 hp
3T	3 way	20T	10	-
4T	4 way	10T	5	-

- Cover sub-assemblies may be shipped separately and are intended to be assembled during installation with "Killark" splice boxes Series FXB, single or double gang.

- Cover sub-assemblies, "Factory Sealed", tumbler switch, Series FXS; Cat Nos FXS-1C to 6C, rated 20A, 120/277V ac; Cat No FXS-8C, rated 15A, 240/480V ac, 3 ph, 3 hp-240V ac, 5 hp-480V ac; Cat No FXS-9C, rated 20A-125V ac, 10A-250V ac; Cat Nos FXS-1, 2, 3, 5, 7 followed by Suffix D, rated 30A, 120/277V ac, 1 ph.

Cat No		125V	250V	230V
FXS-1T	1 pole	20T	20	-
FXS-2T	2 pole	20T	20	2 hp
FXS-3T	3 way	20T	10	-
FXS-4T	4 way	10T	5	-

- Splice boxes, Cat Nos FXB-1 through FXB-6, single gang type; Cat Nos FXB-7 through FXB-12, double gang type, dead end or through feed 1/2 in, 3/4 in or 1 in hub.

Class I, Groups C and D; Class II, Groups E, F and G; Class III(Component Packaged):

- Tumbler switch and snap switches, single, double or multi-gang, Series XS and XT; Cat Nos XS and XT-1 through -14, -17 through -21, -31 through -38, 41 through -45; followed by Suffix 1, 2, 3, 4, 5, 6, 7, 8, 9, followed by Suffix C or D rated 30A, 120/277V ac; Cat Nos XS and XT-1 through -14, -17 through -21, -31 through -38, -41 through -45, followed by Suffix 1, 2, 3, 4, followed by T, rated:

Suffix		125V	250V	230V
1T	1 pole	20T	20	-
2T	2 pole	20T	20	2 hp
3T	3 way	20T	10	-
4T	4 way	10T	5	-

- Cover sub-assemblies may be shipped separately and are intended to be assembled during installation with "Killark" splice boxes, Series SWB, single, double or multi-gang.
- Cover sub-assemblies, tumbler and snap switches, Series XT and XS, Cat No XS-0 followed by Suffix 1, 2, 3, 4, 5, 6, 7, 8, 9 followed by C or D; Cat No XTS-0, followed by Suffix 1, 2, 3, 4, followed by T, and blank cover, Cat No X-10.

Notes:

1. Suffix numbers may be repeated up to five times.
2. Series XS and XT assemblies, suitable for Encl 3 designation when provided with a Certified breather/drain fitting.

Class I, Groups C and D; Class II, Groups E, F and G; Class III;

- Series No XST followed by 15 or 20, followed by 21C, 23C, 31C, 33C, 51C, 53C, 61C or 63C; Rated 20A max, 347VAC max.

ELECTRICAL RATINGS:

These devices have the following electrical ratings:

<i>Series XST Suffix</i>	<i>Switch Type</i>	<i>Hubbell Wiring Switch Cat. No.</i>	<i>Electrical Rating of Switch</i>
15-21C	Single pole	HBL18201CN	15A, 347VAC, 1 Phase
15-31C	Single pole	HBL18201CN	15A, 347VAC, 1 Phase
15-23C	3 way	HBL18203CN	15A, 347VAC, 1 Phase
15-33C	3 way	HBL18203CN	15A, 347VAC, 1 Phase
20-21C	Single pole	HBL18221CN	20A, 347VAC, 1 Phase
20-31C	Single pole	HBL18221CN	20A, 347VAC, 1 Phase
20-23C	3 way	HBL18223CN	20A, 347VAC, 1 Phase

/pl



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: EPSW-20A
Description: Explosion Proof Switch

Evaluated Listings:

CE: DIRECTIVE 2014/35/EU - LOW VOLTAGE DIRECTIVE
CE: DIRECTIVE 2014/30/EU - EMC DIRECTIVE
CE: Regulation (EC) No 1907/2006 - REACH REGULATION
CE: DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

The EPSW-20A series complies with the essential protection requirements of the European Parliament of the Council Directive for Low Voltage Directive, EMC Directive, REACH Regulation, and RoHS Directive. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: *James Thomas*

Name: James Thomas
Position: Operations Manager



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: EPSW-20A Series
Description: Explosion Proof Switch

Evaluated Listings:

CE: DIRECTIVE 2015/863/EU - ROHS DIRECTIVE

This is to certify that products offered by Larson Electronics LLC comply with the Reduction of Hazardous Substances (RoHS) directives. Directive 2002/95/EC became effective on 1 July 2006. It restricts the use of six substances in the manufacture of electrical and electronic equipment. This directive was revised in June 2011 and is now referred to as directive 2011/65/EU. Directive 2015/863/EU amending Annex II to Directive 2011/65/EU announced plans to add four substances from 22 July 2019.

We hereby certify that the equipment specified above conforms to the Directive(s) by containing less of the restricted substances than the stated limits.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: *James Thomas*

Name: James Thomas
Position: Operations Manager



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: EPSW-20A Series
Description: Explosion Proof Switch

Evaluated Listings:

CE: Regulation (EC) No 1907/2006 - REACH REGULATION

This letter establishes the opinion of Larson Electronics LLC regarding the status, under the current European Union ("EU") Regulations on Registration, Evaluation, Authorization, and Restriction of Chemical Substances ("REACH").

REACH does not apply to manufactured products which are referred to as "completed articles". Substances (chemicals) are subject to REACH registration, NOT products.

In addition, Articles are exempt from the REACH requirements if (a) the Article does not contain a substance of very high concern or candidate substance in an amount exceeding 0.1% weight by weight, and (b) if substances present in the Article in excess of 1 ton per year per importer are not expected nor intended to be released.

Based on communication with our raw material suppliers, we conclude that to the best of our knowledge our products requiring REACH compliance do not contain any of the currently listed SVHC in concentrations of 0.1% or above.

Accordingly, we foresee no registration or pre-registration requirement for the products we supply.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: *James Thomas*

Name: James Thomas
Position: Operations Manager



Certification

Manufacturer: Larson Electronics LLC
Address: 9419 US-HWY 175
Kemp, Texas 75143

Declare the following equipment conforms to the standard(s) as listed:

Model: EPSW Series
Description: Explosion Proof Switch

Evaluated Listings:

FCC: Radio Frequency Emission & Authorization Status

The EPSW series of Explosion Proof Switches comply with Federal Communications Commission requirements for Radio Frequency Emission & Authorization Status. This product is not capable of emitting rf energy and does not require FCC authorization. This certification applies to all specimens manufactured in accordance to the manufacture's drawings.

Signed for and on behalf of: Larson Electronics, LLC
Place of issue: Kemp, TX

Signature: *James Thomas*

Name: James Thomas
Position: Operations Manager



Frequently Asked Questions (FAQ)

There are no Faqs