Larson Electronics LLC
9419 E US HWY 175, Kemp, TX 75143
Phone: 800.369.6671

www.LarsonElectronics.com
Email: sales@LarsonElectronics.com
Fax: 903.498.3364

CGB-50

Cord Grip (to use with EYM) to seal off wiring connections to explosion proof lights

Product ID: 48440



Larson Electronics LLC manufactures a wide variety of products, including custom built to spec designs. The pictures displayed for this unit are a general representation of form factor for the product line and may not accurately represent this exact configuration in every detail due to custom builds and changes between similar products in our standard catalog. The specifics for this configuration are listed in the specification table and supporting documentation (CAD files, Dimensional Drawing, Name Plate Diagram, Wiring Diagram, etc.). This means that specific details (receptacles, plugs, wires, connections, mounting brackets, external finishes, etc.) may not be accurately represented in images vs specifications. Please review specifications and do not order based solely on images.

Cord Grip (to use with EYM) to seal off wiring connections to explosion proof lights

• .125-.187"	• Red
• .187-.312"	• Brown
• .312-.437"	• Yellow
• .375-.500"	• Purple
• .500-.625"	• Pink
• .625-750"	• Orange

The above table shows the outside diameter of the customer`s cord and the corresponding color of the cord grip that is appropriate for a cord of that diameter.


Common Cord Type Diameters

• 18 AWG • 16 AWG			

• 14 AWG • 12 AWG • 10 AWG			

• 8 AWG • 6 AWG • 4 AWG • 2 AWG • 1 AWG				



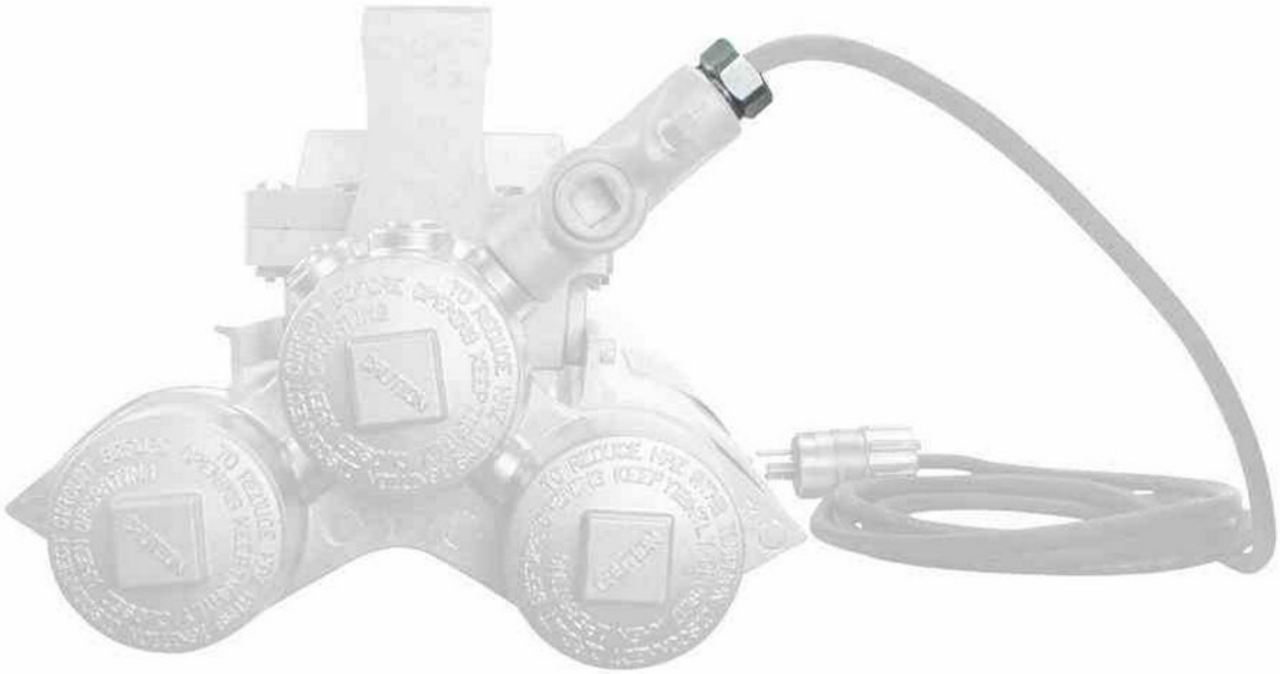

ONLINE CERTIFICATIONS DIRECTORY

Work smarter with UL Product iQ™
Improved access to UL's certification data.
Create your FREE ACCOUNT today!

QCRV.E96445
Outlet Bushings and Fittings

If you notice a change to your QCRV Listing Card, click here to learn more.

Page Bottom

Outlet Bushings and Fittings

See General Information for Outlet Bushings and Fittings

EDGEWATER MFG CO INC E96445
17-10 WILLOW ST
FAIR LAWN, NJ 07410-2057 USA

Trademark and/or Tradename: "AMERICAN FITTINGS CORPORATION" , "AMFICO" ,

Metallic liquid tight cord grip connectors Model(s) CG1*, CG10*, CG100-B560*, CG100-B650*, CG100-B750*, CG100-B850*, CG100-C1050*, CG100-C950*, CG100100AM*, CG100125AM*, CG11*, CG112125AM*, CG115150AM*, CG12*, CG125-C850*, CG125-C950*, CG125-D1050*, CG125-D1150*, CG125-D1250*, CG125-D1375*, CG1250AM*, CG125125AM*, CG125AM*, CG128150AM*, CG13*, CG137125AM*, CG14*, CG15*, CG150-D1050*, CG150-D1150*, CG150-D1250*, CG150-D1375*, CG153200AM*, CG16*, CG17*, CG18*, CG1850AM*, CG19*, CG2*, CG20*, CG21*, CG22*, CG23*, CG24*, CG25*, CG2575AM*, CG26*, CG27*, CG28*, CG3*, CG3150AM*, CG37100AM*, CG3750AM*, CG3775AM*, CG4*, CG5*, CG50-A250*, CG50-A350*, CG50-A450*, CG50-A560*, CG50-A650*, CG501000AM*, CG5050AM*, CG5075AM*, CG6*, CG62100AM*, CG6250AM*, CG6275AM*, CG7*, CG75-A250*, CG75-A350*, CG75-A450*, CG75-A560*, CG75-A650*, CG75-B750*, CG75-B850*, CG75100AM*, CG75125*, CG7575AM*, CG8*, CG87100AM*, CG87125AM*, CG9*

Metallic liquid tight cord grip connectors Model(s) CGB-50-RED, CGB-50-BRN, CGB-50-YLW, CGB-50-PRP, CGB-50-PNK, CGB-50-ORG, CGB-75-BLU, CGB-75-GRN, CGB-75-PRP, CGB-75-PNK, CGB-75-ORG, CGB-75-GRY, CGB-100-PRPL, CGB-100-PNK, CGB-100-ORG, CGB-100-GRY, CGB-100-RED, CGB-100-BLU

Investigated to ANSI/UL 514B 6th ed.(last revised 2014-06-04)

Metallic liquid tight cord grip connectors Model(s) CG50AA187*, CG50AA312*, CG50AA437*

* - May have suffix GT, AL, 45 or 90.

Last Updated on 2017-11-15

Questions? Print this page Terms of Use Page Top

© 2018 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2018 UL LLC".

Frequently Asked Questions (FAQ)