
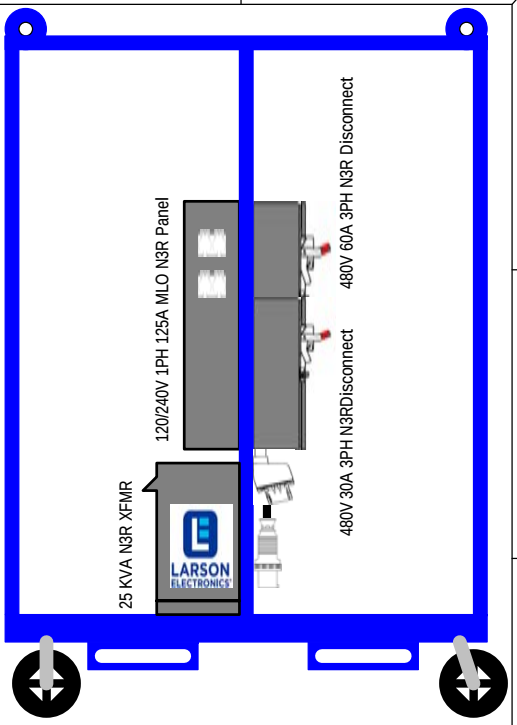


480V 30A 3PH N3R Disconnect
Installed 3X30A Time Delay Fuses

480V 60A N3R Disconnect
Installed 2X60A Time Delay Fuses

1 PH 3 WIRE
480V to 120/240V 1PH 25KVA N3R Transformer

120/240V 1PH 125A MLO N3R Panel

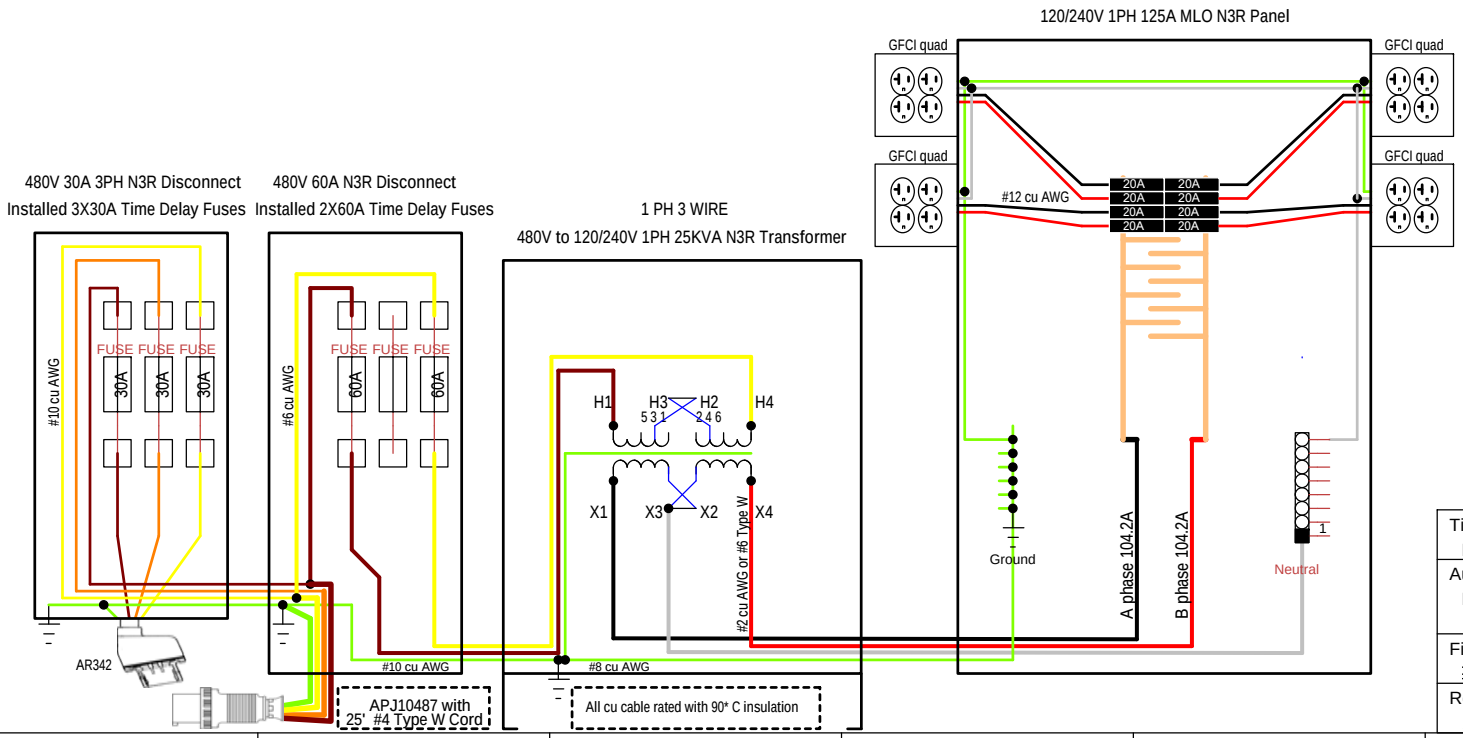

Title	MPD-DC-480.30A-25KVA-8X120.20A
Author	David Downs
File	30A 3PH 25KVA 120V 104.2A 1PH APJ10487.dsn
Document	
Revision	1.0
Date	04/02/2018
Sheets	1 of 1