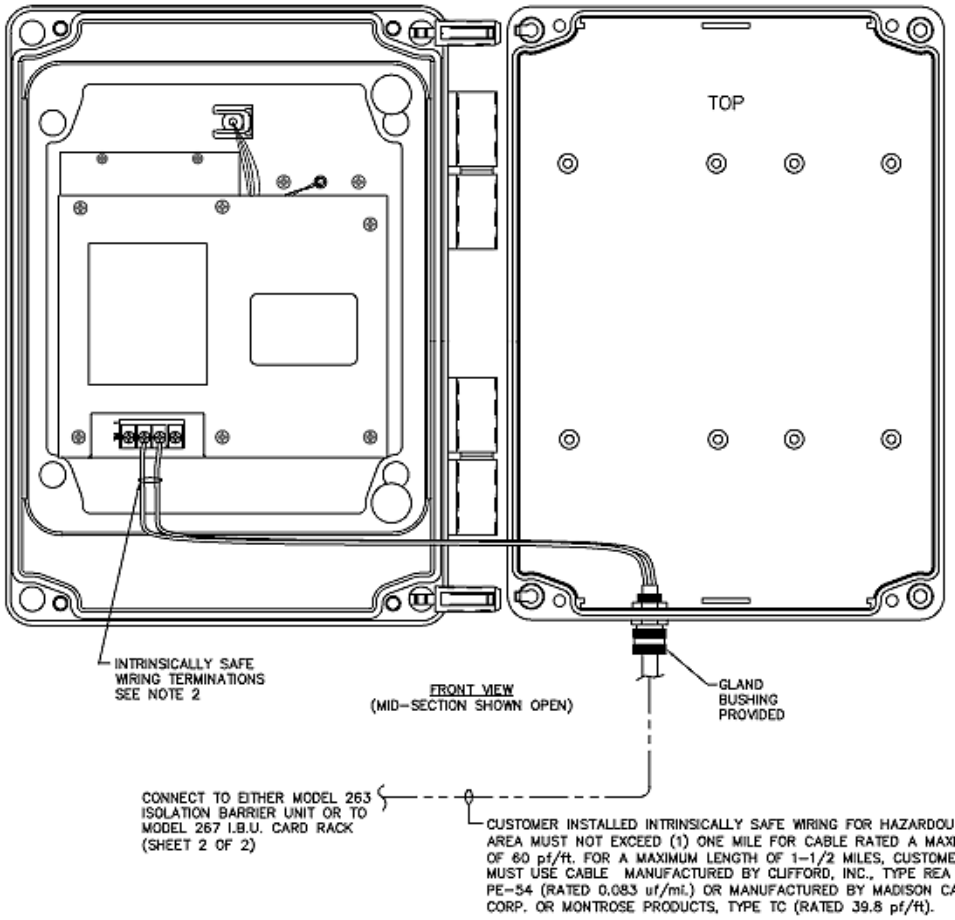

LARSON ELECTRONICS

TITLE:

EPPH-229AH Control Drawing

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF LARSON ELECTRONICS LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF LARSON ELECTRONICS LLC IS PROHIBITED.

		NAME			
	DRAWN		SIZE A	DWG. NO.	REV
MATERIAL	CHECKED				
DO NOT SCALE DRAWING					SHEET 1 OF 2

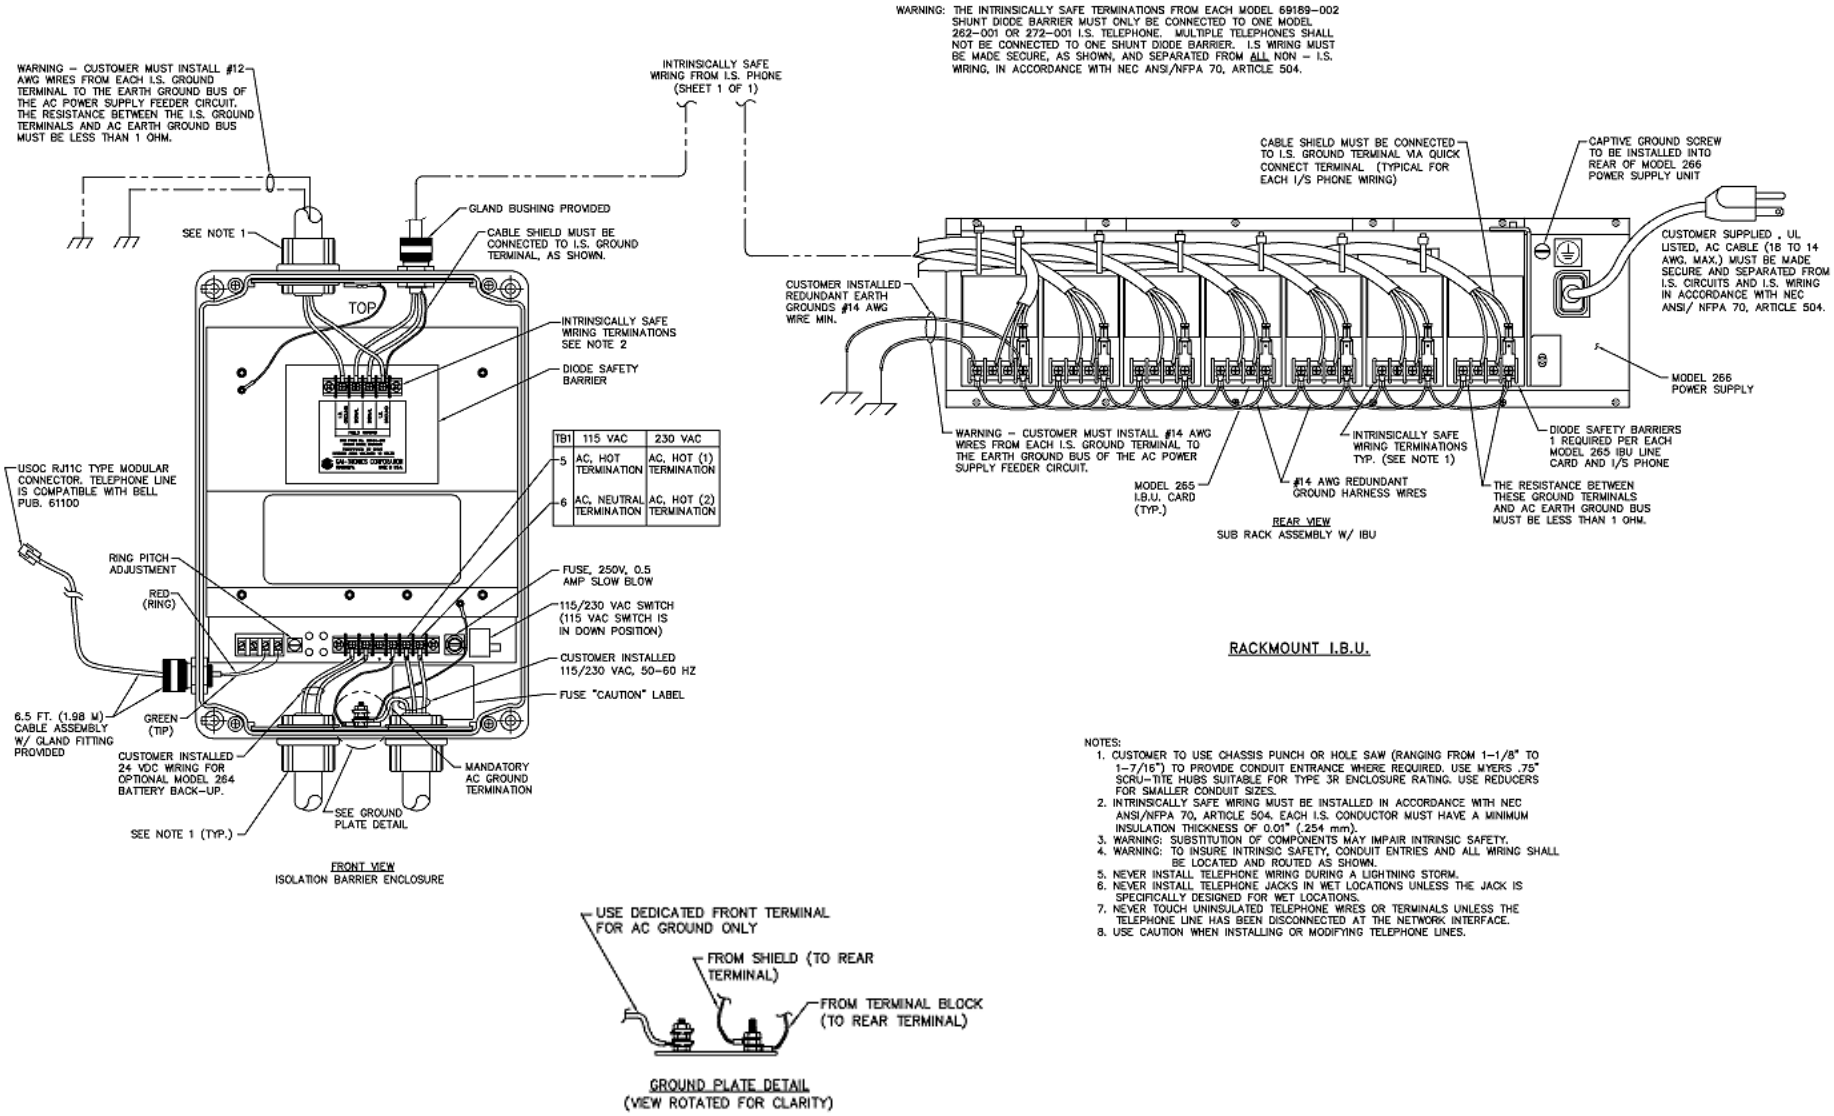

NOTES:
1. CUSTOMER TO USE CHASSIS PUNCH OR HOLE SAW (RANGING FROM 1-1/8" TO 1-7/16") TO PROVIDE CONDUIT ENTRANCE WHERE REQUIRED. USE MYERS .75" SCRU-TITE HUBS SUITABLE FOR TYPE 3R ENCLOSURE RATING. USE REDUCERS FOR SMALLER CONDUIT SIZES.
2. INTRINSICALLY SAFE WIRING MUST BE INSTALLED IN ACCORDANCE WITH NEC ANSI/NFPA 70, ARTICLE 504. EACH I.S. CONDUCTOR MUST HAVE A MINIMUM INSULATION THICKNESS OF 0.01" (.254 mm).
3. WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY.
4. WARNING: TO INSURE INTRINSIC SAFETY, CONDUIT ENTRIES AND ALL WIRING SHALL BE LOCATED AND ROUTED AS SHOWN.
5. NEVER INSTALL TELEPHONE WIRING DURING A LIGHTNING STORM.
6. NEVER INSTALL TELEPHONE JACKS IN WET LOCATIONS UNLESS THE JACK IS SPECIFICALLY DESIGNED FOR WET LOCATIONS.
7. NEVER TOUCH UNINSULATED TELEPHONE WIRES OR TERMINALS UNLESS THE TELEPHONE LINE HAS BEEN DISCONNECTED AT THE NETWORK INTERFACE.
8. USE CAUTION WHEN INSTALLING OR MODIFYING TELEPHONE LINES.

TITLE:

EPPH-229AH Control Drawing

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF LARSON ELECTRONICS LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF LARSON ELECTRONICS LLC IS PROHIBITED.

		NAME	SIZE	DWG. NO.	REV
	DRAWN		A		
MATERIAL	CHECKED				
DO NOT SCALE DRAWING					SHEET 2 OF 2